




PROBLEM SUMMARY


Area
MTR [73952]
 Machine Id
TINHGOV1
 Component
Hydraulic System
 Fluid
MOBIL DTE 746 (180 LTR)

Sample Rating Trend

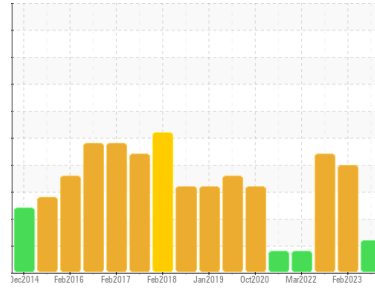

COMPONENT CONDITION SUMMARY

▲ Particle Trend

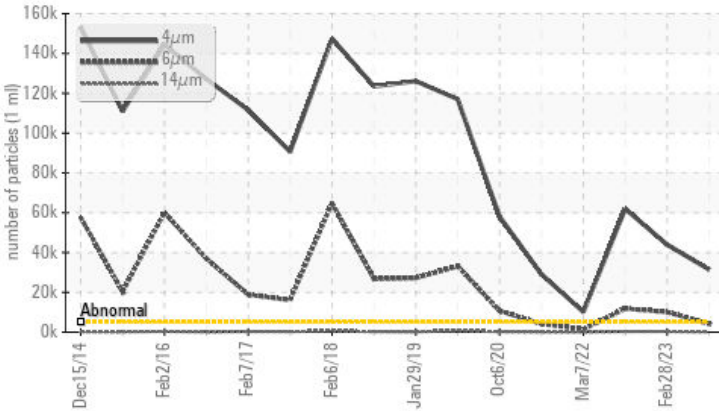

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	SEVERE	SEVERE
Particles >4µm	ASTM D7647	>5000	▲ 31439	● 43973	● 61909
Particles >6µm	ASTM D7647	>1300	▲ 4203	● 10114	● 11791
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 22/19/14	● 23/21/16	● 23/21/15

Customer Id: ALGMIS
 Sample No.: WC0862788
 Lab Number: 02587614
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Wes Davis +1 905-569-8600 x223
wesd@wearcheck.ca

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

28 Feb 2023 Diag: Wes Davis

ISO



Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. All component wear rates are normal. Particles >6µm are severely high. Particles >4µm are severely high. Oil Cleanliness are severely high. Particles >14µm are abnormally high. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



13 Sep 2022 Diag: Wes Davis

ISO



Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. All component wear rates are normal. Particles >6µm are severely high. Particles >4µm are severely high. Oil Cleanliness are severely high. Particles >14µm are notably high. Particles >21µm are notably high. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



07 Mar 2022 Diag: Wes Davis

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. Particles >4µm are abnormally high. Particles >6µm are notably high. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

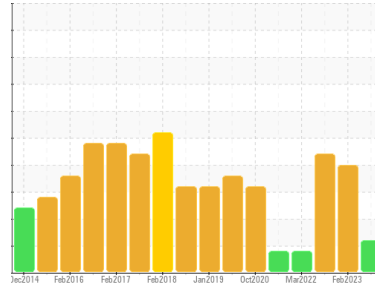

ISO



Area
MTR [73952]
 Machine Id
TINHGOV1
 Component
Hydraulic System
 Fluid
MOBIL DTE 746 (180 LTR)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0862788	WC0678268	WC0511684
Sample Date	Client Info		03 Oct 2023	28 Feb 2023	13 Sep 2022
Machine Age	mths	Client Info	0	0	0
Oil Age	mths	Client Info	48	1	36
Oil Changed	Client Info		Changed	Changed	Changed
Sample Status			ABNORMAL	SEVERE	SEVERE

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>20	<1	<1	2
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>20	0	0	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		<1	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	0	0
Lead	ppm	ASTM D5185(m)	>20	<1	0	0
Copper	ppm	ASTM D5185(m)	>20	<1	0	0
Tin	ppm	ASTM D5185(m)	>20	0	<1	<1
Antimony	ppm	ASTM D5185(m)		0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)		<1	<1	0
Barium	ppm	ASTM D5185(m)		<1	0	0
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		0	0	0
Calcium	ppm	ASTM D5185(m)		<1	0	0
Phosphorus	ppm	ASTM D5185(m)		0	0	0
Zinc	ppm	ASTM D5185(m)		1	<1	1
Sulfur	ppm	ASTM D5185(m)		17	15	20
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>15	0	<1	0
Sodium	ppm	ASTM D5185(m)		0	0	0
Potassium	ppm	ASTM D5185(m)	>20	0	0	0

FLUID CLEANLINESS





	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 31439	43973	61909
Particles >6µm	ASTM D7647	>1300	▲ 4203	10114	11791
Particles >14µm	ASTM D7647	>160	89	▲ 332	▲ 297
Particles >21µm	ASTM D7647	>40	17	49	▲ 62
Particles >38µm	ASTM D7647	>10	1	1	1
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 22/19/14	23/21/16	23/21/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974*	0.10	0.10	0.10	0.11




OIL ANALYSIS REPORT

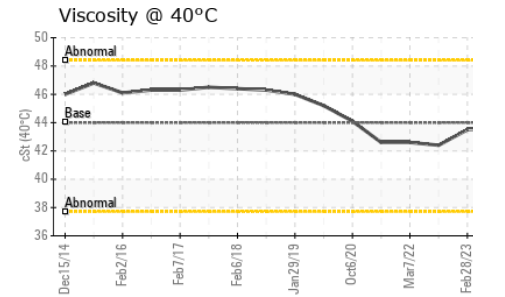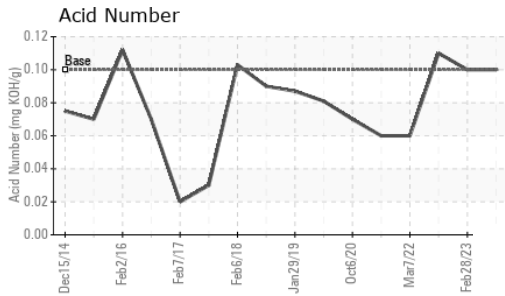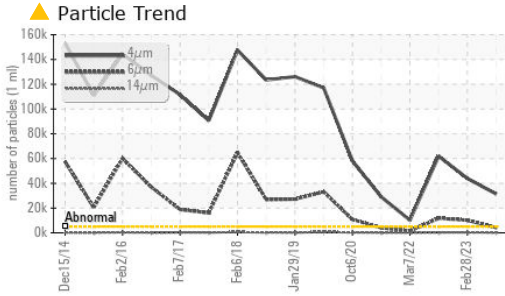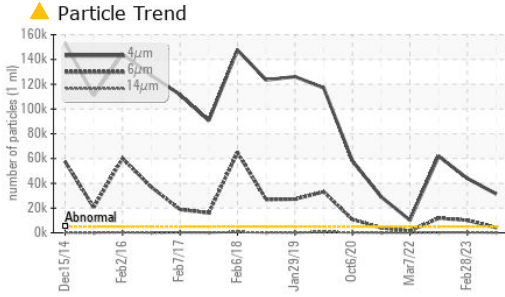






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	44.0	43.6	43.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

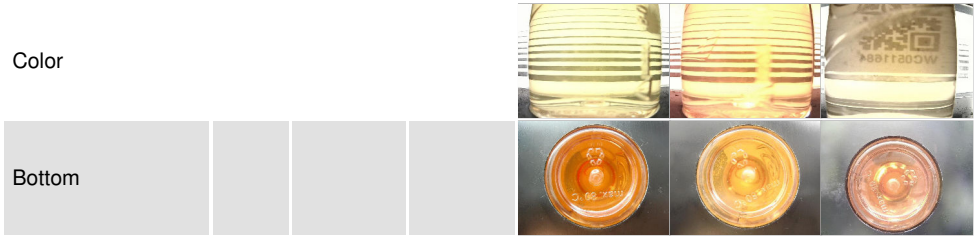

GRAPHS

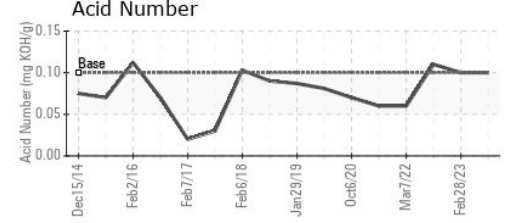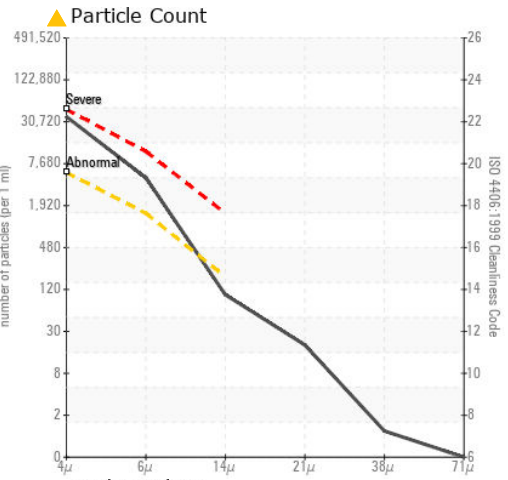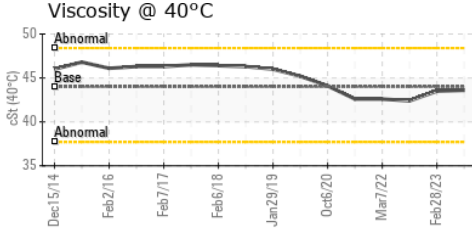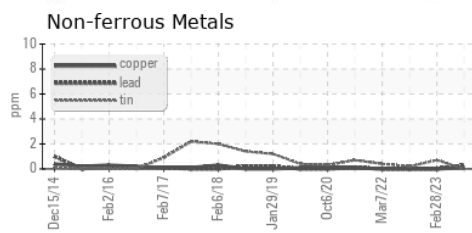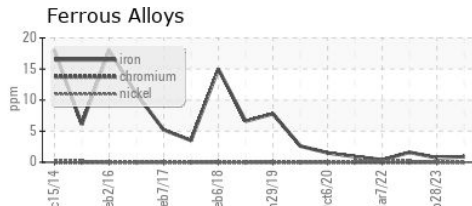

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 ALGONQUIN POWER SYSTEMS INC.
Sample No. : WC0862788 **Received** : 06 Oct 2023 354 DAVIS ROAD
Lab Number : 02587614 **Diagnosed** : 10 Oct 2023 OAKVILLE, ON
Unique Number : 5656680 **Diagnostician** : Wes Davis CA L6J 2X1
Test Package : IND 2 (Additional Tests: TAN Man)
 Contact: Antonino Champ Fernando
 antoninoChamp.fernando@algonquinpower.com
 T: (905)465-7065
 F: x:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.