



OIL ANALYSIS REPORT

Sample Rating Trend


NORMAL



Machine Id
25423986

Component
Diesel Engine

Fluid
PETRO CANADA DURON HP 15W40 (--- GAL)

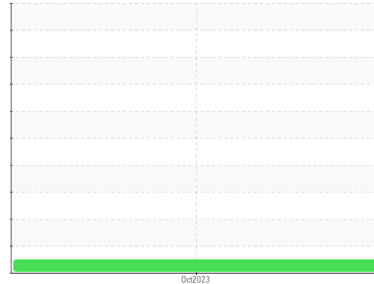

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

Metal levels are typical for a new component breaking in.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0867634	---	---
Sample Date	Client Info		05 Oct 2023	---	---
Machine Age	hrs	Client Info	221	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		Not Chngd	---	---
Sample Status			NORMAL	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>3.0	<1.0	---	---
Glycol	WC Method		NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>90	2	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>2	0	---	---
Titanium	ppm	ASTM D5185(m)	>2	0	---	---
Silver	ppm	ASTM D5185(m)	>2	<1	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<1	---	---
Lead	ppm	ASTM D5185(m)	>40	1	---	---
Copper	ppm	ASTM D5185(m)	>330	<1	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Antimony	ppm	ASTM D5185(m)		0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
Beryllium	ppm	ASTM D5185(m)		0	---	---
Cadmium	ppm	ASTM D5185(m)		0	---	---

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	0	12	---	---
Barium	ppm	ASTM D5185(m)	0	<1	---	---
Molybdenum	ppm	ASTM D5185(m)	60	57	---	---
Manganese	ppm	ASTM D5185(m)	0	0	---	---
Magnesium	ppm	ASTM D5185(m)	1010	916	---	---
Calcium	ppm	ASTM D5185(m)	1070	1137	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	1032	---	---
Zinc	ppm	ASTM D5185(m)	1270	1183	---	---
Sulfur	ppm	ASTM D5185(m)	2060	2603	---	---
Lithium	ppm	ASTM D5185(m)		<1	---	---

CONTAMINANTS


	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>25	3	---	---
Sodium	ppm	ASTM D5185(m)		2	---	---
Potassium	ppm	ASTM D5185(m)	>20	0	---	---

INFRA-RED


	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*	>6	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	5.2	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.8	---	---



OIL ANALYSIS REPORT

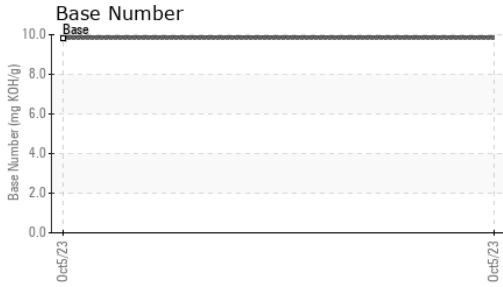

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.4	---	---
Base Number (BN)	mg KOH/g	ASTM D2896*	9.8	9.86	---	---

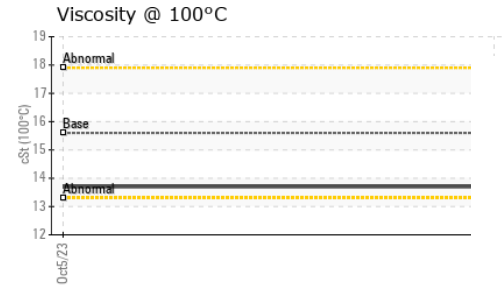

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	15.6	13.7	---	---

GRAPHS

Iron (ppm)

Lead (ppm)

Aluminum (ppm)

Chromium (ppm)

Copper (ppm)

Silicon (ppm)

Viscosity @ 100°C

Base Number



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **ONTARIO CLEAN WATER AGENCY**
Sample No. : WC0867634 **Received** : 06 Oct 2023 920 EAST AVENUE
Lab Number : **02587733** **Diagnosed** : 11 Oct 2023 MISSISSAUGA, ON
Unique Number : 5656799 **Diagnostician** : Wes Davis CA L5E 1W6
Test Package : MOB 2 Contact: George Kairys
 gkairys@ocwa.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T:
 F: (905)274-5906