



OIL ANALYSIS REPORT

Sample Rating Trend


NORMAL



Machine Id
24572408

Component
Diesel Engine

Fluid
DIESEL ENGINE OIL SAE 30 (--- GAL)

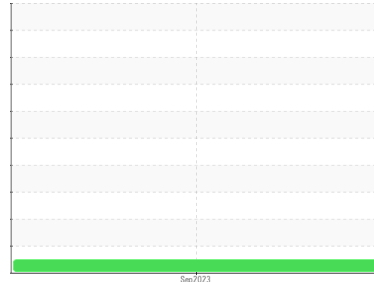

DIAGNOSIS

Recommendation

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. No other corrective action is recommended at this time. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) DIESEL ENGINE OIL SAE 30. Please confirm.

Wear

Metal levels are typical for a components first oil change.

Contamination

Light fuel dilution occurring. The water content is negligible. No other contaminants were detected in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0755025	---	---
Sample Date	Client Info	29 Sep 2023	---	---
Machine Age	hrs Client Info	309	---	---
Oil Age	hrs Client Info	309	---	---
Oil Changed	Client Info	Changed	---	---
Sample Status		NORMAL	---	---

CONTAMINATION

method	limit/base	current	history1	history2
Glycol	WC Method	NEG	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >100	9	---	---
Chromium	ppm ASTM D5185(m) >20	0	---	---
Nickel	ppm ASTM D5185(m) >4	<1	---	---
Titanium	ppm ASTM D5185(m)	0	---	---
Silver	ppm ASTM D5185(m) >3	<1	---	---
Aluminum	ppm ASTM D5185(m) >20	2	---	---
Lead	ppm ASTM D5185(m) >40	<1	---	---
Copper	ppm ASTM D5185(m) >330	10	---	---
Tin	ppm ASTM D5185(m) >15	<1	---	---
Antimony	ppm ASTM D5185(m)	0	---	---
Vanadium	ppm ASTM D5185(m)	0	---	---
Beryllium	ppm ASTM D5185(m)	0	---	---
Cadmium	ppm ASTM D5185(m)	0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 250	4	---	---
Barium	ppm ASTM D5185(m) 10	1	---	---
Molybdenum	ppm ASTM D5185(m) 100	<1	---	---
Manganese	ppm ASTM D5185(m)	1	---	---
Magnesium	ppm ASTM D5185(m) 450	17	---	---
Calcium	ppm ASTM D5185(m) 3000	2489	---	---
Phosphorus	ppm ASTM D5185(m) 1150	907	---	---
Zinc	ppm ASTM D5185(m) 1350	1071	---	---
Sulfur	ppm ASTM D5185(m) 4250	3157	---	---
Lithium	ppm ASTM D5185(m)	<1	---	---

CONTAMINANTS


method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >25	26	---	---
Sodium	ppm ASTM D5185(m) >75	2	---	---
Potassium	ppm ASTM D5185(m) >20	4	---	---
Fuel	% ASTM D7593* >5	1.1	---	---
Water	% ASTM D6304* >0.2	0.053	---	---
ppm Water	ppm ASTM D6304* >2000	535.5	---	---

INFRA-RED

method	limit/base	current	history1	history2
Soot %	% ASTM D7844* >3	0	---	---
Nitration	Abs/cm ASTM D7624* >20	7.7	---	---
Sulfation	Abs.1mm ASTM D7415* >30	17.1	---	---



OIL ANALYSIS REPORT










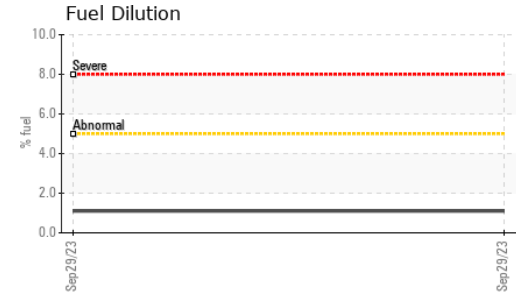


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	11.0	---	---

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	10.9	11.2	---	---

GRAPHS

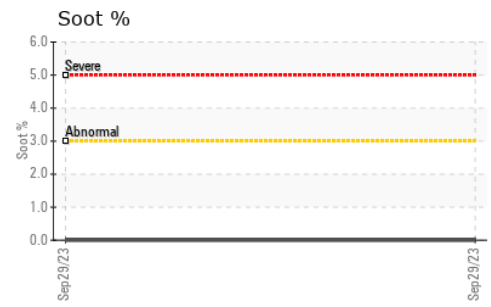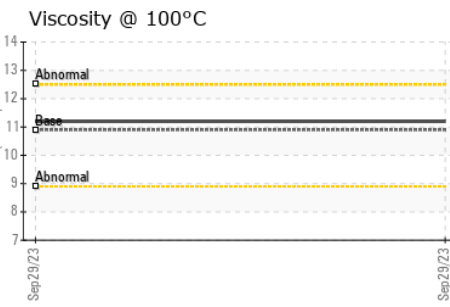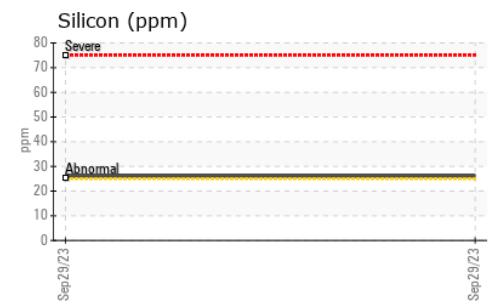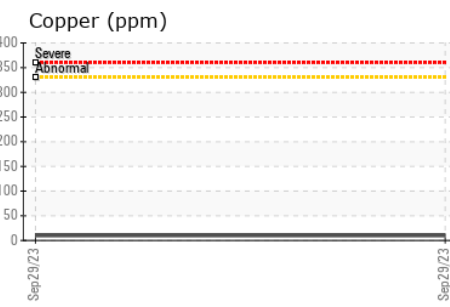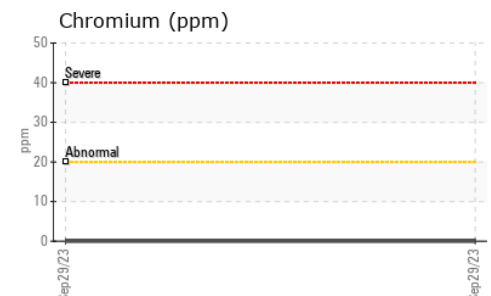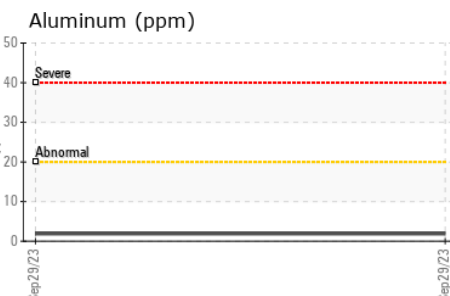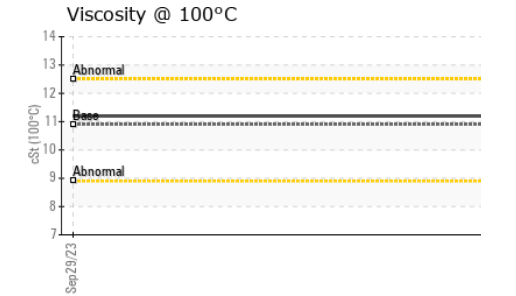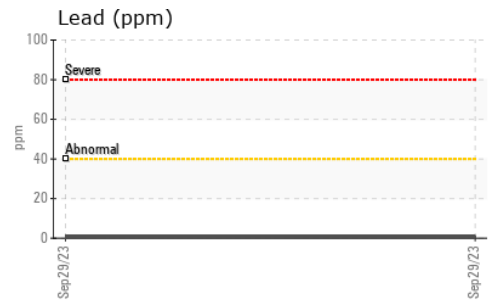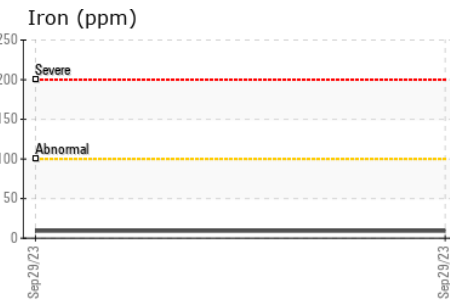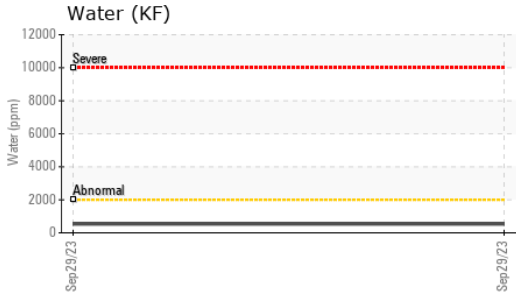

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0755025 **Received** : 11 Oct 2023
Lab Number : **02588076** **Diagnosed** : 12 Oct 2023
Unique Number : 5657142 **Diagnostician** : Kevin Marson
Test Package : MOB 1 (Additional Tests: FuelDilution, KF, PercentFuel)

AXIOM EQUIPMENT INC
 PO BOX 148
 OXBOW, SK
 CA S0C 2B0
 Contact: Jaco Steyn
 jaco.steyn@axiomequipmentgroup.com
 T: (306)485-6938
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.