PROBLEM SUMMARY

Sample Rating Trend

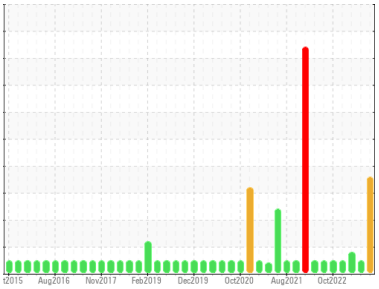

ISO

Area
Temboard/Service/Stock Preparation
Machine Id
N/A N/A [804-236-010] TB Softwood Refiner #1
Component
Hydraulic System
Fluid
SHELL TELLUS 68 (37 LTR)

COMPONENT CONDITION SUMMARY

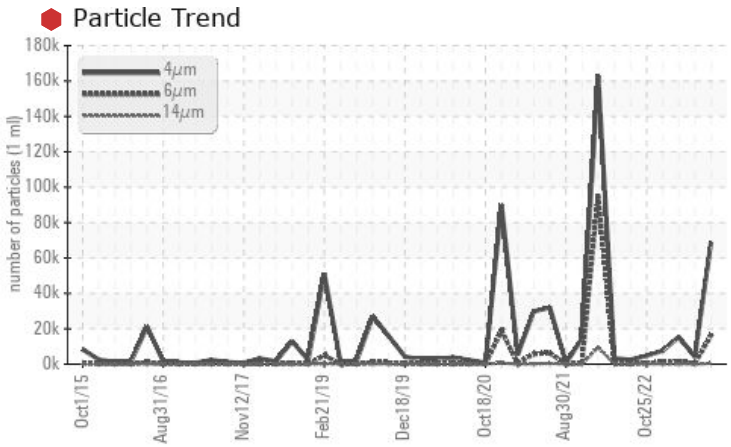

RECOMMENDATION

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	NORMAL	ATTENTION
Particles >6µm		ASTM D7647	>1300	**16274**	383	1602
Particles >14µm		ASTM D7647	>160	**467**	14	83
Particles >21µm		ASTM D7647	>40	**74**	6	27
Oil Cleanliness		ISO 4406 (c)	>--/17/14	**23/21/16**	19/16/11	21/18/14

Customer Id: TEMTEMMD
Sample No.: WC0841330
Lab Number: 02588279
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Wes Davis +1 905-569-8600 x223
wesd@wearcheck.ca

To change component or sample information:
Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	Resample in 30-45 days to monitor this situation.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.

HISTORICAL DIAGNOSIS

18 Jun 2023 Diag: Wes Davis

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

18 Apr 2023 Diag: Wes Davis

ISO

We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a light amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

18 Dec 2022 Diag: Wes Davis

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

OIL ANALYSIS REPORT

Sample Rating Trend

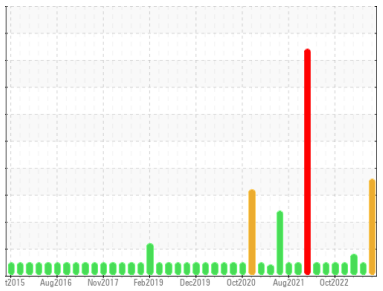

ISO

Area
Temboard/Service/Stock Preparation
Machine Id
N/A N/A [804-236-010] TB Softwood Refiner #1
Component
Hydraulic System
Fluid
SHELL TELLUS 68 (37 LTR)

DIAGNOSIS

Recommendation

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0841330**	WC0822101	WC0803280
Sample Date		Client Info		**18 Aug 2023**	18 Jun 2023	18 Apr 2023
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**SEVERE**	NORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	**3**	2	2
Chromium	ppm	ASTM D5185(m)	>20	**0**	0	0
Nickel	ppm	ASTM D5185(m)	>20	**0**	<1	0
Titanium	ppm	ASTM D5185(m)		**0**	0	0
Silver	ppm	ASTM D5185(m)		**<1**	0	0
Aluminum	ppm	ASTM D5185(m)	>20	**0**	0	0
Lead	ppm	ASTM D5185(m)	>20	**0**	0	0
Copper	ppm	ASTM D5185(m)	>20	**<1**	<1	0
Tin	ppm	ASTM D5185(m)	>20	**0**	0	0
Antimony	ppm	ASTM D5185(m)		**0**	0	<1
Vanadium	ppm	ASTM D5185(m)		**0**	0	0
Beryllium	ppm	ASTM D5185(m)		**0**	0	0
Cadmium	ppm	ASTM D5185(m)		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		**<1**	0	0
Barium	ppm	ASTM D5185(m)		**<1**	0	0
Molybdenum	ppm	ASTM D5185(m)		**0**	0	0
Manganese	ppm	ASTM D5185(m)		**0**	0	0
Magnesium	ppm	ASTM D5185(m)	11	**<1**	<1	0
Calcium	ppm	ASTM D5185(m)	39	**51**	51	51
Phosphorus	ppm	ASTM D5185(m)	260	**346**	367	368
Zinc	ppm	ASTM D5185(m)	279	**450**	434	424
Sulfur	ppm	ASTM D5185(m)	2109	**3077**	3651	4190
Lithium	ppm	ASTM D5185(m)		**<1**	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	**3**	4	3
Sodium	ppm	ASTM D5185(m)		**0**	0	0
Potassium	ppm	ASTM D5185(m)	>20	**0**	<1	0
Water	%	ASTM D6304*	>0.05	**0.001**	0.00	0.00
ppm Water	ppm	ASTM D6304*	>500	**14.1**	0.00	0.00

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		**68781**	4094	15367
Particles >6µm		ASTM D7647	>1300	**16274**	383	1602
Particles >14µm		ASTM D7647	>160	**467**	14	83
Particles >21µm		ASTM D7647	>40	**74**	6	27
Particles >38µm		ASTM D7647	>10	**4**	1	0
Particles >71µm		ASTM D7647	>3	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/14	**23/21/16**	19/16/11	21/18/14

OIL ANALYSIS REPORT

Particle Trend

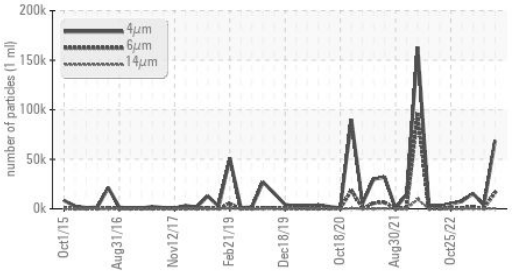

Water (KF)

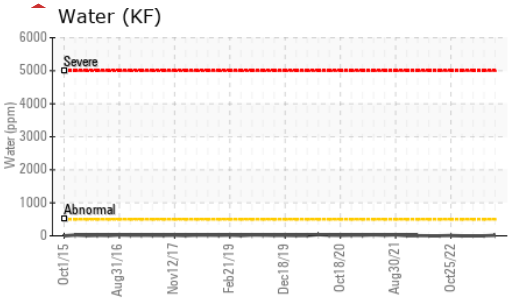

Acid Number

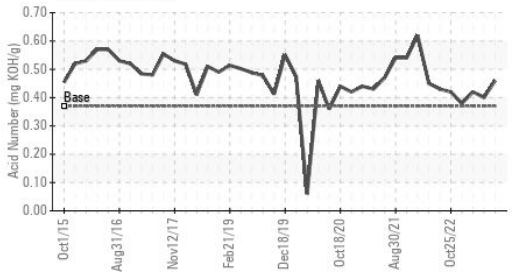

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.37	**0.46**	0.40	0.42

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Precipitate	scalar	Visual*	NONE	**NONE**	NONE	NONE
Silt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Debris	scalar	Visual*	NONE	**VLITE**	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	**VLITE**	NONE	NONE
Appearance	scalar	Visual*	NORML	**NORML**	NORML	NORML
Odor	scalar	Visual*	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	**NEG**	NEG	NEG
Free Water	scalar	Visual*		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	69.43	**65.9**	65.1	65.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

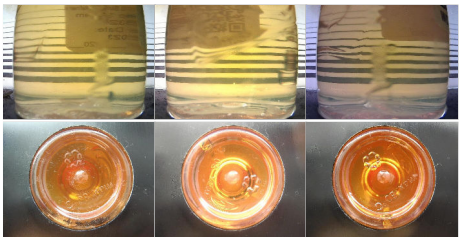

Water (KF)

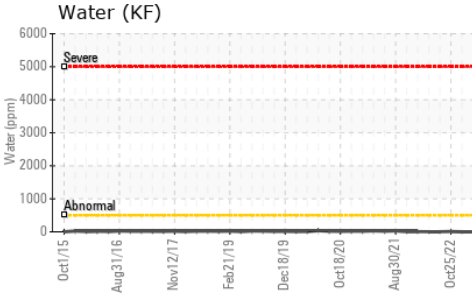

Viscosity @ 40°C

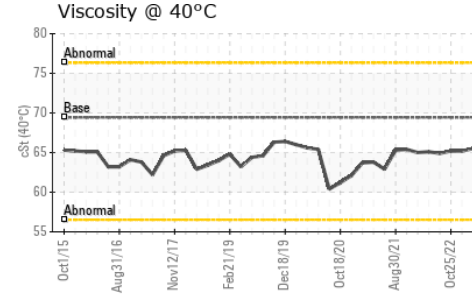

GRAPHS

Ferrous Alloys

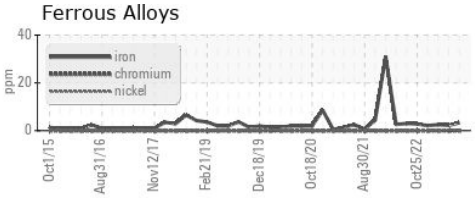

Non-ferrous Metals

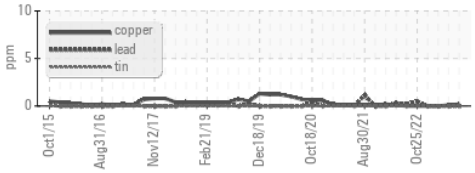

Viscosity @ 40°C

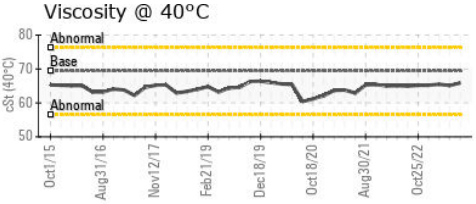

Particle Count

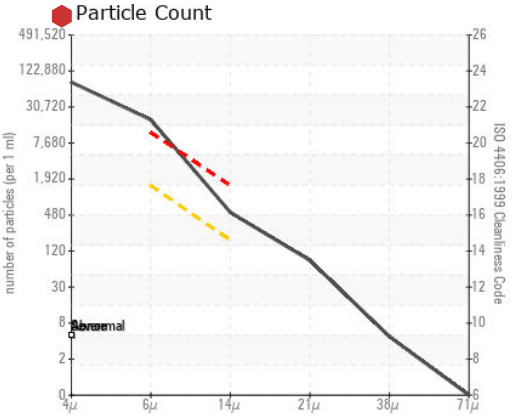

Acid Number

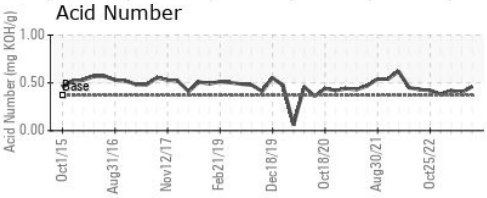

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0841330 **Received** : 11 Oct 2023
Lab Number : 02588279 **Diagnosed** : 12 Oct 2023
Unique Number : 5657345 **Diagnostician** : Wes Davis
Test Package : IND 2 (Additional Tests: KF, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

Rayonier Advanced Materials
P.O.Box 6000, 33 Kipawa Road
Temiscaming, QC
CA J0Z 3R0
Contact: Santosh Raikar
santosh.raikar@rayonieram.com
T: (819)627-4931
F: (819)627-1507