




COOLANT REPORT

Sample Rating Trend

NORMAL



Area
[198702]
Machine Id
GD5867B
Component
Coolant
Fluid
HYBRID (HOAT) COOLANT (--- GAL)

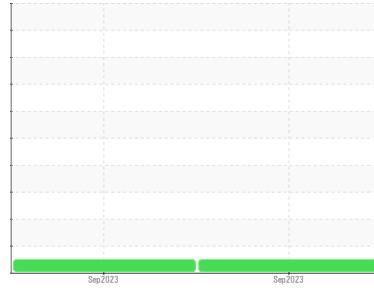

DIAGNOSIS

Recommendation

Le fluide peut encore servir. Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition.

Corrosion

Les concentrations de tous les métaux sont normales indiquant qu'il n'y a pas de corrosion dans le système de refroidissement.

Contaminants

Il n'y a aucun indice de contamination dans l'agent de refroidissement.

Coolant Condition

Le niveau de nitrite est acceptable. Le niveau de pH de ce fluide est dans les limites acceptables. La réserve d'alcalinité de ce fluide est acceptable.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	GD0005909	GD0005908	---
Sample Date	Client Info	21 Sep 2023	20 Sep 2023	---
Machine Age	hrs Client Info	0	0	---
Oil Age	hrs Client Info	0	0	---
Oil Changed	Client Info	N/A	N/A	---
Sample Status		NORMAL	NORMAL	---

PHYSICAL TEST RESULTS

method	limit/base	current	history1	history2
Specific Gravity	ASTM D1298*	1.069	1.069	---
pH	Scale 0-14 ASTM D1287*	8.08	7.61	---
Nitrites	ppm Alcan Test Kit*	520	320	---
Reserve Alkalinity	Scale 0-20 ASTM D1121*	3.3	2.3	---
Percentage Glycol	% ASTM D3321*	51.2	51.5	---
Freezing Point	°C ASTM D3321*	-38	-38	---
Carboxylate		---	---	---

CORROSION INHIBITORS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m)	58	81	---
Phosphorus	ppm ASTM D5185(m)	27	65	---
Boron	ppm ASTM D5185(m)	122	29	---
Molybdenum	ppm ASTM D5185(m)	4	<1	---

CORROSION

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >15	0	12	---
Aluminum	ppm ASTM D5185(m) >10	0	0	---
Copper	ppm ASTM D5185(m) >10	0	0	---
Lead	ppm ASTM D5185(m) >10	0	<1	---
Tin	ppm ASTM D5185(m) >10	0	0	---
Silver	ppm ASTM D5185(m) >10	<1	<1	---
Zinc	ppm ASTM D5185(m)	0	0	---

CARRIER SALTS


method	limit/base	current	history1	history2
Sodium	ppm ASTM D5185(m)	2045	1795	---
Potassium	ppm ASTM D5185(m)	1873	2801	---

SCALE POTENTIAL

method	limit/base	current	history1	history2
Calcium	ppm ASTM D5185(m) >100	2	3	---
Magnesium	ppm ASTM D5185(m) >40	<1	<1	---
Hardness	mg/L CaCO3 In-house* <75	5	10	---








VISUAL

method	limit/base	current	history1	history2
Coolant Color	Visual*	Pink	Orange	---
Coolant Appearance	Visual*	Clear	Clear	---

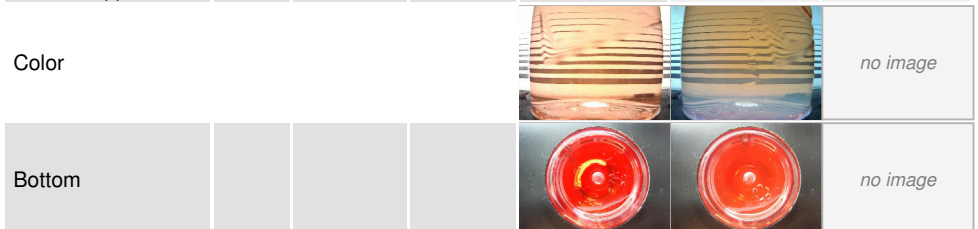



COOLANT REPORT

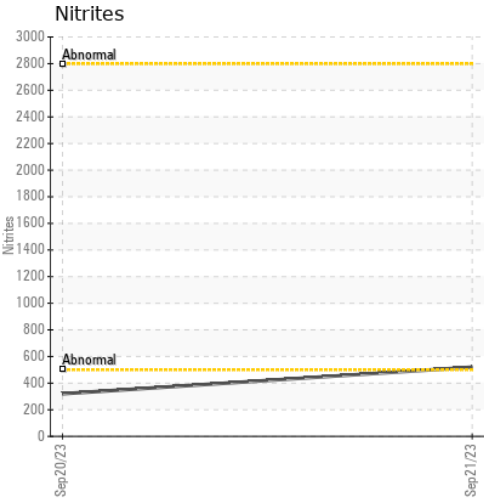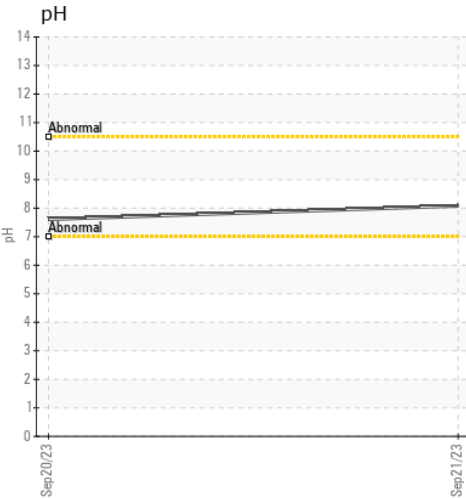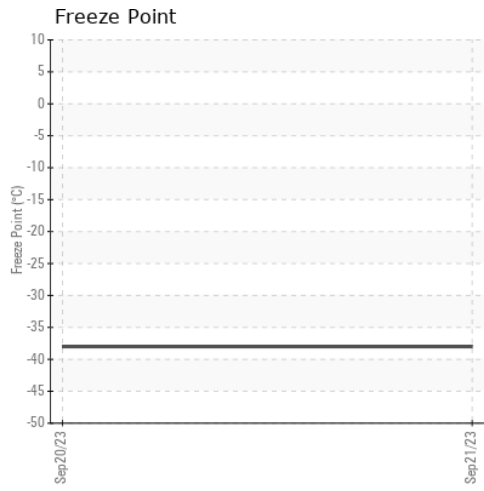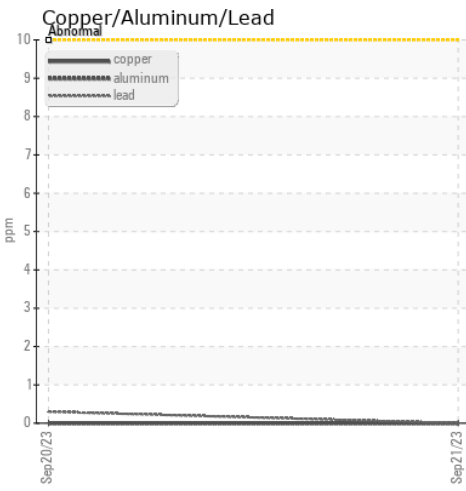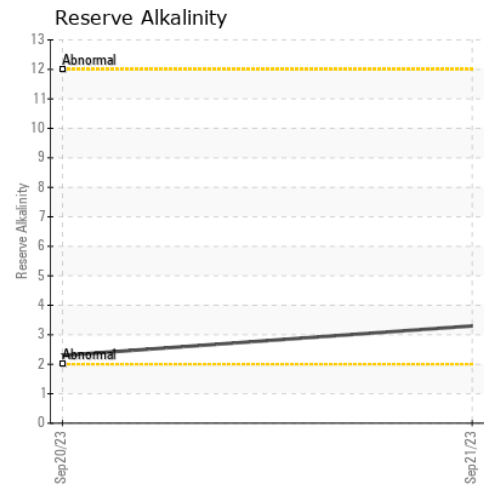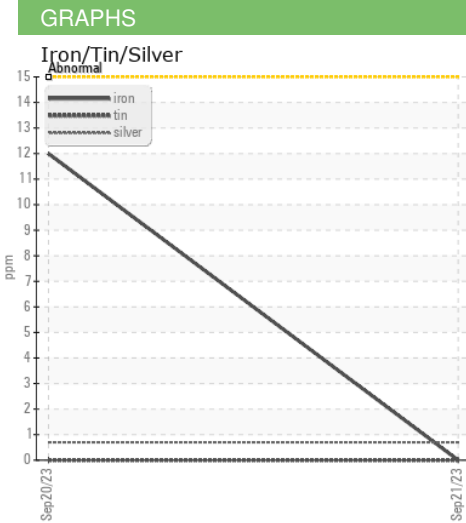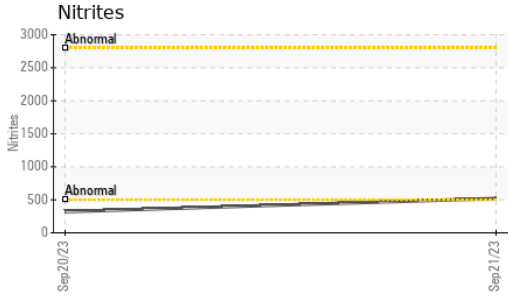

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : GD0005909
Lab Number : 02588409
Unique Number : 5657475
Test Package : COOL

Generatrice Drummond
 243 rue des ARTISANS
 SAINT-GERMAIN-DE-GRANTHAM, QC
 CA J0C 1K0
 Contact: Valerie Poirier
 poiirivalerie@generatricedrummond.com
 T: (819)398-6811
 F: (819)398-7022

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.