



# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Machine Id  
**NO UNIT WC0716342**  
 Component  
**Diesel Engine**  
 Fluid  
**DIESEL ENGINE OIL SAE 30 (--- GAL)**



## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) DIESEL ENGINE OIL SAE 30. Please confirm. Please specify the component make and model with your next sample.

### Wear

Metal levels are typical for a components first oil change.

### Contamination

Light fuel dilution occurring. No other contaminants were detected in the oil.

### Fluid Condition

The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0716342</b>	---	---
Sample Date	Client Info	<b>20 Sep 2023</b>	---	---
Machine Age	hrs Client Info	<b>500</b>	---	---
Oil Age	hrs Client Info	<b>500</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>NORMAL</b>	---	---

## CONTAMINATION

method	limit/base	current	history1	history2
Glycol	WC Method	<b>NEG</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >100	<b>56</b>	---	---
Chromium	ppm ASTM D5185(m) >20	<b>1</b>	---	---
Nickel	ppm ASTM D5185(m) >4	<b>1</b>	---	---
Titanium	ppm ASTM D5185(m)	<b>0</b>	---	---
Silver	ppm ASTM D5185(m) >3	<b>&lt;1</b>	---	---
Aluminum	ppm ASTM D5185(m) >20	<b>8</b>	---	---
Lead	ppm ASTM D5185(m) >40	<b>1</b>	---	---
Copper	ppm ASTM D5185(m) >330	<b>2</b>	---	---
Tin	ppm ASTM D5185(m) >15	<b>0</b>	---	---
Antimony	ppm ASTM D5185(m)	<b>0</b>	---	---
Vanadium	ppm ASTM D5185(m)	<b>0</b>	---	---
Beryllium	ppm ASTM D5185(m)	<b>0</b>	---	---
Cadmium	ppm ASTM D5185(m)	<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 250	<b>63</b>	---	---
Barium	ppm ASTM D5185(m) 10	<b>&lt;1</b>	---	---
Molybdenum	ppm ASTM D5185(m) 100	<b>94</b>	---	---
Manganese	ppm ASTM D5185(m)	<b>0</b>	---	---
Magnesium	ppm ASTM D5185(m) 450	<b>54</b>	---	---
Calcium	ppm ASTM D5185(m) 3000	<b>2213</b>	---	---
Phosphorus	ppm ASTM D5185(m) 1150	<b>1032</b>	---	---
Zinc	ppm ASTM D5185(m) 1350	<b>1184</b>	---	---
Sulfur	ppm ASTM D5185(m) 4250	<b>3209</b>	---	---
Lithium	ppm ASTM D5185(m)	<b>&lt;1</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >25	<b>17</b>	---	---
Sodium	ppm ASTM D5185(m) >75	<b>6</b>	---	---
Potassium	ppm ASTM D5185(m) >20	<b>2</b>	---	---
Fuel	% ASTM D7593* >5	<b>1.9</b>	---	---

## INFRA-RED



method	limit/base	current	history1	history2
Soot %	% ASTM D7844* >3	<b>0</b>	---	---
Nitration	Abs/cm ASTM D7624* >20	<b>8.7</b>	---	---
Sulfation	Abs/.1mm ASTM D7415* >30	<b>18.9</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm ASTM D7414* >25	<b>14.1</b>	---	---










# OIL ANALYSIS REPORT

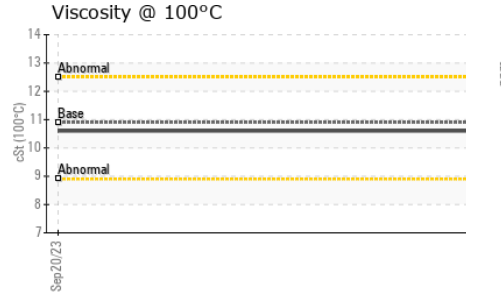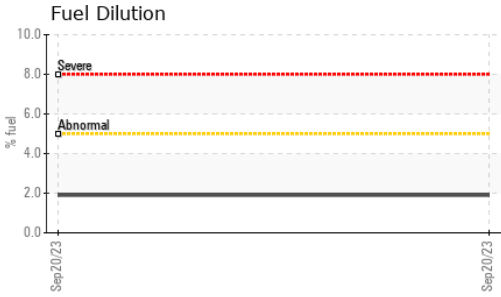

VISUAL	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	---
Free Water	scalar	Visual*		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	10.9	10.6	---

## GRAPHS

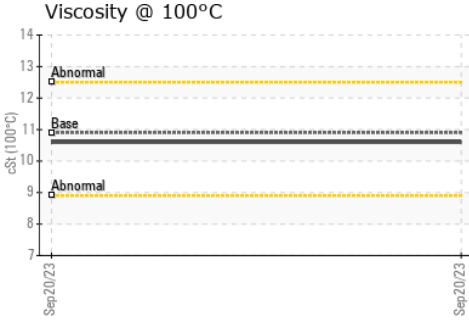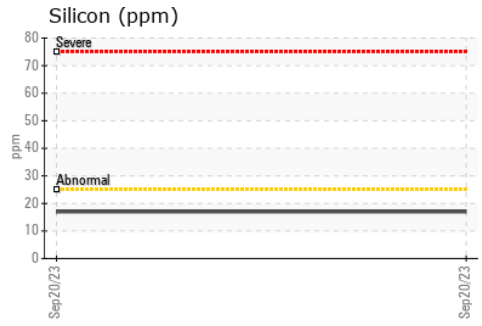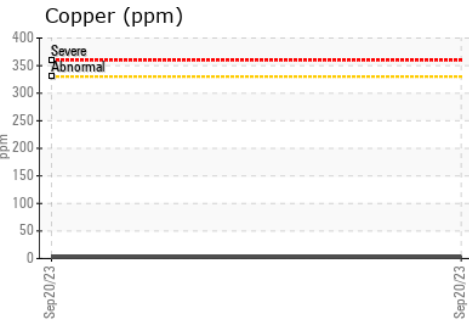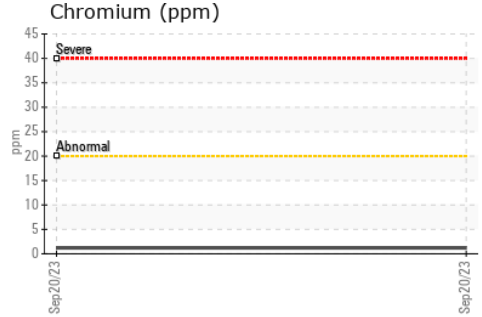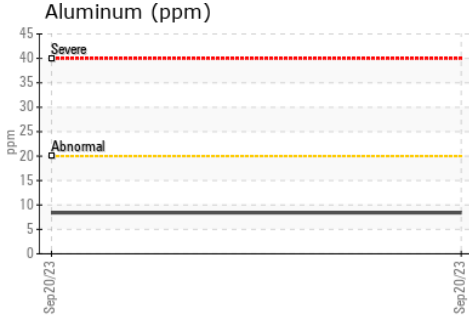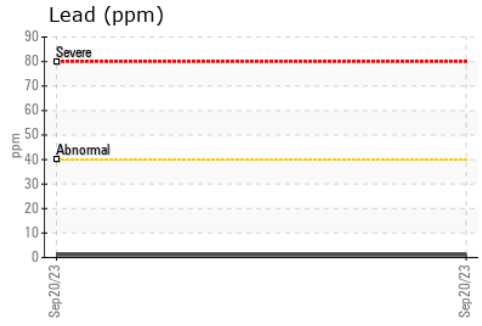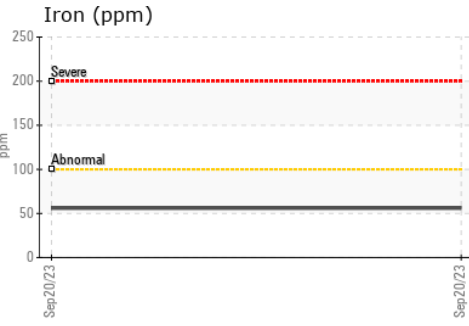

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0716342 **Received** : 12 Oct 2023  
**Lab Number** : 02588486 **Diagnosed** : 13 Oct 2023  
**Unique Number** : 5657552 **Diagnostician** : Kevin Marson  
**Test Package** : MOB 1 ( Additional Tests: FuelDilution, PercentFuel )

**COLACEM CANADA INC**  
 56 RUE LONGUEUIL CP 301  
 L'ORIGINAL, ON  
 CA K0B 1K0  
 Contact: Michel Landriault  
 mlandriault@colacem.ca  
 T: (613)675-2747

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.