


OIL ANALYSIS REPORT

Sample Rating Trend

FUEL

Area
[6100213424]
Machine Id
06R0709503
Component
Diesel Engine
Fluid
NOT GIVEN (--- GAL)

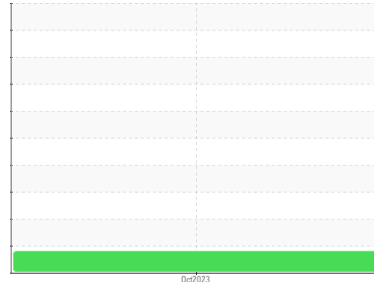

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the component make and model with your next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

▲ Contamination

Light fuel dilution occurring. No other contaminants were detected in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WA0020653	---	---
Sample Date	Client Info		05 Oct 2023	---	---
Machine Age	hrs	Client Info	4227777	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			MARGINAL	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Glycol	WC Method		NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >100	9	---	---
Chromium	ppm	ASTM D5185(m) >20	<1	---	---
Nickel	ppm	ASTM D5185(m) >4	<1	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m) >3	<1	---	---
Aluminum	ppm	ASTM D5185(m) >20	2	---	---
Lead	ppm	ASTM D5185(m) >40	2	---	---
Copper	ppm	ASTM D5185(m) >330	<1	---	---
Tin	ppm	ASTM D5185(m) >15	0	---	---
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	34	---	---
Barium	ppm	ASTM D5185(m)	<1	---	---
Molybdenum	ppm	ASTM D5185(m)	39	---	---
Manganese	ppm	ASTM D5185(m)	0	---	---
Magnesium	ppm	ASTM D5185(m)	465	---	---
Calcium	ppm	ASTM D5185(m)	1575	---	---
Phosphorus	ppm	ASTM D5185(m)	680	---	---
Zinc	ppm	ASTM D5185(m)	804	---	---
Sulfur	ppm	ASTM D5185(m)	1905	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	6	---	---
Sodium	ppm	ASTM D5185(m)	3	---	---
Potassium	ppm	ASTM D5185(m) >20	2	---	---
Fuel	%	ASTM D7593* >5	▲ 3.5	---	---



INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844* >3	0.5	---	---
Nitration	Abs/cm	ASTM D7624* >20	8.0	---	---
Sulfation	Abs/.1mm	ASTM D7415* >30	27.3	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414* >25	29.6	---	---









OIL ANALYSIS REPORT

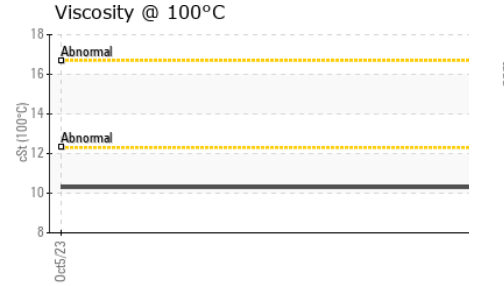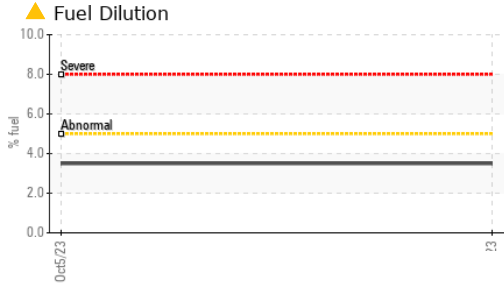

VISUAL	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	---
Free Water	scalar	Visual*		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	10.3	---	---

GRAPHS

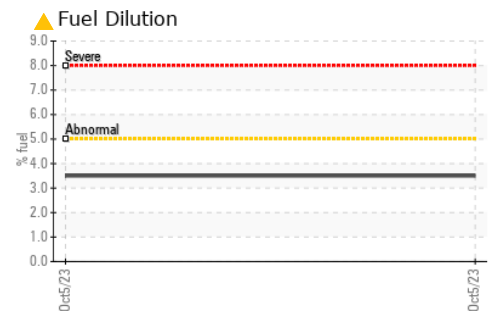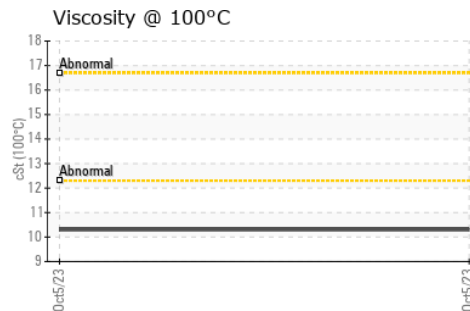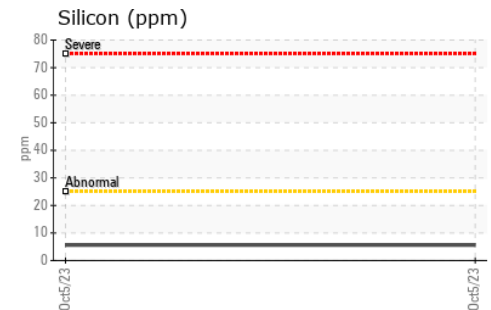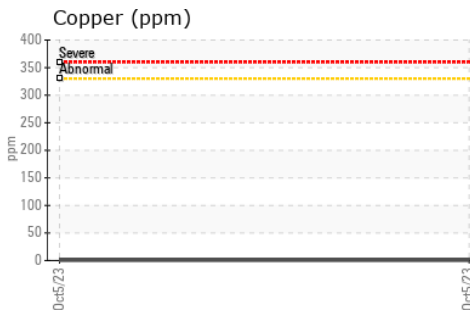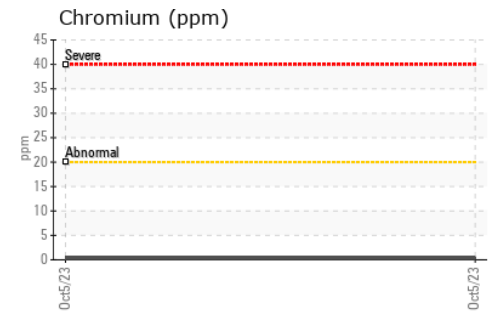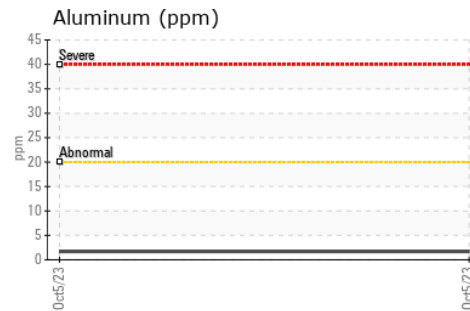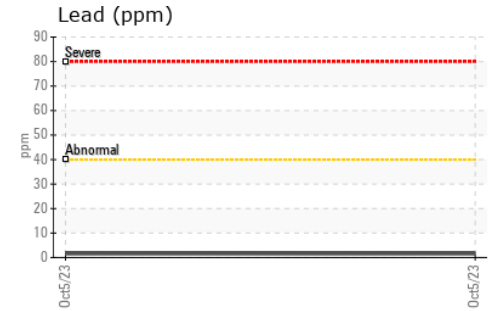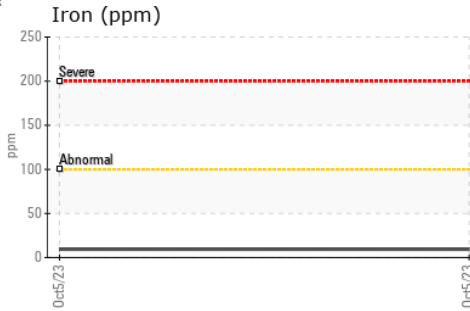

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0020653 **Received** : 12 Oct 2023
Lab Number : 02588504 **Diagnosed** : 13 Oct 2023
Unique Number : 5657570 **Diagnostician** : Kevin Marson
Test Package : MOB 1 (Additional Tests: FuelDilution, PercentFuel)

Wajax Power Systems
 485 VENTURE DR
 MONCTON, NB
 CA E1H 2P4
 Contact: M Cormier
 mcormier@wajax.com
 T: (902)496-5467
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.