




OIL ANALYSIS REPORT



Machine Id
LIDM03BE (S/N GZJ-00163)
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 6500 LFG GAS ENGINE OIL (540 LTR)

Sample Rating Trend

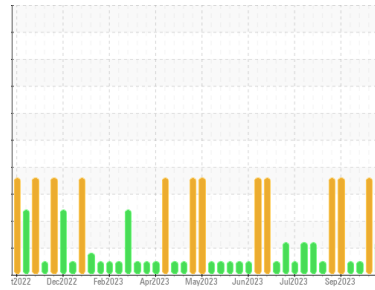

PH



DIAGNOSIS

▲ Recommendation

Nous vous recommandons de vidanger l'huile de ce composant si vous ne l'avez pas déjà fait. Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition.

Wear

Les taux d'usure de tous les composants sont normaux.

Contamination

Il n'y a aucun indice de contamination dans l'huile.

▲ Fluid Condition

Le niveau de i-pH est anormalement bas. Le résultat pour le BN indique que la réserve d'alcalinité est acceptable pour l'huile. Le AN est acceptable pour ce fluide. L'huile ne peut plus être utilisée.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0817904	WC0772230	WC0817919
Sample Date	Client Info		10 Oct 2023	25 Sep 2023	18 Sep 2023
Machine Age	hrs	Client Info	40106	39853	39685
Oil Age	hrs	Client Info	190	469	301
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			ABNORMAL	ABNORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>15	5	4	3
Chromium	ppm	ASTM D5185(m)	>4	0	0	0
Nickel	ppm	ASTM D5185(m)	>2	<1	0	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)	>5	<1	<1	0
Aluminum	ppm	ASTM D5185(m)	>6	2	2	2
Lead	ppm	ASTM D5185(m)	>9	0	<1	<1
Copper	ppm	ASTM D5185(m)	>6	1	1	1
Tin	ppm	ASTM D5185(m)	>4	<1	1	1
Antimony	ppm	ASTM D5185(m)		2	2	2
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)		3	3	4
Barium	ppm	ASTM D5185(m)		<1	<1	0
Molybdenum	ppm	ASTM D5185(m)		3	3	4
Manganese	ppm	ASTM D5185(m)		0	0	<1
Magnesium	ppm	ASTM D5185(m)		8	9	11
Calcium	ppm	ASTM D5185(m)		1793	1877	1790
Phosphorus	ppm	ASTM D5185(m)		244	254	259
Zinc	ppm	ASTM D5185(m)		291	309	296
Sulfur	ppm	ASTM D5185(m)		2722	2892	2765
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS




	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>181	68	93	80
Sodium	ppm	ASTM D5185(m)		<1	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	<1	2	3

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*		0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	5.3	5.6	5.5
Sulfation	Abs./1mm	ASTM D7415*	>30	21.6	24.0	22.6



OIL ANALYSIS REPORT






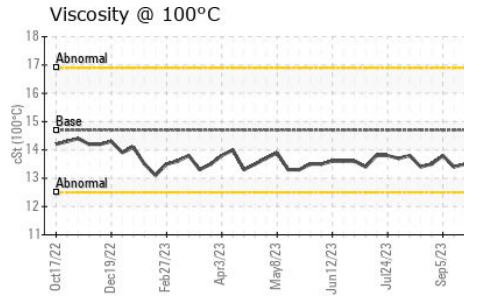
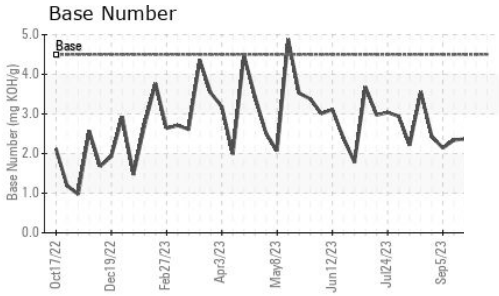
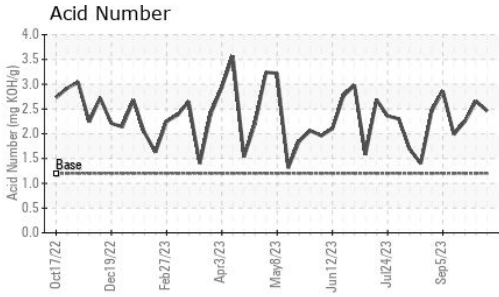


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	ASTM D7414*	>25	11.4	13.7	12.7
Acid Number (AN)	mg KOH/g	ASTM D974*	1.2	2.46	▲ 2.66	2.25
Base Number (BN)	mg KOH/g	ASTM D2896*	4.5	2.53	▲ 1.93	2.37
i-pH	Scale 0-14	ASTM D7946*	<4.5	▲ 4.40	▲ 4.39	4.81

VISUAL	method	limit/base	current	history1	history2	
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D7279(m)	14.7	13.2	13.6	13.5

GRAPHS

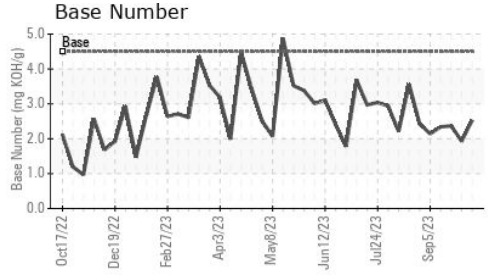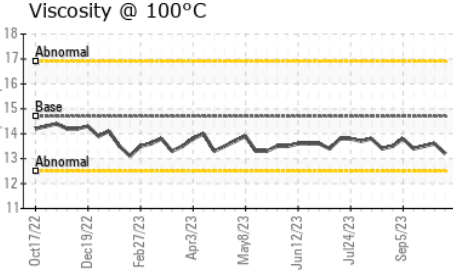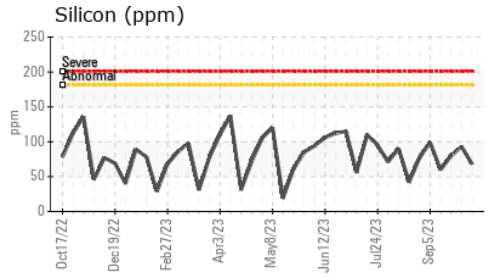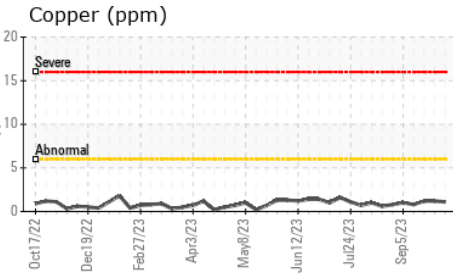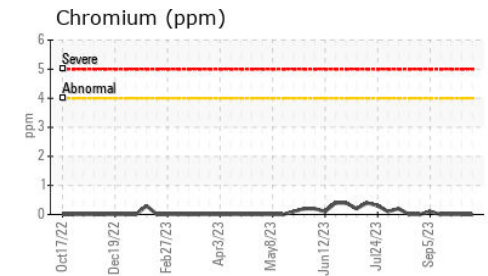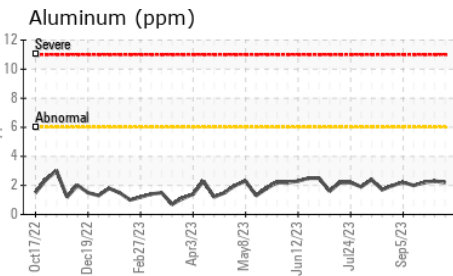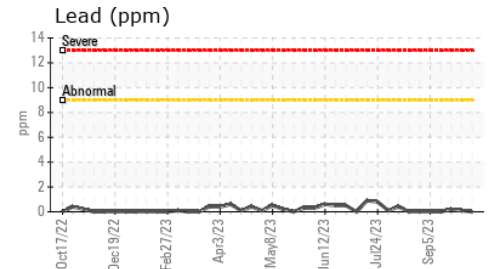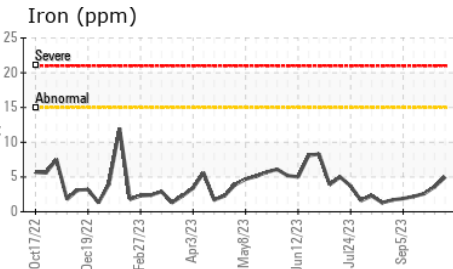

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0817904 **Received** : 12 Oct 2023
Lab Number : **02588606** **Diagnosed** : 17 Oct 2023
Unique Number : 5657672 **Diagnostician** : Kevin Marson
Test Package : MOB 2 (Additional Tests: i-pH, TAN Auto, TAN Man)

EDL NA Recips-Lydia
 6985 CHEMIN DES SOURCES
 LACHUTE, QC
 CA J8H 2C5
 Contact: Eloi Legault
 eloi.legault@energydi.com
 T: (450)526-4001
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.