



# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Machine Id  
**F6579 COMPRESSOR**  
 Component  
**Compressor**  
 Fluid  
**AW HYDRAULIC OIL ISO 32 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PP</b>	---	---
Sample Date	Client Info			<b>24 Sep 2023</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		<b>0</b>	---	---
Iron	ppm	ASTM D5185(m)	>50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185(m)	>5	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185(m)	>15	<b>0</b>	---	---
Lead	ppm	ASTM D5185(m)	>65	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185(m)	>65	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185(m)	>10	<b>0</b>	---	---
Antimony	ppm	ASTM D5185(m)		<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	---	---





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	5	<b>&lt;1</b>	---	---
Barium	ppm	ASTM D5185(m)	5	<b>&lt;1</b>	---	---
Molybdenum	ppm	ASTM D5185(m)	5	<b>0</b>	---	---
Manganese	ppm	ASTM D5185(m)		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m)	25	<b>0</b>	---	---
Calcium	ppm	ASTM D5185(m)	200	<b>34</b>	---	---
Phosphorus	ppm	ASTM D5185(m)	300	<b>335</b>	---	---
Zinc	ppm	ASTM D5185(m)	370	<b>418</b>	---	---
Sulfur	ppm	ASTM D5185(m)	2500	<b>1365</b>	---	---
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>35	<b>0</b>	---	---
Sodium	ppm	ASTM D5185(m)		<b>2</b>	---	---
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	---	---
Water	%	ASTM D6304*	>0.1	<b>0.004</b>	---	---
ppm Water	ppm	ASTM D6304*	>1000	<b>45.0</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.57	<b>0.65</b>	---	---



# OIL ANALYSIS REPORT

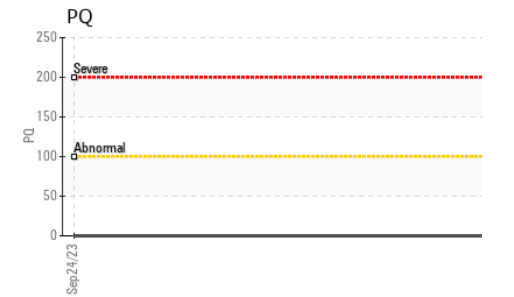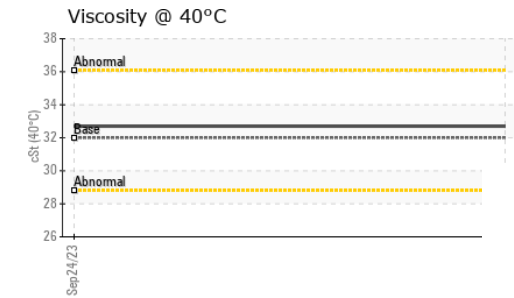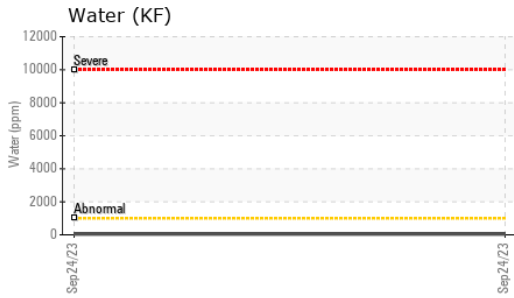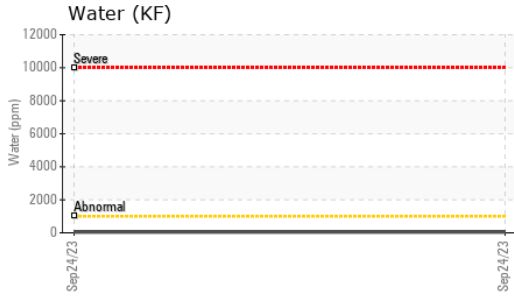

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	VLITE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.1	NEG	---
Free Water	scalar	Visual*		NEG	---





FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	32	32.7	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

Bottom

## GRAPHS

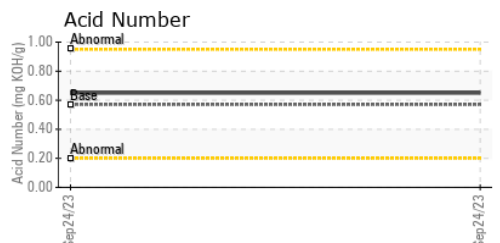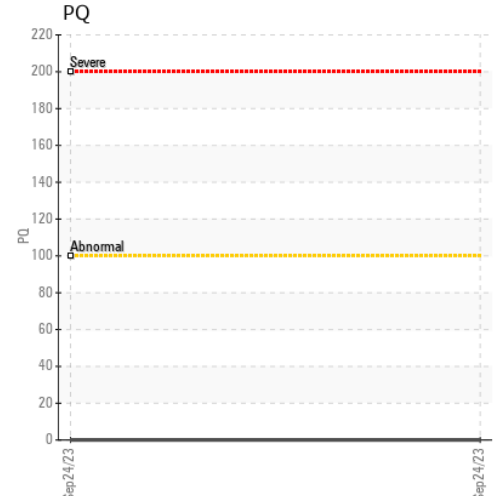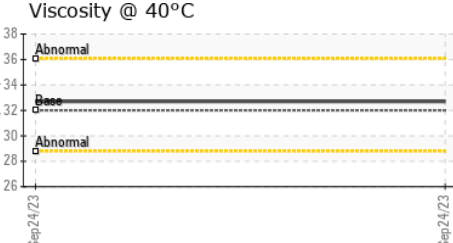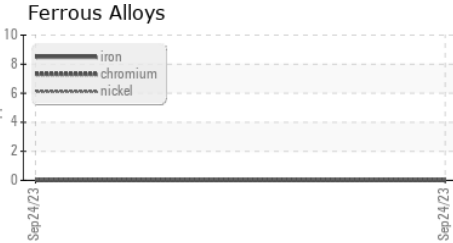

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 HIBERNIA MGMT & DEVELOPMENT CO. LTD  
**Sample No.** : PP **Received** : 16 Oct 2023 SUITE 1000,, 100 NEW GOWER STREET  
**Lab Number** : 02589322 **Diagnosed** : 17 Oct 2023 ST.JOHNS, NL  
**Unique Number** : 5658388 **Diagnostician** : Kevin Marson CA A1C 6K3  
**Test Package** : MAR 2 ( Additional Tests: KF, TAN Man ) Contact: Christopher Michelau

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied. F: (709)722-3766