PROBLEM SUMMARY

Sample Rating Trend

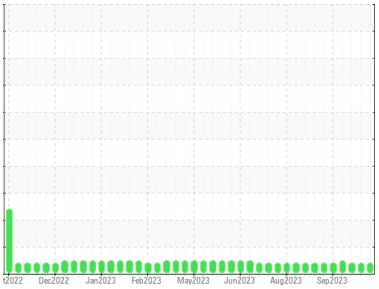

VISCOSITY

Area
5
Machine Id
5-3-230-D Pump Station for Atox Roller Lube
Component
Reservoir Bearing Lube
Fluid
MOBIL SHC 639 (1000 LTR)

COMPONENT CONDITION SUMMARY

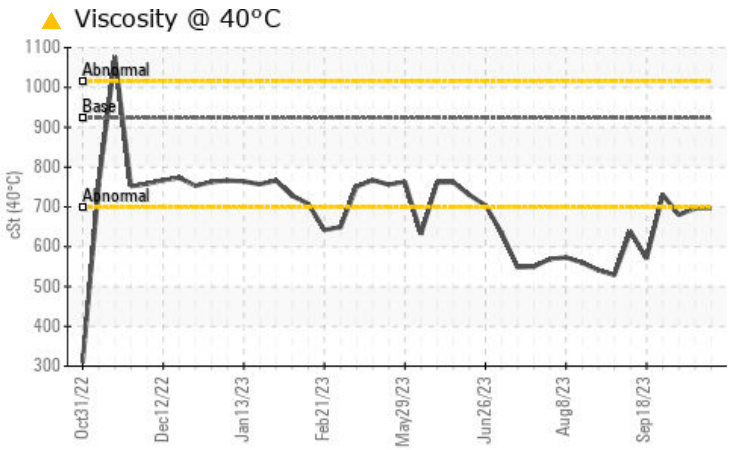

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				**ABNORMAL**	ABNORMAL	ABNORMAL
Visc @ 40°C	cSt	ASTM D7279(m)	923	▲ **697**	▲ 696	▲ 680

Customer Id: STMBOW
Sample No.: WC0851471
Lab Number: 02590135
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

10 Oct 2023 Diag: Kevin Marson

VISCOSITY

Resample at the next service interval to monitor.All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. Viscosity of sample indicates oil is within ISO 680 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

02 Oct 2023 Diag: Kevin Marson

VISCOSITY

Resample at the next service interval to monitor.All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. Viscosity of sample indicates oil is within ISO 680 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

25 Sep 2023 Diag: Wes Davis

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

OIL ANALYSIS REPORT

Sample Rating Trend

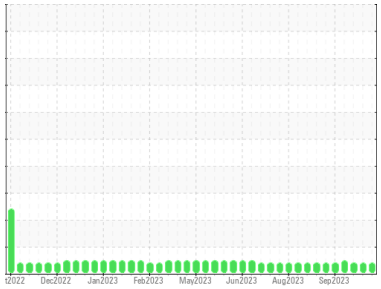

VISCOSITY

Area
5
Machine Id
5-3-230-D Pump Station for Atox Roller Lube
Component
Reservoir Bearing Lube
Fluid
MOBIL SHC 639 (1000 LTR)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition
Viscosity of sample indicates oil is within ISO 680 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0851471**	WC0851473	WC0851472
Sample Date		Client Info		**16 Oct 2023**	10 Oct 2023	02 Oct 2023
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ABNORMAL**	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>120	**<1**	<1	2
Chromium	ppm	ASTM D5185(m)	>5	**0**	0	0
Nickel	ppm	ASTM D5185(m)	>20	**0**	0	<1
Titanium	ppm	ASTM D5185(m)		**0**	0	0
Silver	ppm	ASTM D5185(m)		**<1**	<1	<1
Aluminum	ppm	ASTM D5185(m)	>4	**0**	0	0
Lead	ppm	ASTM D5185(m)	>30	**0**	<1	0
Copper	ppm	ASTM D5185(m)	>17	**<1**	<1	<1
Tin	ppm	ASTM D5185(m)	>10	**0**	0	0
Antimony	ppm	ASTM D5185(m)		**0**	0	0
Vanadium	ppm	ASTM D5185(m)		**0**	0	0
Beryllium	ppm	ASTM D5185(m)		**0**	0	0
Cadmium	ppm	ASTM D5185(m)		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0.2	**<1**	1	2
Barium	ppm	ASTM D5185(m)	0.0	**<1**	0	<1
Molybdenum	ppm	ASTM D5185(m)	0.0	**0**	0	0
Manganese	ppm	ASTM D5185(m)	0.0	**0**	0	0
Magnesium	ppm	ASTM D5185(m)	0.6	**0**	0	0
Calcium	ppm	ASTM D5185(m)	0.0	**<1**	<1	<1
Phosphorus	ppm	ASTM D5185(m)	691	**387**	388	386
Zinc	ppm	ASTM D5185(m)	2.0	**1**	1	<1
Sulfur	ppm	ASTM D5185(m)	18	**340**	255	352
Lithium	ppm	ASTM D5185(m)		**<1**	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	**18**	19	20
Sodium	ppm	ASTM D5185(m)		**<1**	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	**0**	0	0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		**3434**	19365	22104
Particles >6µm		ASTM D7647	>320000	**1099**	2320	2698
Particles >14µm		ASTM D7647	>160000	**102**	53	77
Particles >21µm		ASTM D7647	>40000	**28**	10	22
Particles >38µm		ASTM D7647	>10000	**6**	1	5
Particles >71µm		ASTM D7647	>2500	**5**	0	3
Oil Cleanliness		ISO 4406 (c)	>25/24	**17/14**	18/13	19/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.32	**0.49**	0.46	0.47

OIL ANALYSIS REPORT

Particle Trend

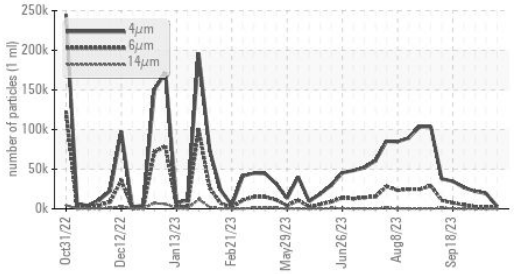

Particle Count

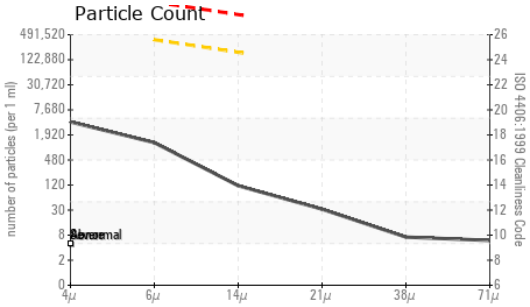

Acid Number

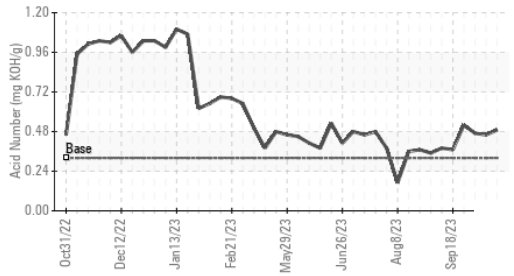

Particle Trend

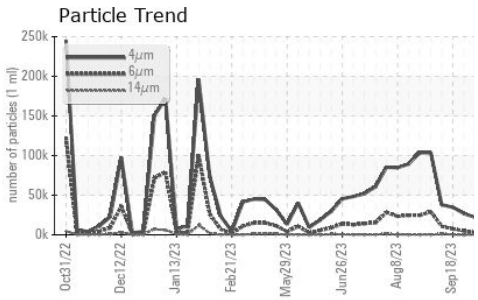

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Precipitate	scalar	Visual*	NONE	**NONE**	NONE	NONE
Silt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Debris	scalar	Visual*	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Appearance	scalar	Visual*	NORML	**NORML**	NORML	NORML
Odor	scalar	Visual*	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	**NEG**	NEG	NEG
Free Water	scalar	Visual*		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	923	▲ **697**	▲ 696	▲ 680

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			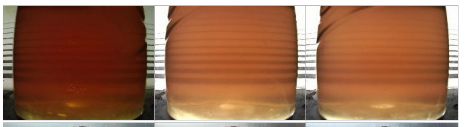		
Bottom					

GRAPHS

Ferrous Alloys

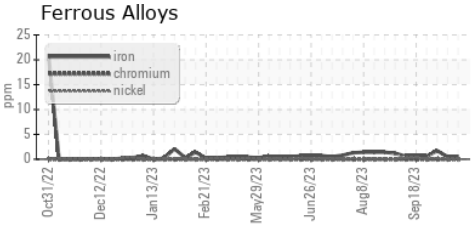

Non-ferrous Metals

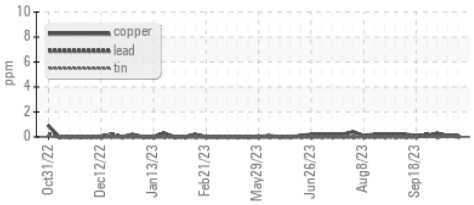

▲ Viscosity @ 40°C

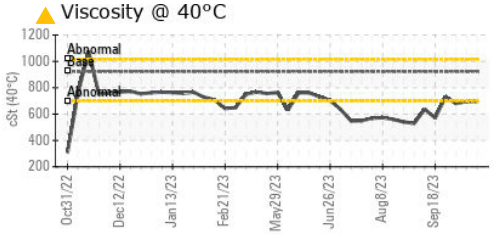

Particle Count

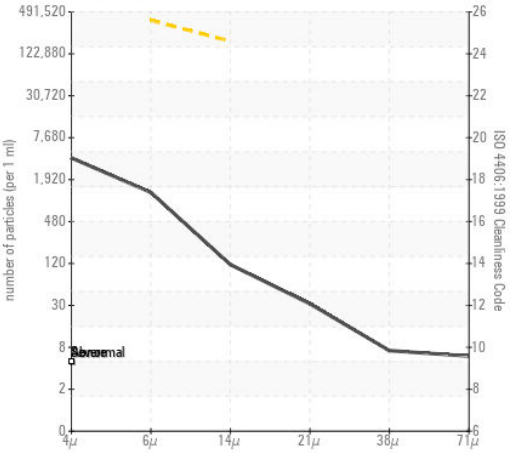

Acid Number

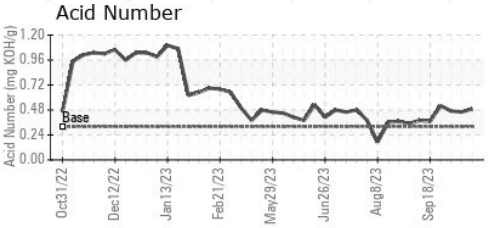

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0851471 **Received** : 18 Oct 2023
Lab Number : 02590135 **Diagnosed** : 19 Oct 2023
Unique Number : 5659201 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

ST. MARYS CEMENT CO.
400 BOWMANVILLE AVENUE
BOWMANVILLE, ON
CA L1C 7B5
Contact: Lou Traiforos
lou.traiforos@vcimentos.com
T: (905)440-5874
F: (905)623-4695