



FUEL REPORT

Sample Rating Trend


NORMAL



Machine Id
1840

Component
Diesel Fuel
Fluid

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

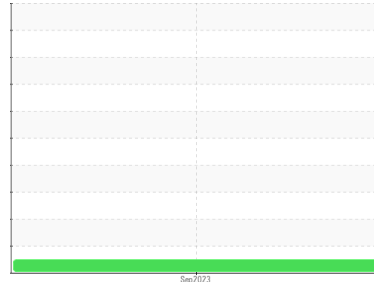

DIAGNOSIS

Recommendation

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. Resample at the next service interval to monitor.

Corrosion

{not applicable}

Contaminants

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. There is no indication of any contamination in the diesel fuel.

Fuel Condition

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B).

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0863024	---	---
Sample Date	Client Info	27 Sep 2023	---	---
Machine Age	hrs Client Info	0	---	---
Sample Status		NORMAL	---	---

PHYSICAL PROPERTIES

method	limit/base	current	history1	history2
Specific Gravity	ASTM D1298*	0.839	0.843	---
Fuel Color	text Visual Screen*	Yellow	Pink	---
Visc @ 40°C	cSt ASTM D7279(m)	3.0	2.7	---
Pensky-Martens Flash Point	°C ASTM D7215*	52	58.5	---

SULFUR CONTENT

method	limit/base	current	history1	history2
Sulfur	ppm ASTM D5185(m)	10	8	---

DISTILLATION

method	limit/base	current	history1	history2
Initial Boiling Point	°C ASTM D2887*	165	170	---
5% Distillation Point	°C ASTM D2887*		197	---
10% Distill Point	°C ASTM D2887*	201	207	---
15% Distillation Point	°C ASTM D2887*		215	---
20% Distill Point	°C ASTM D2887*	216	223	---
30% Distill Point	°C ASTM D2887*	230	237	---
40% Distill Point	°C ASTM D2887*	243	249	---
50% Distill Point	°C ASTM D2887*	255	262	---
60% Distill Point	°C ASTM D2887*	267	275	---
70% Distill Point	°C ASTM D2887*	280	288	---
80% Distill Point	°C ASTM D2887*	295	303	---
85% Distillation Point	°C ASTM D2887*		313	---
90% Distill Point	°C ASTM D2887*	310	323	---
95% Distillation Point	°C ASTM D2887*		339	---
Final Boiling Point	°C ASTM D2887*	341	366	---

IGNITION QUALITY

method	limit/base	current	history1	history2
API Gravity	ASTM D1298*	37.7	36	---
Cetane Index	ASTM D4737*	<40.0	48	---

CONTAMINANTS






method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m)	<1.0	0	---
Sodium	ppm ASTM D5185(m)	<0.1	0	---
Potassium	ppm ASTM D5185(m)	<0.1	<1	---
Water	% ASTM D6304*	<0.05	0.003	---
ppm Water	ppm ASTM D6304*	<500	26.1	---

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	847	---
Particles >6µm	ASTM D7647	>640	186	---
Particles >14µm	ASTM D7647	>80	11	---
Particles >21µm	ASTM D7647	>20	3	---
Particles >38µm	ASTM D7647	>4	0	---
Particles >71µm	ASTM D7647	>3	0	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	17/15/11	---






FUEL REPORT

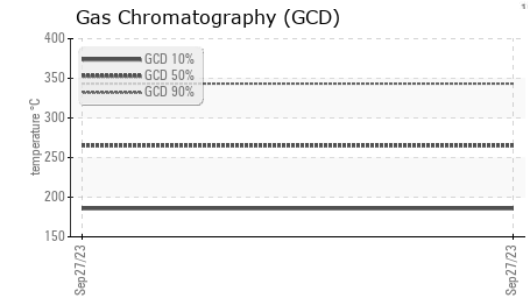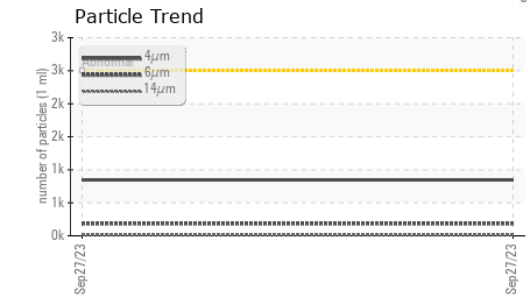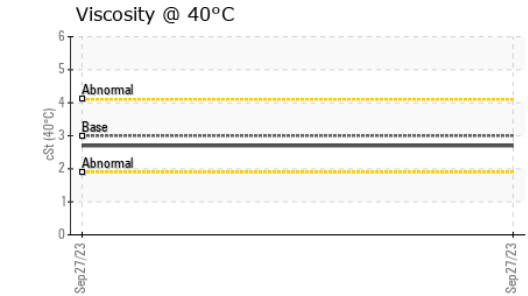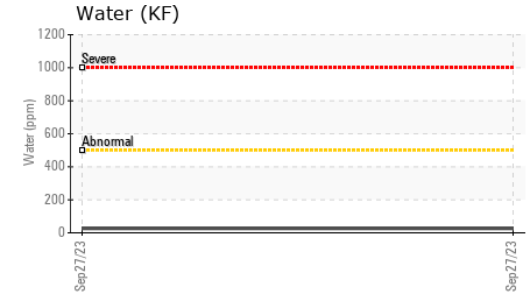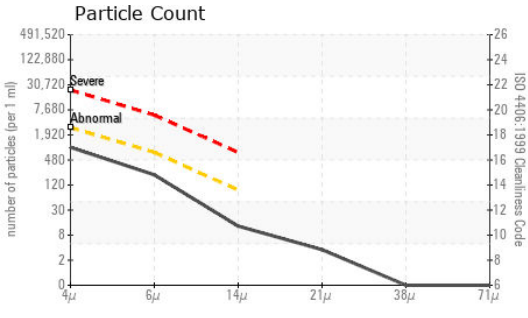

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	0	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	---
Lead	ppm	ASTM D5185(m)	<0.1	0	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	---
Iron	ppm	ASTM D5185(m)	<0.1	<1	---
Calcium	ppm	ASTM D5185(m)	<0.1	0	---
Magnesium	ppm	ASTM D5185(m)	<0.1	0	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	0	---
Zinc	ppm	ASTM D5185(m)	<0.1	0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

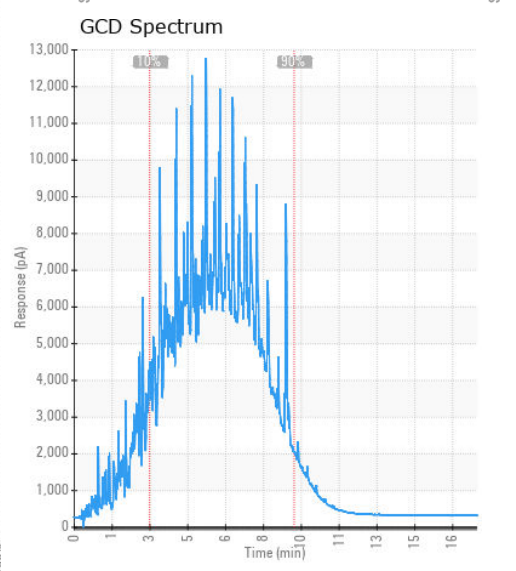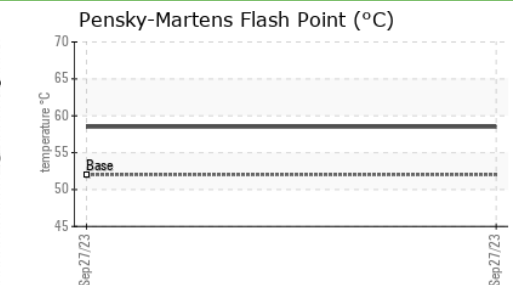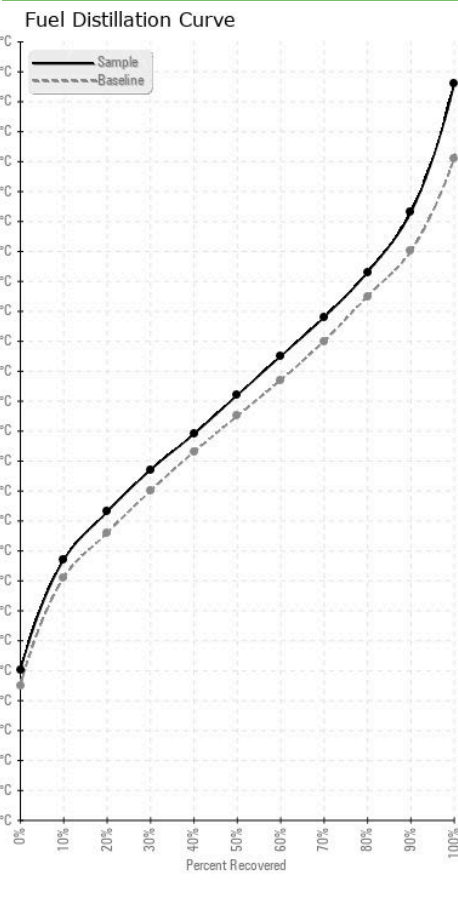

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0863024 **Received** : 18 Oct 2023
Lab Number : 02590155 **Diagnosed** : 23 Oct 2023
Unique Number : 5659221 **Diagnostician** : Kevin Marson
Test Package : FUEL (Additional Tests: CC Flash, GC-PercFuel, PrtCount)

Liftking Manufacturing
 7135 Islington Ave
 Woodbridge, ON
 CA L4L 1V9
 Contact: Guido Cameli
 GCameli@liftking.com
 T: (905)265-3973
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.