

PROBLEM SUMMARY

Sample Rating Trend

pr2009 Mar2010 Jan2011 Oct2011 Oct2013 Sep2015 Oct2017 Sep2019 Oct2013 Sep2015 Oct2017 Sep2019 Oct2013 Sep2015 Oct2017 Sep2019 Oct2013 Sep2015 Oct2017 Sep2019 Oct2017 Sep2019





Saugeen Shores SP-17701 Machine IV ECW #1

Component **Hydraulic System**

MOBIL AERO HF (280 LTR)

COMPONENT CONDITION SUMMARY

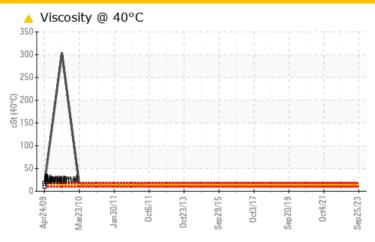

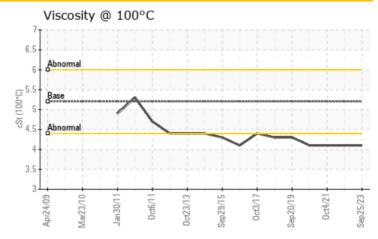

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS											
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL					
Visc @ 40°C	cSt	ASTM D7279(m)	14.0	11.5	<u>▲</u> 11.5	<u>▲</u> 11.6					

Customer Id: VESTAS Sample No.: WC0835229 Lab Number: 02590625 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Bill Quesnel CLS,OMA II,MLA-III,LLA-I +1 (289)291-4641 x4641

Bill.Quesnel@wearcheck.com

To change component or sample information: Gloria Gonzalez +1 (289)291-4643 x4643 gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

27 Sep 2022 Diag: Kevin Marson

VISCOSITY



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. Viscosity of sample indicates oil is within ISO 10 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



04 Oct 2021 Diag: Bill Quesnel

VISCOSITY



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. Viscosity of sample indicates oil is within ISO 10 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



01 Oct 2020 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. Viscosity of sample indicates oil is within ISO 10 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.






OIL ANALYSIS REPORT

Sample Rating Trend

Saugeen Shores SP-17701 **ECW #1**

Hydraulic System

MOBIL AERO HF (280 LTR)





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.


Fluid Condition


Viscosity of sample indicates oil is within ISO 10 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		pr2009 Mar20	10 Jan 2011 Oct2011 Oct20	13 Sep2015 Oct2017 Sep2019 Oc	rt2021 Sep202	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0835229	WC0577979	WC0546457
Sample Date		Client Info		25 Sep 2023	27 Sep 2022	04 Oct 2021
Machine Age	yrs	Client Info		15	14	0
Oil Age	yrs	Client Info		15	14	0
Oil Changed		Client Info		Not Changd	Not Changd	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*	>50	0	0	0
Iron	ppm	ASTM D5185(m)	>10	<1	<1	<1
Chromium	ppm	ASTM D5185(m)	>15	0	0	<1
Nickel	ppm	ASTM D5185(m)	>10	<1	<1	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		<1	0	0
Aluminum	ppm	ASTM D5185(m)	>10	0	0	0
Lead	ppm	ASTM D5185(m)	>20	<1	0	<1
Copper	ppm	ASTM D5185(m)	>15	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>20	0	0	<1
Antimony	ppm	ASTM D5185(m)		0	<1	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1	<1	<1
Barium	ppm	ASTM D5185(m)		<1	0	0
Molybdenum	ppm	ASTM D5185(m)	0.0	0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)	0.4	0	0	0
Calcium	ppm	ASTM D5185(m)	0.0	<1	<1	<1
Phosphorus	ppm	ASTM D5185(m)	426	363	386	379
Zinc	ppm	ASTM D5185(m)	0.9	4	4	3
Sulfur	ppm	ASTM D5185(m)	93	180	189	184
Lithium	ppm	ASTM D5185(m)		<1	<1	<1
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>10	<1	<1	<1
Sodium	ppm	ASTM D5185(m)	>10	2	2	1
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Water	%	ASTM D6304*	>0.03	0.006	0.003	0.004
ppm Water	ppm	ASTM D6304*	>300	61.5	39.3	47.0
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*		0	0	0
Nitration	Abs/cm	ASTM D7624*		3.5	3.8	3.6
Sulfation	Abs/.1mm	ASTM D7415*		49.3	50.0	49.8





OIL ANALYSIS REPORT
















CALA ISO 17025:2017

Accredited

Laboratory Sample No. Lab Number **Unique Number**

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Vestas American Wind Technology Inc. : WC0835229

: 5659691

Received : 02590625 Diagnosed

: 20 Oct 2023

: 23 Oct 2023 Diagnostician : Bill Quesnel Test Package : IND 2 (Additional Tests: FT-IR, KF, KV100, PQ, TAN Man, VI) 1417 NW Everett Street Portland, OR US 97209

Contact: Katie Horner kahor@vestas.com T: (519)368-7500

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

F: (519)368-7535