




# OIL ANALYSIS REPORT

Sample Rating Trend

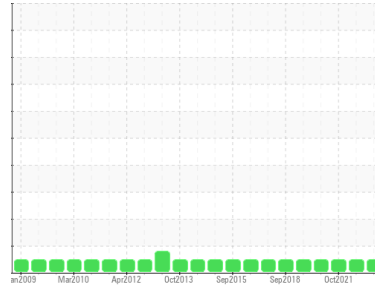

**NORMAL**



Area  
**Saugen Shores SP-17701**  
 Machine Id  
**ECW #5 (S/N 23971)**

Component  
**Wind Turbine Gearbox**  
 Fluid  
**MOBIL MOBILGEAR SHC XMP 320 (260 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0835227</b>	WC0577990	WC
Sample Date	Client Info		<b>27 Sep 2023</b>	29 Sep 2022	05 Oct 2021
Machine Age	yrs	Client Info	<b>15</b>	14	0
Oil Age	yrs	Client Info	<b>15</b>	14	0
Oil Changed	Client Info		<b>Not Changed</b>	Not Changed	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184*	>50	<b>0</b>	0	0	
Iron	ppm	ASTM D5185(m)	>75	<b>17</b>	12	11
Chromium	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>10	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185(m)	>10	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	<1
Aluminum	ppm	ASTM D5185(m)	>10	<b>0</b>	0	0
Lead	ppm	ASTM D5185(m)	>15	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185(m)	>5	<b>5</b>	5	2
Tin	ppm	ASTM D5185(m)	>10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	0	<b>1</b>	<1	1
Barium	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Calcium	ppm	ASTM D5185(m)	0	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185(m)	485	<b>331</b>	359	382
Zinc	ppm	ASTM D5185(m)	0	<b>34</b>	8	5
Sulfur	ppm	ASTM D5185(m)		<b>3644</b>	3721	3833
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

## CONTAMINANTS






	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>40	<b>13</b>	16	19
Sodium	ppm	ASTM D5185(m)	>10	<b>&lt;1</b>	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	<1	<1
Water	%	ASTM D6304*	>0.02	<b>0.007</b>	0.006	0.008
ppm Water	ppm	ASTM D6304*	>200	<b>71.5</b>	67.6	83.4

## INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*		<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*		<b>2.2</b>	2.4	2.2
Sulfation	Abs./1mm	ASTM D7415*		<b>47.3</b>	23.3	47.6



# OIL ANALYSIS REPORT

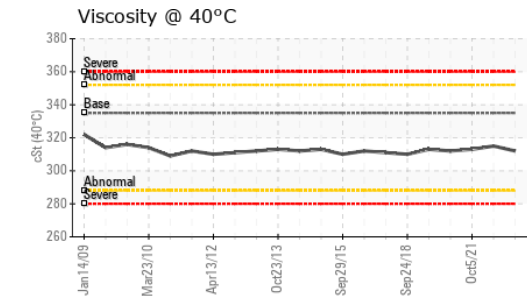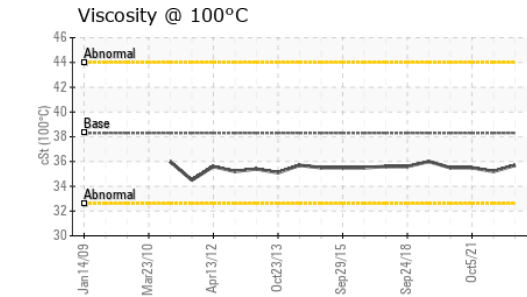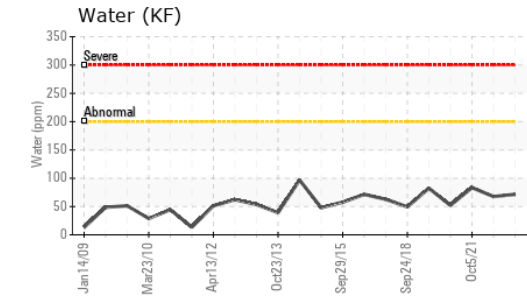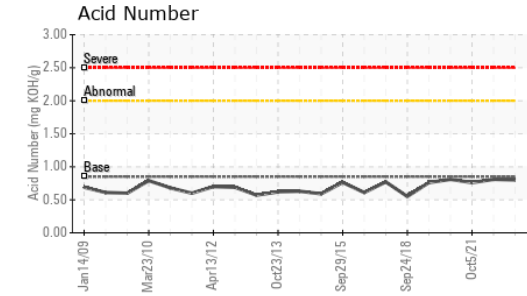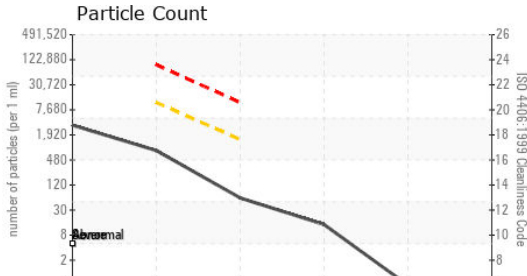

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>2877</b>	1369	845
Particles >6µm	ASTM D7647	>10000	<b>710</b>	360	169
Particles >14µm	ASTM D7647	>1300	<b>52</b>	54	21
Particles >21µm	ASTM D7647	>320	<b>12</b>	19	7
Particles >38µm	ASTM D7647	>80	<b>0</b>	1	0
Particles >71µm	ASTM D7647	>20	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/20/17	<b>19/17/13</b>	18/16/13	17/15/12

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	<b>54.1</b>	18.4	53.5
Acid Number (AN)	mg KOH/g	ASTM D974*	<b>0.80</b>	0.81	0.76

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	<b>NONE</b>	NONE	VLITE
Sand/Dirt	scalar	Visual*	<b>NONE</b>	VLITE	NONE
Appearance	scalar	Visual*	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*	<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	<b>312</b>	315	313
Visc @ 100°C	cSt	ASTM D7279(m)	<b>35.7</b>	35.2	35.5
Viscosity Index (VI)	Scale	ASTM D2270*	<b>161</b>	157	159

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					



**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **Vestas American Wind Technology Inc.**  
**Sample No.** : WC0835227 **Received** : 20 Oct 2023  
**Lab Number** : **02590758** **Diagnosed** : 24 Oct 2023  
**Unique Number** : 5659824 **Diagnostician** : Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: FT-IR, KF, KV100, PQ, TAN Man, VI )

1417 NW Everett Street  
 Portland, OR  
 US 97209  
 Contact: Michael Vandenberg  
 mivan@vestas.com  
 T: (519)386-6327  
 F: (503)327-2001

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.