

PROBLEM SUMMARY

Saugeen Shores SP-17701 09K04

Component Grease

SKF LGWM 1 (--- LTR)



COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

We recommend an early resample to monitor this condition.

PROBLEMATIC 1	EST RE	SULTS				
Sample Status				SEVERE	MARGINAL	ABNORMAL
NLGI Consistency	NLGI Scale	SKF Method*	1	• 000	^ 00	^ 00
PrtFilter						

Customer Id: VESTAS Sample No.: PP0835246 Lab Number: 02590801 Test Package: GRS 1



To manage this report scan the QR code

To discuss the diagnosis or test data: Bill Quesnel CLS, OMA II, MLA-III, LLA-I +1 (289)291-4641 x4641

Bill.Quesnel@wearcheck.com

To change component or sample information: Gloria Gonzalez +1 (289)291-4643 x4643 gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample			?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

27 Jul 2022 Diag: Bill Quesnel

VISCOSITY



No corrective action is recommended at this time. Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the grease. The NLGI grade has decreased from 1 to 00. The condition of the grease is acceptable for the time in service.



29 Jul 2021 Diag: Kevin Marson

VISCOSITY



We recommend an early resample to monitor this condition.All component wear rates are normal. There is no indication of any contamination in the grease. The consistency has dropped by 2 NLGI grades.





GREASE ANALYSIS

Saugeen Shores SP-17701 09K04

Component

Grease

SKF LGWM 1 (--- LTR)

Sample Rating Trend



DIAGNOSIS

Recommendation

We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Grease Condition

Grease consistency has changed by 3 NLGI grades from NLGI 1 to 000.

Contaminants


There is no indication of any contamination in the grease.


		Ju	2021	Jul2022 Jun2	023	
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PP0835246	PP	WC0546361
Sample Date		Client Info		30 Jun 2023	27 Jul 2022	29 Jul 2021
Machine Age	yrs	Client Info		15	0	0
Grease Age	yrs	Client Info		15	0	0
Grease Serviced		Client Info		Not Changd	N/A	N/A
Sample Status				SEVERE	MARGINAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*	>200	120	90	890
Iron	ppm	ASTM D5185(m)	>250	39	54	173
Chromium	ppm	ASTM D5185(m)	>10	<1	<1	1
Nickel	ppm	ASTM D5185(m)	>5	<1	<1	<1
Cadmium	ppm	ASTM D5185(m)		0	0	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Lead	ppm	ASTM D5185(m)	>25	<1	0	0
Copper	ppm	ASTM D5185(m)	>75	2	0	<1
Tin	ppm	ASTM D5185(m)	>5	0	0	0
Silver	ppm	ASTM D5185(m)	>5	<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<1	<1	1
Magnesium	ppm	ASTM D5185(m)	0	<1	0	0
Manganese	ppm	ASTM D5185(m)	0	0	<1	<1
Molybdenum	ppm	ASTM D5185(m)	0	0	0	<1
Phosphorus	ppm	ASTM D5185(m)	5	2	7	5
Zinc	ppm	ASTM D5185(m)	20	6	14	16
Antimony	ppm	ASTM D5185(m)	0	0	0	0
THICKENER/SOA	.P	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	0	0	<1	<1
Barium	ppm	ASTM D5185(m)	0	<1	0	0
Calcium	ppm	ASTM D5185(m)	40	15	34	24
Sodium	ppm	ASTM D5185(m)	2	4	1	2
Lithium	ppm	ASTM D5185(m)	120	80	113	100
Sulfur	ppm	ASTM D5185(m)	650	535	677	624
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>150	<1	<1	<1
Potassium	ppm	ASTM D5185(m)		20	0	<1
GREASE CONDIT	TON	method	limit/base	current	history1	history2
Grease Color		Visual*	Brown	Brown	Brown	Tan
				D.O.	2.0	
Texture		In-house*	2.0	Buttery	Short fiber	Short fibe



GREASE ANALYSIS



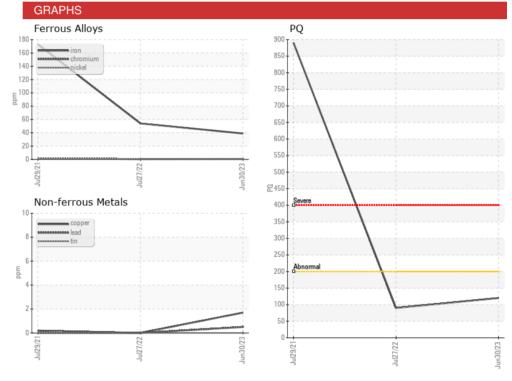





CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No. Lab Number Unique Number : 5659867

: PP0835246 : 02590801

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Vestas American Wind Technology Inc. Received Diagnosed

Diagnostician : Bill Quesnel **Test Package**: GRS 1 (Additional Tests: BottomAnalysis)

: 20 Oct 2023 : 23 Oct 2023

Portland, OR US 97209 Contact: Nicole Philippi NiPhi@vestas.com T: (503)327-7683

1417 NW Everett Street

To discuss this sample report, contact Customer Service at 1-800-268-2131.

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

F: (503)327-0247