




# OIL ANALYSIS REPORT

Sample Rating Trend

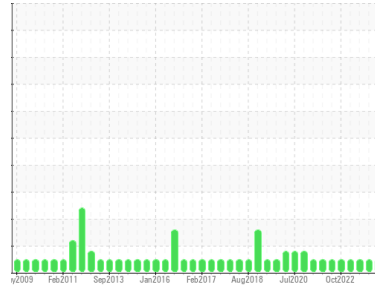

**NORMAL**



Area  
**System 72 - Essential Power Generation**  
 Machine Id  
**Z-7201B Essential Power Diesel Engine Lube Oil**  
 Component  
**Diesel Engine**  
 Fluid  
**IRVING IDO UNIVERSAL SAE 15W40 (830 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.

### Contaminants

The water content is negligible. There is no indication of any contamination in the oil.

### Oil Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PP</b>	PP	WC0774323
Sample Date	Client Info		<b>06 Oct 2023</b>	23 Aug 2023	01 Jun 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	0	0
Iron	ppm	ASTM D5185(m) >100	<b>16</b>	16	16
Chromium	ppm	ASTM D5185(m) >20	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185(m) >4	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m) >3	<b>&lt;1</b>	0	<1
Aluminum	ppm	ASTM D5185(m) >20	<b>1</b>	1	2
Lead	ppm	ASTM D5185(m) >40	<b>8</b>	8	9
Copper	ppm	ASTM D5185(m) >330	<b>175</b>	173	178
Tin	ppm	ASTM D5185(m) >15	<b>1</b>	1	1
Antimony	ppm	ASTM D5185(m)	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<b>21</b>	20	22
Barium	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185(m)	<b>2</b>	2	2
Manganese	ppm	ASTM D5185(m)	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185(m)	<b>8</b>	9	8
Calcium	ppm	ASTM D5185(m)	<b>2248</b>	2207	2284
Phosphorus	ppm	ASTM D5185(m)	<b>908</b>	946	945
Zinc	ppm	ASTM D5185(m) 1300	<b>1052</b>	1057	1075
Sulfur	ppm	ASTM D5185(m)	<b>2824</b>	2831	2866
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	<b>7</b>	8	8
Sodium	ppm	ASTM D5185(m)	<b>3</b>	4	3
Potassium	ppm	ASTM D5185(m) >20	<b>1</b>	3	2
Water	%	ASTM D6304* >0.2	<b>0.050</b>	0.052	0.040
ppm Water	ppm	ASTM D6304* >2000	<b>506.7</b>	525.2	403.7

## INFRA-RED


	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844* >3	<b>0.2</b>	0.1	0.2
Nitration	Abs/cm	ASTM D7624* >20	<b>10.3</b>	9.4	10.3
Sulfation	Abs./1mm	ASTM D7415* >30	<b>22.4</b>	21.1	22.5




# OIL ANALYSIS REPORT

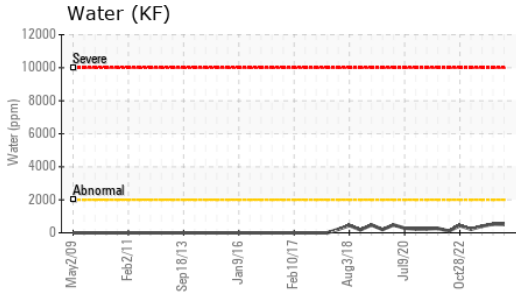

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>20.4</b>	18.5	20.7
Base Number (BN)	mg KOH/g	ASTM D2896*	11.3	<b>5.14</b>	5.68	5.41






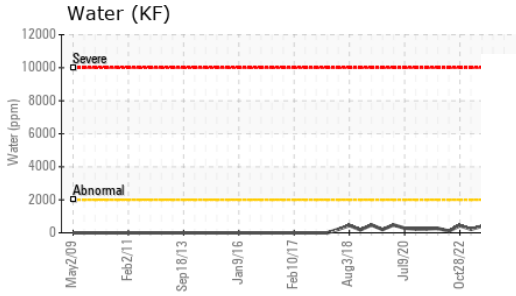


VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

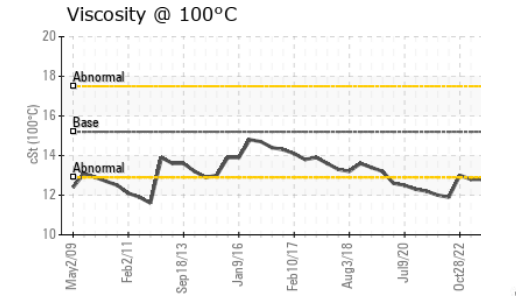

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	15.2	<b>12.5</b>	12.6	12.8

### GRAPHS

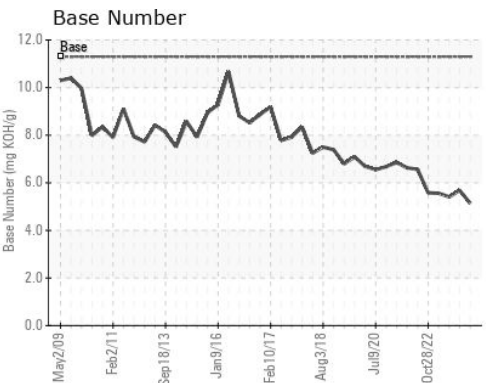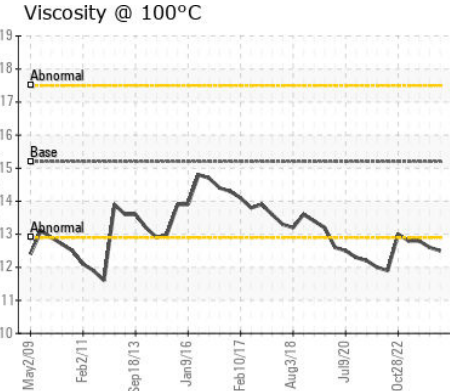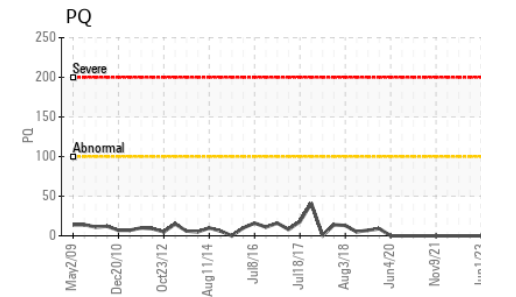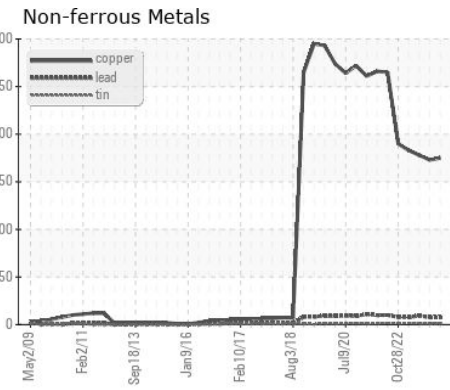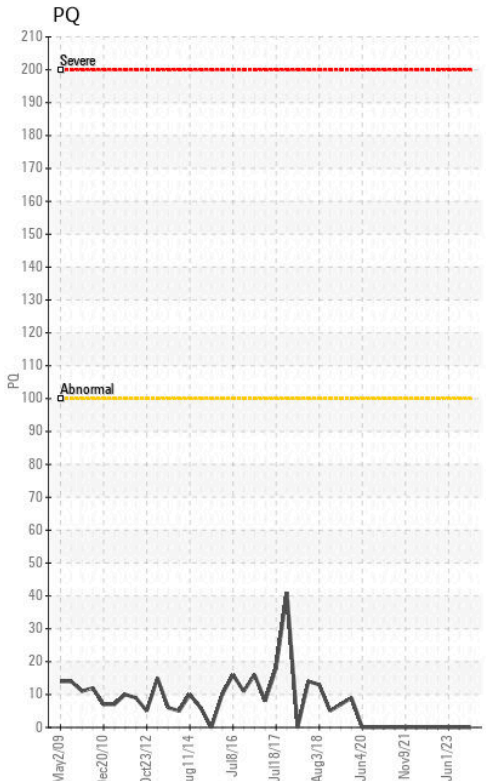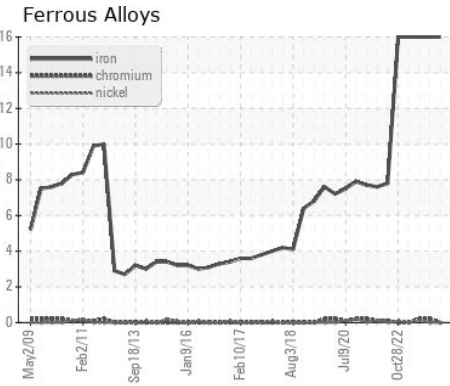

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **HIBERNIA MGMT & DEVELOPMENT CO. LTD**  
**Sample No.** : PP **Received** : 23 Oct 2023 **SUITE 1000,, 100 NEW GOWER STREET**  
**Lab Number** : **02590886** **Diagnosed** : 27 Oct 2023 **ST.JOHNS, NL**  
**Unique Number** : 5667965 **Diagnostician** : Kevin Marson **CA A1C 6K3**  
**Test Package** : MAR 3 ( Additional Tests: KF ) **Contact: Christopher Michelau**  
**christopher.j.michelau@exxonmobil.com**




To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

T:  
 F: (709)722-3766



# FERROGRAPHY REPORT

Area  
**System 72 - Essential Power Generation**  
 Machine Id  
**Z-7201B Essential Power Diesel Engine Lube Oil**  
 Component  
**Diesel Engine**  
 Fluid  
**IRVING IDO UNIVERSAL SAE 15W40 (830 LTR)**

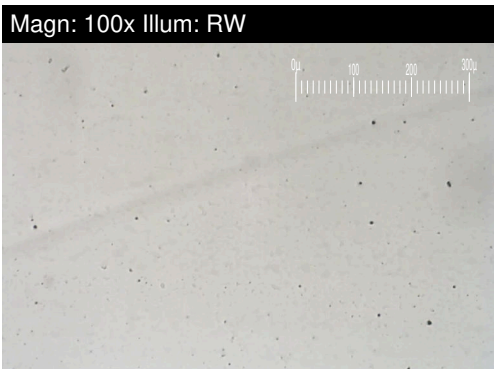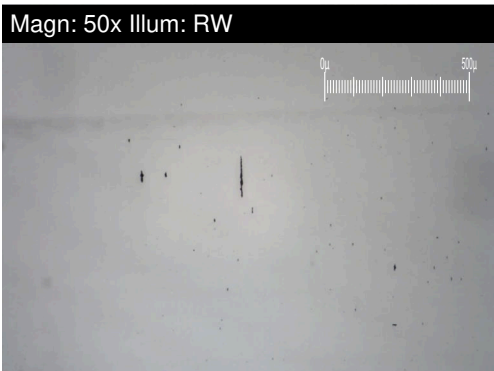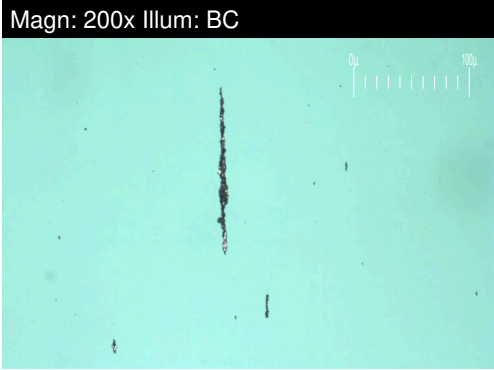


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		<b>2.1</b>	2.4	3.8
Small Particles		DR-Ferr*		<b>2.0</b>	1.5	3.0
Total Particles		DR-Ferr*	>---	<b>4.1</b>	3.9	6.8
Large Particles Percentage	%	DR-Ferr*		<b>2.4</b>	23.1	11.8
Severity Index		DR-Ferr*		<b>0</b>	2	3

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		<b>2</b>	2	2
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		<b>1</b>	1	1
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*		<b>1</b>	1	
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		<b>1</b>	1	1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		<b>1</b>	1	1

### WEAR

All component wear rates are normal.  
 The ferrography results are normal indicating no abnormal wear in the system.

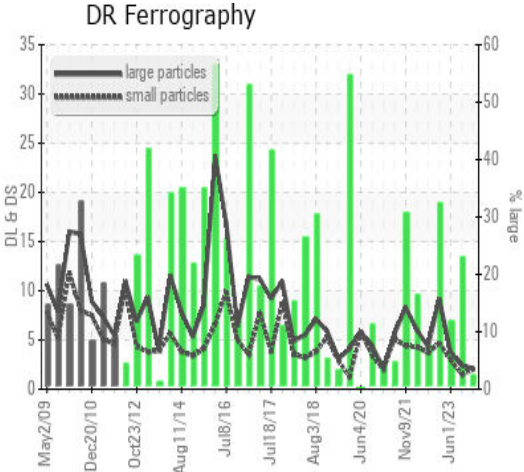

*This page left intentionally blank*