




# PROBLEM SUMMARY


Area  
**Curing Department**  
 Machine Id  
**PHC12**  
 Component  
**Hydraulic System**  
 Fluid  
**ISO 68 (200 GAL)**

Sample Rating Trend

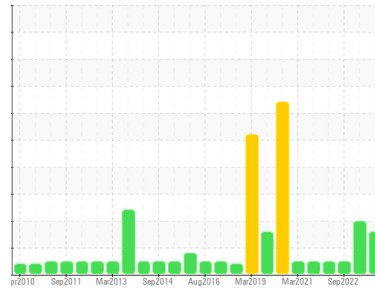

## COMPONENT CONDITION SUMMARY

▲ Silicon (ppm)

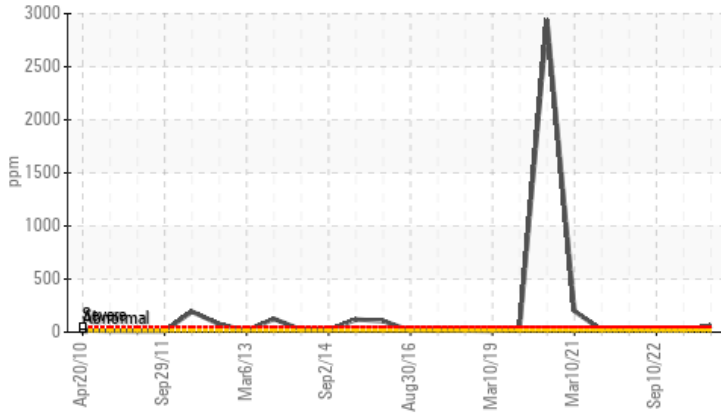

## RECOMMENDATION

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample.

## PROBLEMATIC TEST RESULTS

Sample Status				<b>ABNORMAL</b>	ATTENTION	NORMAL
Silicon	ppm	ASTM D5185(m)	>15	<b>▲ 58</b>	15	17

Customer Id: GOONAP  
 Sample No.: WC0851365  
 Lab Number: 02591015  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Kevin Marson +1 (289)291-4644 x4644  
[Kevin.Marson@wearcheck.com](mailto:Kevin.Marson@wearcheck.com)

To change component or sample information:  
 Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	We recommend an early resample to monitor this condition.
Information Required	---	---	?	Please specify the brand, type, and viscosity of the oil on your next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.

## HISTORICAL DIAGNOSIS

### 10 Mar 2023 Diag: Kevin Marson

#### WEAR



We recommend you service the filters on this component. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using IND 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. Aluminum ppm levels are noted. All other component wear rates are normal. There is a light amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 10 Sep 2022 Diag: Wes Davis

#### NORMAL



Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 10 Mar 2022 Diag: Wes Davis

#### NORMAL



Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

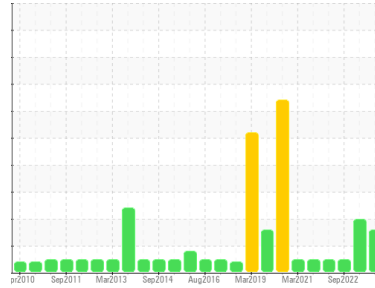

**DIRT**



Area  
**Curing Department**  
 Machine Id  
**PHC12**  
 Component  
**Hydraulic System**  
 Fluid  
**ISO 68 (200 GAL)**

## DIAGNOSIS

### Recommendation

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear

All component wear rates are normal.

### Contamination

Elemental level of silicon (Si) above normal indicating ingress of seal material and/or dirt.

### Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0851365</b>	WC0794164	WC0736528
Sample Date	Client Info		<b>10 Sep 2023</b>	10 Mar 2023	10 Sep 2022
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ATTENTION	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	---	---
Iron	ppm	ASTM D5185(m) >20	<b>35</b>	37	34
Chromium	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185(m) >20	<b>2</b>	2	2
Titanium	ppm	ASTM D5185(m)	<b>0</b>	<1	<1
Silver	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185(m) >20	<b>6</b>	▲ 7	2
Lead	ppm	ASTM D5185(m) >20	<b>15</b>	18	17
Copper	ppm	ASTM D5185(m) >20	<b>111</b>	124	117
Tin	ppm	ASTM D5185(m) >20	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185(m)	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	<1	<1
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	<1	<1

## ADDITIVES






	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Barium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Molybdenum	ppm	ASTM D5185(m)	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185(m)	<b>44</b>	40	41
Calcium	ppm	ASTM D5185(m)	<b>72</b>	78	73
Phosphorus	ppm	ASTM D5185(m)	<b>706</b>	788	727
Zinc	ppm	ASTM D5185(m)	<b>606</b>	592	563
Sulfur	ppm	ASTM D5185(m)	<b>2188</b>	2376	2232
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	▲ <b>58</b>	15	17
Sodium	ppm	ASTM D5185(m)	<b>3</b>	3	3
Potassium	ppm	ASTM D5185(m) >20	<b>0</b>	0	0

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>3369</b>	▲ 9647	3945
Particles >6µm	ASTM D7647	>1300	<b>538</b>	▲ 1364	1108
Particles >14µm	ASTM D7647	>160	<b>14</b>	47	108
Particles >21µm	ASTM D7647	>40	<b>3</b>	10	21
Particles >38µm	ASTM D7647	>10	<b>1</b>	1	1
Particles >71µm	ASTM D7647	>3	<b>0</b>	1	1
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>19/16/11</b>	▲ 20/18/13	19/17/14

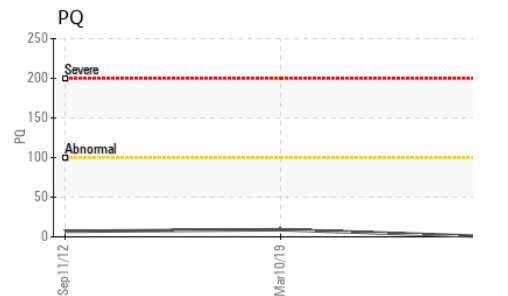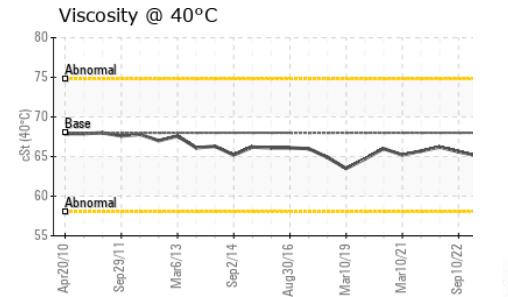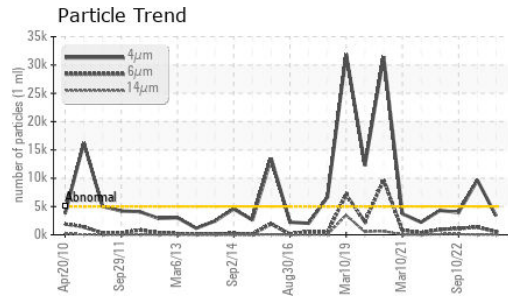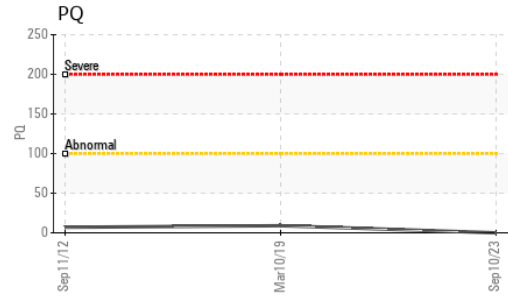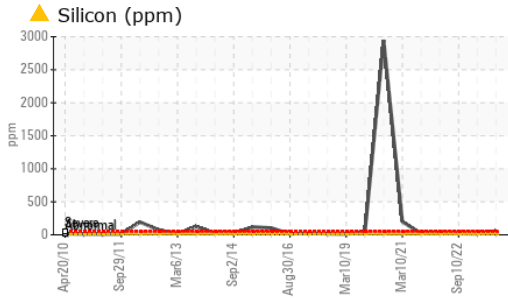


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	<b>1.03</b>	0.91	0.93






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	NEG	NEG
Free Water	scalar	Visual*	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	<b>65.0</b>	65.1	65.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

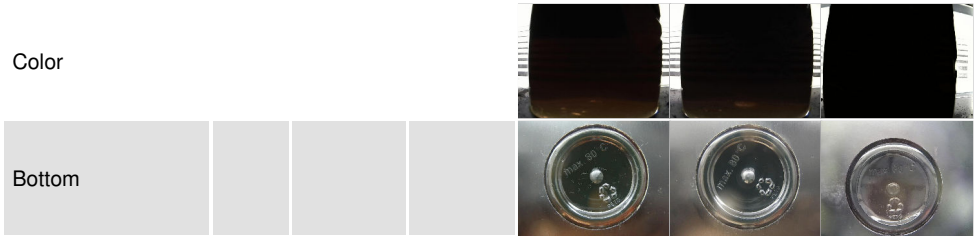

## GRAPHS

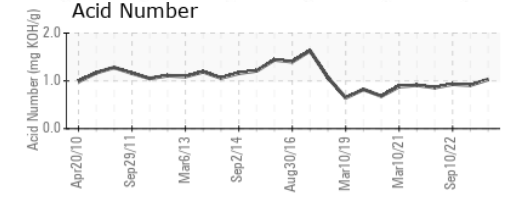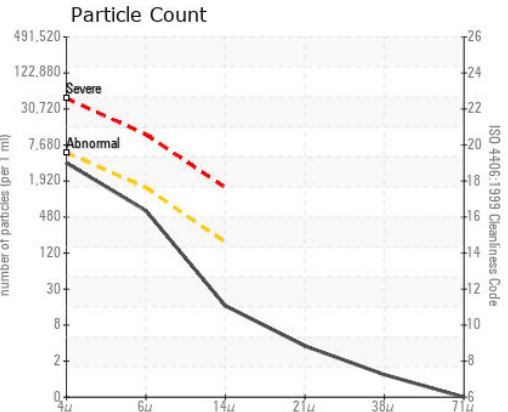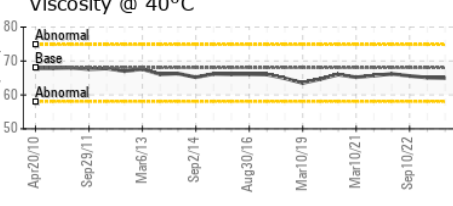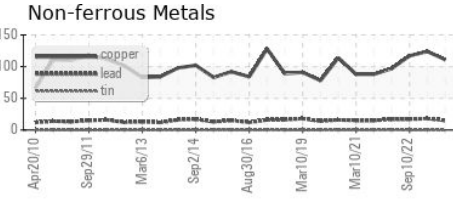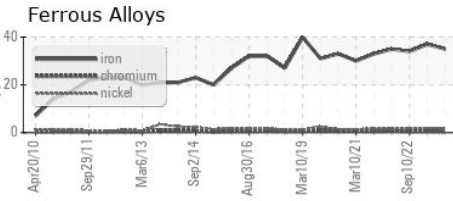

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0851365 **Received** : 23 Oct 2023  
**Lab Number** : 02591015 **Diagnosed** : 24 Oct 2023  
**Unique Number** : 5668094 **Diagnostician** : Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: PQ, TAN Man )

**Goodyear Napanee**  
 388 GOODYEAR ROAD  
 NAPANEE, ON  
 CA K7R 3L2  
 Contact: Mohammad Waleed  
 Mohammad\_Waleed@goodyear.com  
 T: (613)354-7709  
 F: (613)354-9377

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.