



# PROBLEM SUMMARY

Sample Rating Trend


DEGRADATION

Area  
**MPG GENERATOR [02591388]**  
Machine Id  
**71-T-3580C (71-G-3300C)**

Component  
**Turbine**  
Fluid  
**MOBIL DTE 846 (--- LTR)**



## COMPONENT CONDITION SUMMARY

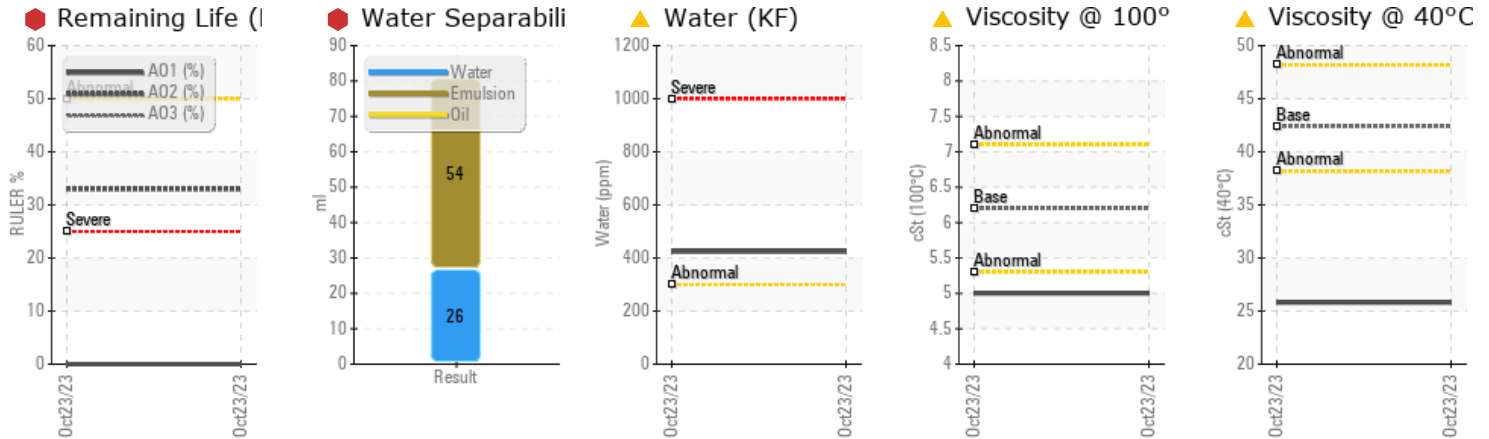

## RECOMMENDATION

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We advise that you check for the source of water entry. Check seals and/or filters for points of contaminant entry. We recommend that you sweeten the oil by draining off half the system oil (50%) and replacing with new oil. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you use off-line filtration with water adsorbent filters to attempt to remove the water from this oil. We recommend you service the filters on this component. We recommend an early resample to monitor this condition. The fluid was specified as MOBIL DTE 846, however, a fluid match indicates that this fluid is Phosphate Ester (PE) Turbine Oil. Please confirm the oil type and grade on your next sample. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

## PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	---	---
Water	%	ASTM D6304*	>0.03	▲ 0.042	---	---
ppm Water	ppm	ASTM D6304*	>300	▲ 424.2	---	---
Particles >6µm		ASTM D7647	>640	▲ 1061	---	---
Particles >14µm		ASTM D7647	>80	▲ 143	---	---
Particles >21µm		ASTM D7647	>20	▲ 34	---	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	▲ 18/17/14	---	---
Anti-Oxidant 1	%	ASTM D6971*	<25	● 0	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	42.4	▲ 25.8	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	6.2	▲ 5	---	---
Separability	oil/h2o/em	ASTM D1401*	40/40/0	● 0/26/54 (30)	---	---
Rust Prevention	PASS/FAIL	ASTM D665*	PASS	▲ FAIL	---	---

Customer Id: MAKMOU  
Sample No.: WC0814814  
Lab Number: 02591452  
Test Package: AOM 3



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Bill Quesnel CLS,OMA II,MLA-III,LLA-I +1  
(289)291-4641 x4641  
[Bill.Quesnel@wearcheck.com](mailto:Bill.Quesnel@wearcheck.com)

To change component or sample information:  
Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Alert	---	---	?	The fluid was specified as MOBIL DTE 846, however, a fluid match indicates that this fluid is Phosphate Ester (PE) Turbine Oil. Please confirm the oil type and grade on your next sample.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Water Access	---	---	?	We advise that you check for the source of water entry.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.
Filter Fluid	---	---	?	We advise that you use off-line filtration with water adsorbent filters to attempt to remove the water from this oil.
Partial Drain	---	---	?	We recommend that you sweeten the oil by draining off half the system oil (50%) and replacing with new oil.

## HISTORICAL DIAGNOSIS




# OIL ANALYSIS REPORT

Sample Rating Trend

DEGRADATION

Area  
**MPG GENERATOR [02591388]**  
 Machine Id  
**71-T-3580C (71-G-3300C)**  
 Component  
**Turbine**  
 Fluid  
**MOBIL DTE 846 (--- LTR)**

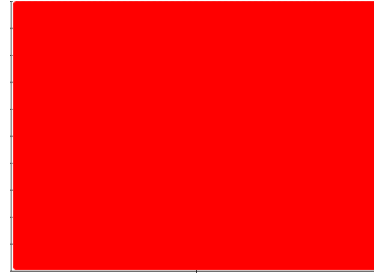

## DIAGNOSIS

### Recommendation

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We advise that you check for the source of water entry. Check seals and/or filters for points of contaminant entry. We recommend that you sweeten the oil by draining off half the system oil (50%) and replacing with new oil. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you use off-line filtration with water adsorbent filters to attempt to remove the water from this oil. We recommend you service the filters on this component. We recommend an early resample to monitor this condition. The fluid was specified as MOBIL DTE 846, however, a fluid match indicates that this fluid is Phosphate Ester (PE) Turbine Oil. Please confirm the oil type and grade on your next sample. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.

### Contaminants

There is a light amount of silt (particulates < 14 microns in size) present in the oil. Water Separability results (ASTM D1401) are poor and indicate that the oil will form emulsions with water. There is a moderate concentration of water present in the oil.

### Oil Condition

Linear Sweep Voltammetry (RULER- ASTM D6971) testing indicates one of the anti-oxidants present in the oil will soon be depleted. Rust Prevention test (ASTM D665) indicates poor anti-corrosion properties of the oil and a potential for corrosion in the system. Viscosity of sample indicates oil is within ISO 22 range, advise investigate. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0814814</b>	---	---
Sample Date	Client Info		<b>23 Oct 2023</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>SEVERE</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	---	---
Iron	ppm	ASTM D5185(m) >15	<b>0</b>	---	---
Chromium	ppm	ASTM D5185(m) >4	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m) >2	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185(m) >10	<b>0</b>	---	---
Lead	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185(m) >5	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185(m) >5	<b>0</b>	---	---
Antimony	ppm	ASTM D5185(m)	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Barium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m)	<b>0</b>	---	---
Manganese	ppm	ASTM D5185(m)	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Calcium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185(m)	<b>3068</b>	---	---
Zinc	ppm	ASTM D5185(m)	<b>1</b>	---	---
Sulfur	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<b>3</b>	---	---
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	---	---
Water	%	ASTM D6304* >0.03	<b>▲ 0.042</b>	---	---
ppm Water	ppm	ASTM D6304* >300	<b>▲ 424.2</b>	---	---


## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	<b>0.2</b>	---	---
Nitration	Abs/cm	ASTM D7624*	<b>8.9</b>	---	---
Sulfation	Abs/.1mm	ASTM D7415*	<b>176.1</b>	---	---




# OIL ANALYSIS REPORT


## Remaining Life (RULER)

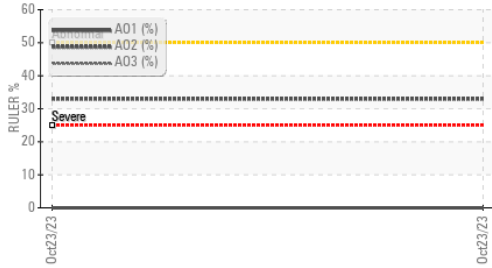

## Water Separability

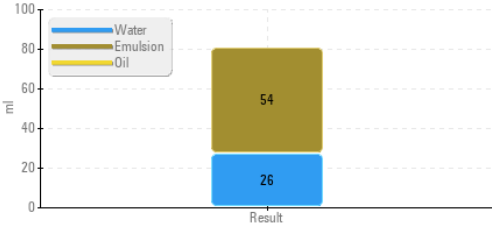


## Water (KF)

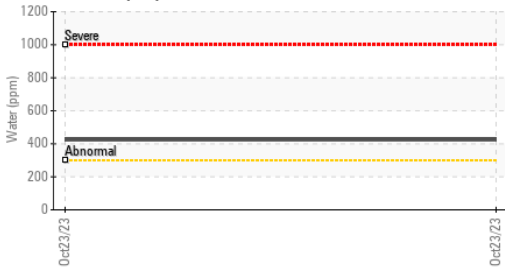

## Viscosity @ 100°C



## Viscosity @ 40°C

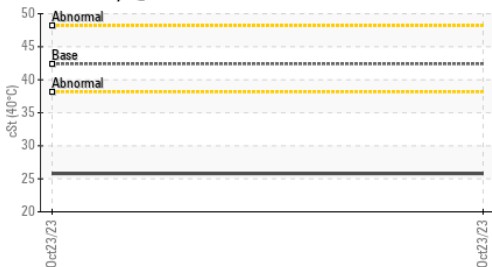

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	<b>2204</b>	---	---
Particles >6µm	ASTM D7647	>640	<b>1061</b>	---	---
Particles >14µm	ASTM D7647	>80	<b>143</b>	---	---
Particles >21µm	ASTM D7647	>20	<b>34</b>	---	---
Particles >38µm	ASTM D7647	>4	<b>5</b>	---	---
Particles >71µm	ASTM D7647	>3	<b>3</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	<b>18/17/14</b>	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm ASTM D7414*		<b>238.6</b>	---	---
Acid Number (AN)	mg KOH/g ASTM D974*		<b>0.11</b>	---	---
Anti-Oxidant 1	% ASTM D6971*	<25	<b>0</b>	---	---
Anti-Oxidant 2	% ASTM D6971*	<25	<b>33</b>	---	---
MPC Varnish Potential	Scale ASTM D7843(m)*	>15	<b>8</b>	---	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar Visual*	NONE	<b>NONE</b>	---	---
Precipitate	scalar Visual*	NONE	<b>NONE</b>	---	---
Silt	scalar Visual*	NONE	<b>NONE</b>	---	---
Debris	scalar Visual*	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar Visual*	NONE	<b>NONE</b>	---	---
Appearance	scalar Visual*	NORML	<b>NORML</b>	---	---
Odor	scalar Visual*	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar Visual*	>0.03	<b>NEG</b>	---	---
Free Water	scalar Visual*		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	42.4	<b>25.8</b>	---	---
Visc @ 100°C	cSt ASTM D7279(m)	6.2	<b>5</b>	---	---
Viscosity Index (VI)	Scale ASTM D2270*	106	<b>121</b>	---	---
Separability	oil/h2o/em ASTM D1401*	40/40/0	<b>0/26/54 (30)</b>	---	---
Air Release Time	min ASTM D3427*	2	<b>2.50</b>	---	---
Foam Tendency	I/II/III ASTM D892*	20	<b>10/0/10</b>	---	---
Foam Stability	I/II/III ASTM D892*	0	<b>0/0/0</b>	---	---
ASTM Color	scalar ASTM D1500*		<b>5.0</b>	---	---
Rust Prevention	PASS/FAIL ASTM D665*	PASS	<b>FAIL</b>	---	---
Oxidation Test (RPVOT)	minutes ASTM D2272*	1100	<b>506</b>	---	---

SEDIMENT	method	limit/base	current	history1	history2
Pentane Insolubles	% ASTM D893(m)*		<b>0.024</b>	---	---
Toluene Insolubles	% ASTM D893(m)*		<b>0.026</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image
MPC				no image	no image



ISO 17025:2017  
Accredited  
Laboratory

Laboratory  
Sample No.  
Lab Number  
Unique Number  
Test Package

To discuss this sample report, cc  
Test denoted (\*) outside scope o




Validity of results and interpretation are based on the sample and information as supplied.

F: (709)364-3501



# FERROGRAPHY REPORT

Area  
**MPG GENERATOR [02591388]**  
 Machine Id  
**71-T-3580C (71-G-3300C)**  
 Component  
**Turbine**  
 Fluid  
**MOBIL DTE 846 (--- LTR)**

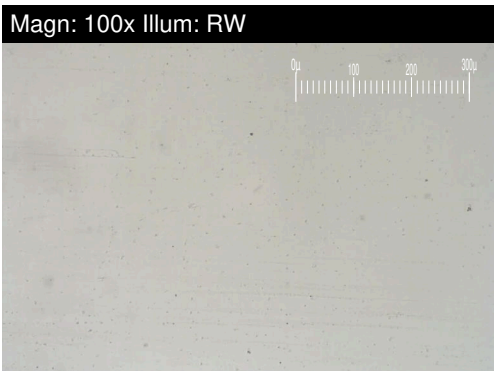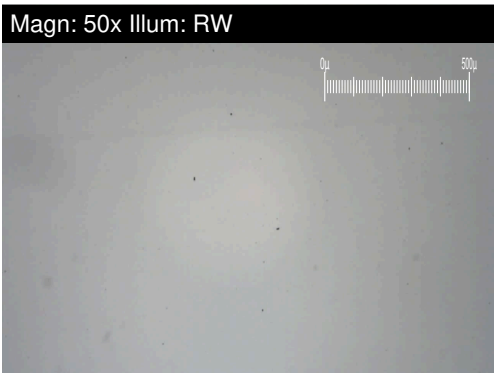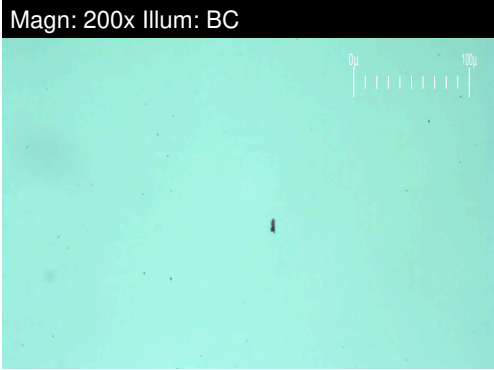

DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		<b>0.7</b>	---	---
Small Particles		DR-Ferr*		<b>0.5</b>	---	---
Total Particles		DR-Ferr*	>---	<b>1.2</b>	---	---
Large Particles Percentage	%	DR-Ferr*		<b>16.7</b>	---	---
Severity Index		DR-Ferr*		<b>0</b>	---	---

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		<b>1</b>		
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*				
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*				
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		<b>1</b>		
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*				

### WEAR

All component wear rates are normal.  
 The ferrography results are normal indicating no abnormal wear in the system.

