




PROBLEM SUMMARY

Sample Rating Trend

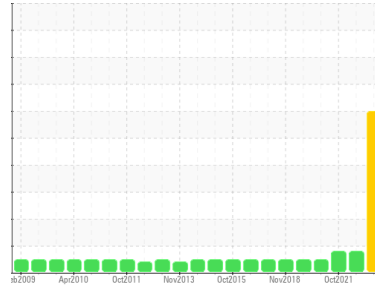

WEAR




Area
Saugen Shores SP-17701
 Machine ID
05K02 (S/N 24014)

Component
Wind Turbine Gearbox
 Fluid
MOBIL MOBILGEAR SHC XMP 320 (260 LTR)

COMPONENT CONDITION SUMMARY

Non-ferrous Metals

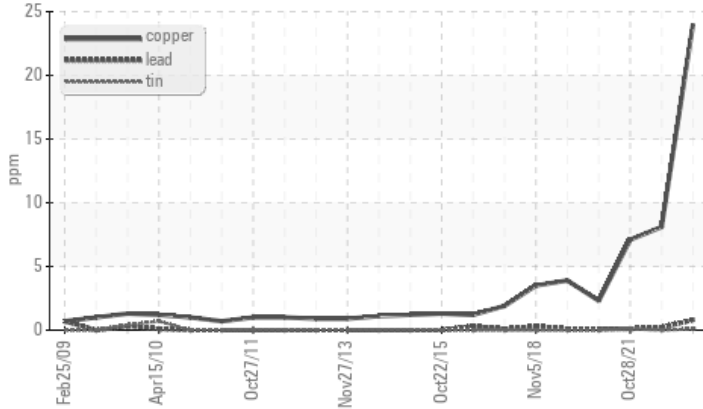

RECOMMENDATION

Resample at the next service interval to monitor. Re-sampling is suggested to confirm test results prior to significant maintenance activities being performed. Please indicate that this is a resample on your Sample Information Form (SIF).

PROBLEMATIC TEST RESULTS

Sample Status		SEVERE	ABNORMAL	ABNORMAL
Copper	ppm ASTM D5185(m) >5	24	8	7

Customer Id: VESTAS
 Sample No.: WC0835304
 Lab Number: 02591542
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Bill Quesnel CLS, OMA II, MLA-III, LLA-I +1
 (289)291-4641 x4641
Bill.Quesnel@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	Re-sampling is suggested to confirm test results prior to significant maintenance activities being performed. Please indicate that this is a resample on your Sample Information Form (SIF).

HISTORICAL DIAGNOSIS

01 Oct 2022 Diag: Kevin Marson

WEAR



We recommend an early resample to monitor this condition. Copper ppm levels are abnormal. Bearing and/or bushing wear is indicated. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



28 Oct 2021 Diag: Bill Quesnel

WEAR



We recommend an early resample to monitor this condition. Copper ppm levels are abnormal. Bearing and/or bushing wear is indicated. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



29 Oct 2020 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

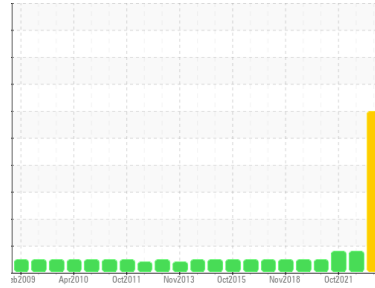

WEAR



Area
Saugen Shores SP-17701
 Machine ID
05K02 (S/N 24014)

Component
Wind Turbine Gearbox
 Fluid
MOBIL MOBILGEAR SHC XMP 320 (260 LTR)

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor. Re-sampling is suggested to confirm test results prior to significant maintenance activities being performed. Please indicate that this is a resample on your Sample Information Form (SIF).

Wear
 Copper ppm levels are severe. Bearing and/or bushing wear is indicated.

Contamination
 The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0835304	WC0632942	WC0546392
Sample Date	Client Info		20 Oct 2023	01 Oct 2022	28 Oct 2021
Machine Age	yrs	Client Info	15	14	0
Oil Age	yrs	Client Info	15	14	0
Oil Changed	Client Info		Not Chngd	Not Chngd	N/A
Sample Status			SEVERE	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184*	>50	0	0	0	
Iron	ppm	ASTM D5185(m)	>75	18	15	14
Chromium	ppm	ASTM D5185(m)	>5	0	0	0
Nickel	ppm	ASTM D5185(m)	>10	0	<1	<1
Titanium	ppm	ASTM D5185(m)	>10	0	<1	0
Silver	ppm	ASTM D5185(m)		<1	0	0
Aluminum	ppm	ASTM D5185(m)	>10	0	<1	<1
Lead	ppm	ASTM D5185(m)	>15	<1	<1	<1
Copper	ppm	ASTM D5185(m)	>5	24	8	7
Tin	ppm	ASTM D5185(m)	>10	<1	0	<1
Antimony	ppm	ASTM D5185(m)	>5	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	0	1	<1	1
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		0	0	0
Calcium	ppm	ASTM D5185(m)	0	<1	0	0
Phosphorus	ppm	ASTM D5185(m)	485	324	359	349
Zinc	ppm	ASTM D5185(m)	0	30	15	15
Sulfur	ppm	ASTM D5185(m)		3681	3742	3544
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS


	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>40	8	12	14
Sodium	ppm	ASTM D5185(m)	>10	<1	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Water	%	ASTM D6304*	>0.02	0.009	0.008	0.006
ppm Water	ppm	ASTM D6304*	>200	92.9	83.5	68.0

INFRA-RED


	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*		0	0	0
Nitration	Abs/cm	ASTM D7624*		2.2	2.4	2.2
Sulfation	Abs/1mm	ASTM D7415*		47.5	26.4	47.8

OIL ANALYSIS REPORT


Non-ferrous Metals

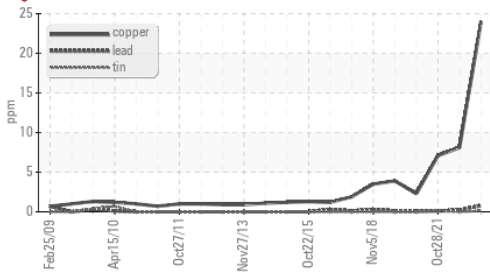


Particle Count

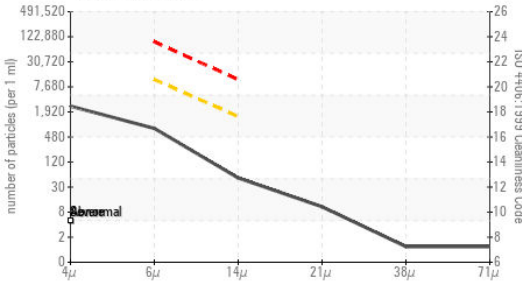


Acid Number

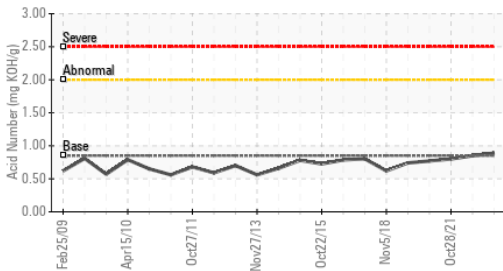

Water (KF)

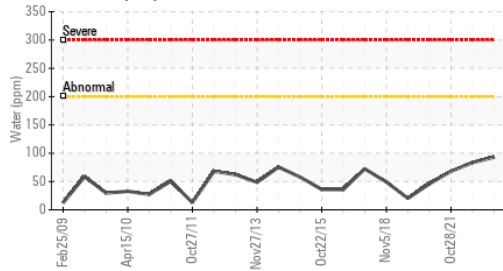

Viscosity @ 100°C

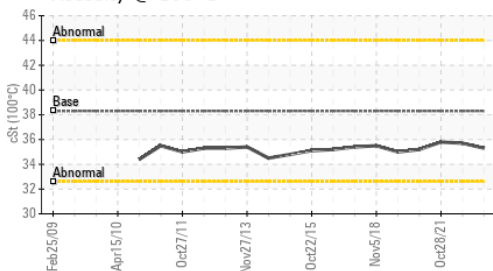


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		2310	4655	1995
Particles >6µm	ASTM D7647	>10000	677	1073	373
Particles >14µm	ASTM D7647	>1300	44	81	33
Particles >21µm	ASTM D7647	>320	9	28	11
Particles >38µm	ASTM D7647	>80	1	2	1
Particles >71µm	ASTM D7647	>20	1	0	0
Oil Cleanliness	ISO 4406 (c)	>--/20/17	18/17/13	19/17/14	18/16/12

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm ASTM D7414*		54.8	22.1	53.0
Acid Number (AN)	mg KOH/g ASTM D974*	0.85	0.89	0.85	0.80

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE	NONE
Debris	scalar Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	NONE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*	>0.02	NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	335	311	313	314
Visc @ 100°C	cSt ASTM D7279(m)	38.3	35.3	35.7	35.8
Viscosity Index (VI)	Scale ASTM D2270*	164	159	160	160

SAMPLE IMAGES

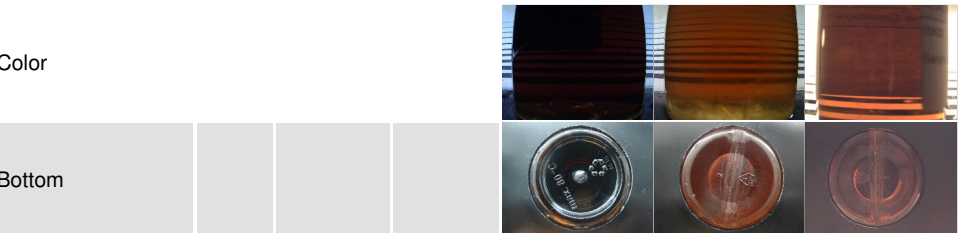

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Vestas American Wind Technology Inc.
Sample No. : WC0835304
Lab Number : **02591542**
Unique Number : 5668621
Test Package : IND 2 (Additional Tests: FT-IR, KF, KV100, PQ, TAN Man, VI)

Received : 24 Oct 2023
Diagnosed : 26 Oct 2023
Diagnostician : Bill Quesnel

1417 NW Everett Street
 Portland, OR
 US 97209
 Contact: Nicole Philippi
 NiPhi@vestas.com
 T: (503)327-7683
 F: (503)327-0247

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.