


# COOLANT REPORT

Sample Rating Trend

**NORMAL**

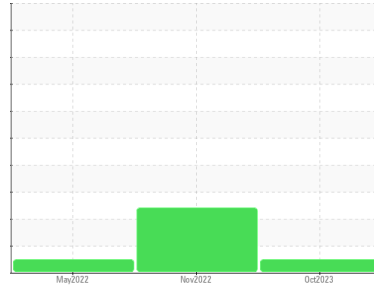

Area  
**ESTRUCTURE [208377]**  
Machine Id  
**GD13198**  
Component  
**Coolant**  
Fluid  
**CONVENTIONAL COOLANT (--- GAL)**

**DIAGNOSIS**

**Recommendation**

Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition. Le fluide n'était pas spécifié, toutefois, une comparaison avec d'autres fluides indiqua que ce fluide est du (GENERIC) CONVENTIONAL COOLANT. Veuillez confirmer.

**Corrosion**

Les taux d'usure de tous les composants sont normaux.

**Contaminants**

Il n'y a aucun indice de contamination dans l'agent de refroidissement.

**Coolant Condition**

L'état de l'agent de refroidissement est acceptable pour la durée de service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WA0020484</b>	GD0005823	GD0005383
Sample Date	Client Info			<b>19 Oct 2023</b>	08 Nov 2022	18 May 2022
Machine Age	yrs	Client Info		<b>0</b>	0	0
Oil Age	yrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	Not Changd
Sample Status				<b>NORMAL</b>	ABNORMAL	NORMAL

PHYSICAL TEST RESULTS		method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*		<b>1.065</b>	1.065	1.065
pH	Scale 0-14	ASTM D1287*	9.5	<b>8.23</b>	8.82	8.05
Nitrites	ppm	Alcan Test Kit*	1500	<b>1600</b>	1600	1520
Reserve Alkalinity	Scale 0-20	ASTM D1121*	8.5	<b>4.1</b>	4.4	3.7
Percentage Glycol	%	ASTM D3321*	50	<b>48.6</b>	48.7	48.6
Freezing Point	°C	ASTM D3321*	-40	<b>-31</b>	-31	-31
Carboxylate				<b>---</b>	---	---


CORROSION INHIBITORS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)		<b>82</b>	12	101
Phosphorus	ppm	ASTM D5185(m)		<b>58</b>	17	91
Boron	ppm	ASTM D5185(m)		<b>399</b>	518	395
Molybdenum	ppm	ASTM D5185(m)		<b>130</b>	4	167

CORROSION		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>15	<b>0</b>	9	2
Aluminum	ppm	ASTM D5185(m)	>10	<b>&lt;1</b>	<1	3
Copper	ppm	ASTM D5185(m)	>10	<b>0</b>	3	<1
Lead	ppm	ASTM D5185(m)	>10	<b>0</b>	▲ 57	1
Tin	ppm	ASTM D5185(m)	>10	<b>0</b>	▲ 7	<1
Silver	ppm	ASTM D5185(m)	>10	<b>&lt;1</b>	0	<1
Zinc	ppm	ASTM D5185(m)		<b>2</b>	2	2








CARRIER SALTS		method	limit/base	current	history1	history2
Sodium	ppm	ASTM D5185(m)		<b>7573</b>	3400	2330
Potassium	ppm	ASTM D5185(m)		<b>1242</b>	66	934

SCALE POTENTIAL		method	limit/base	current	history1	history2
Calcium	ppm	ASTM D5185(m)	>100	<b>6</b>	6	5
Magnesium	ppm	ASTM D5185(m)	>40	<b>2</b>	1	1
Hardness	mg/L CaCO3	In-house*	<75	<b>24</b>	20	18

VISUAL		method	limit/base	current	history1	history2
Coolant Color	Visual*	Green		<b>Pink</b>	Pink	Orange
Coolant Appearance	Visual*	Clear		<b>Clear</b>	▲ Very cld	Clear

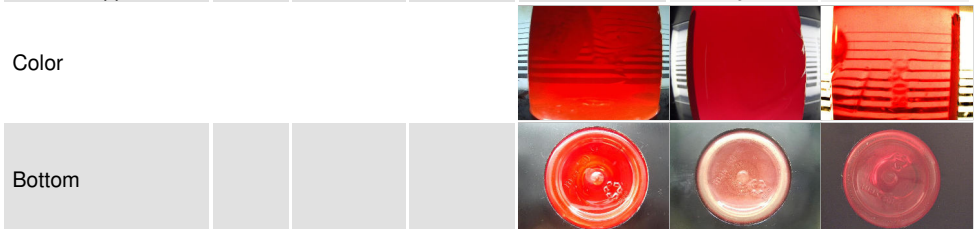

# COOLANT REPORT

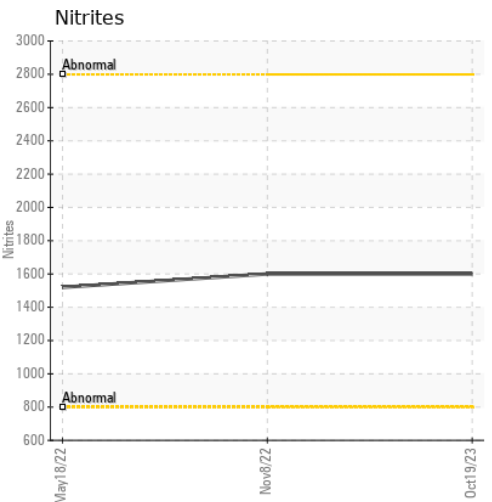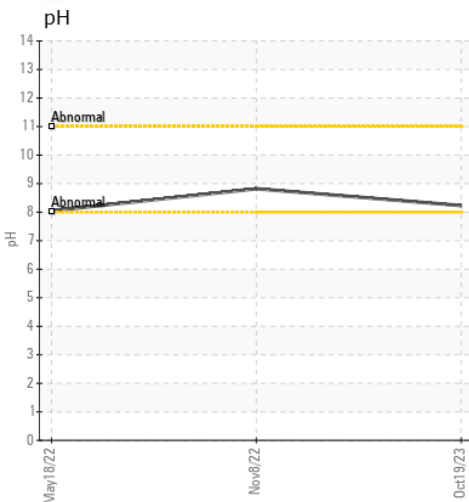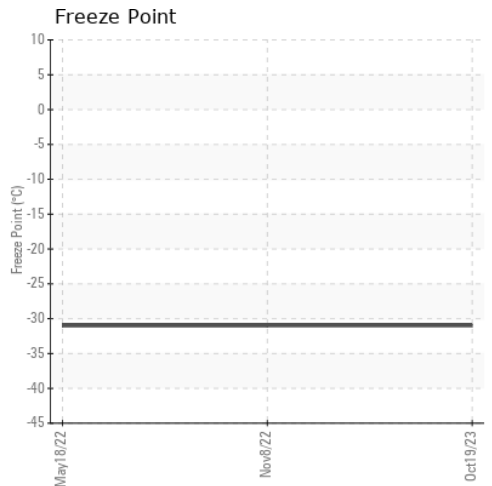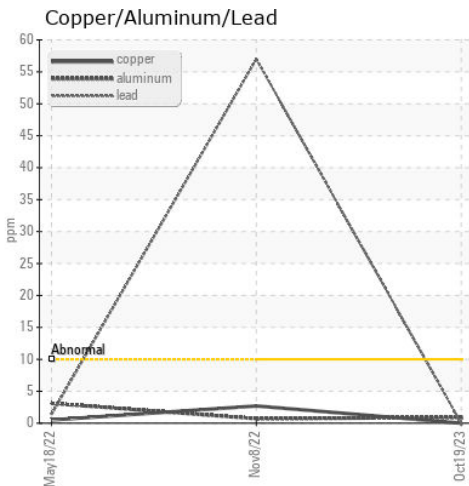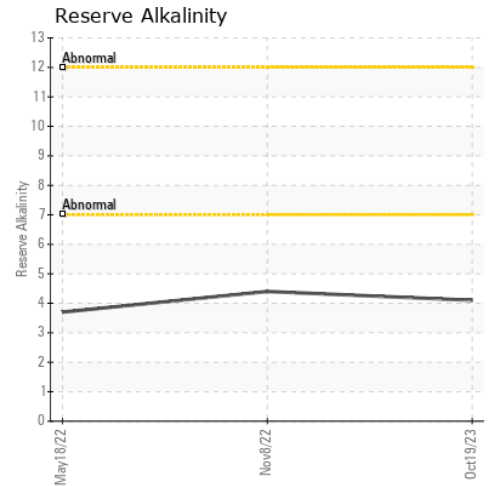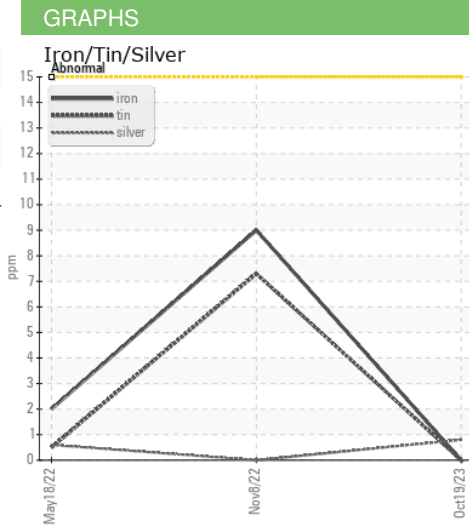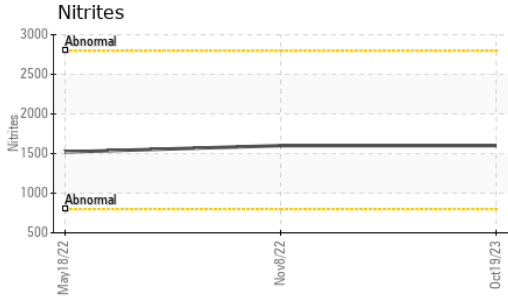

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WA0020484  
**Lab Number** : 02591555  
**Unique Number** : 5668634  
**Test Package** : COOL

**Received** : 24 Oct 2023  
**Diagnosed** : 24 Oct 2023  
**Diagnostician** : Wes Davis

**Generatrice Drummond**  
 243 rue des ARTISANS  
 SAINT-GERMAIN-DE-GRANTHAM, QC  
 CA J0C 1K0  
 Contact: Valerie Poirier  
 poiirivalerie@generatricedrummond.com  
 T: (819)398-6811  
 F: (819)398-7022

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.