

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area
PLAN NORD [213749]
Machine Id
MTU 933918C0245378
Component
Diesel Engine
Fluid
DIESEL ENGINE OIL SAE 30 (--- GAL)

DIAGNOSIS

Recommendation

Aucune mesure corrective n'est recommandée pour l'instant. Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition. Le fluide n'était pas spécifié, toutefois, une comparaison avec d'autres fluides indiqua que ce fluide est du (GENERIC) DIESEL ENGINE OIL SAE 30. Veuillez confirmer.

Wear

Les taux de métaux sont typiques pour la période de rodage d'un nouveau composant.

Contamination

Légère dilution de carburant dans l'huile. Aucun autre contaminant n'a été détecté dans l'huile.

Fluid Condition

Le résultat pour le BN indique que la réserve d'alcalinité est acceptable pour l'huile. L'état de l'huile permet d'en prolonger l'utilisation.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WA0020780	---	---
Sample Date	Client Info			03 Oct 2023	---	---
Machine Age	hrs	Client Info		624	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				NORMAL	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Glycol	WC Method			NEG	---	---


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>100	22	---	---
Chromium	ppm	ASTM D5185(m)	>20	<1	---	---
Nickel	ppm	ASTM D5185(m)	>4	0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	<1	---	---
Aluminum	ppm	ASTM D5185(m)	>20	11	---	---
Lead	ppm	ASTM D5185(m)	>40	<1	---	---
Copper	ppm	ASTM D5185(m)	>330	8	---	---
Tin	ppm	ASTM D5185(m)	>15	<1	---	---
Antimony	ppm	ASTM D5185(m)		0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
Beryllium	ppm	ASTM D5185(m)		0	---	---
Cadmium	ppm	ASTM D5185(m)		0	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	250	107	---	---
Barium	ppm	ASTM D5185(m)	10	<1	---	---
Molybdenum	ppm	ASTM D5185(m)	100	83	---	---
Manganese	ppm	ASTM D5185(m)		4	---	---
Magnesium	ppm	ASTM D5185(m)	450	395	---	---
Calcium	ppm	ASTM D5185(m)	3000	1747	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	847	---	---
Zinc	ppm	ASTM D5185(m)	1350	978	---	---
Sulfur	ppm	ASTM D5185(m)	4250	2705	---	---
Lithium	ppm	ASTM D5185(m)		<1	---	---


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	7	---	---
Sodium	ppm	ASTM D5185(m)	>75	8	---	---
Potassium	ppm	ASTM D5185(m)	>20	1	---	---
Fuel	%	ASTM D7593*	>5	1.3	---	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	0.1	---	---
Nitration	Abs/cm	ASTM D7624*	>20	9.0	---	---
Sulfation	Abs.1mm	ASTM D7415*	>30	23.7	---	---


OIL ANALYSIS REPORT

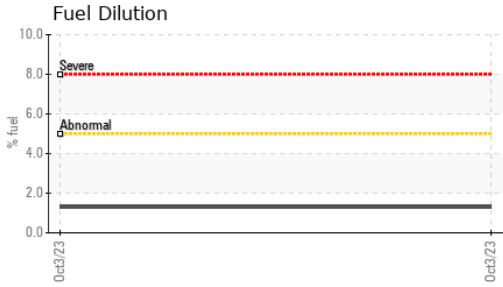

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	23.3	---	---
Base Number (BN)	mg KOH/g	ASTM D2896*	8.5	8.38	---	---








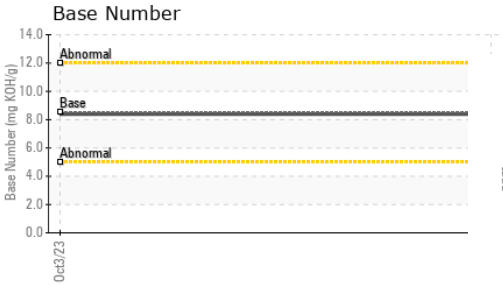


VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

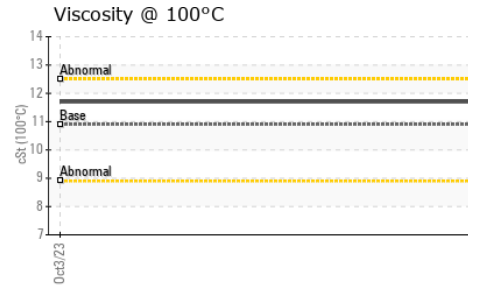

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	10.9	11.7	---	---

GRAPHS

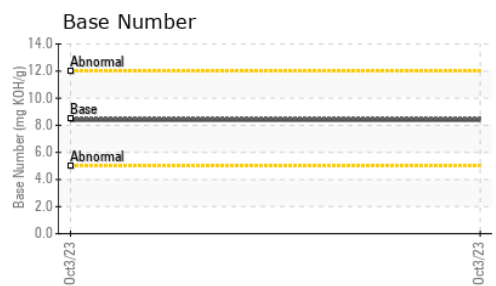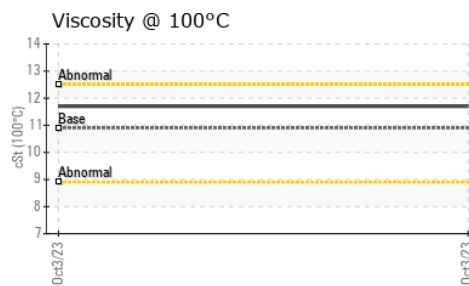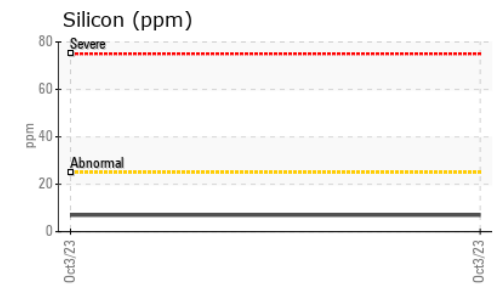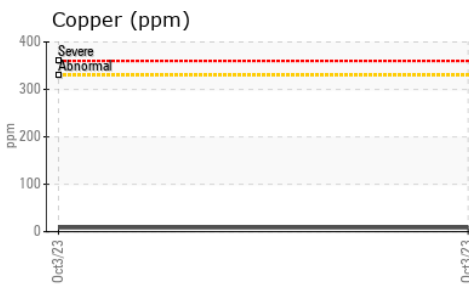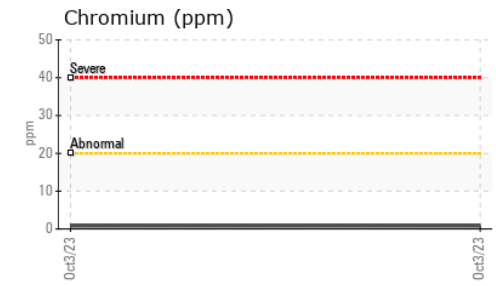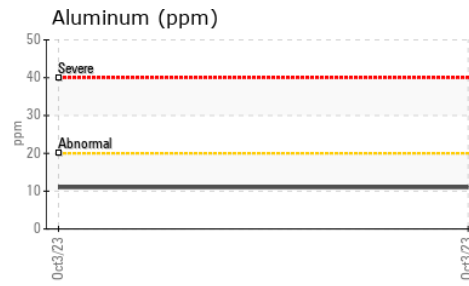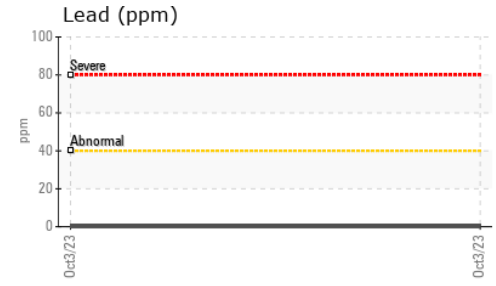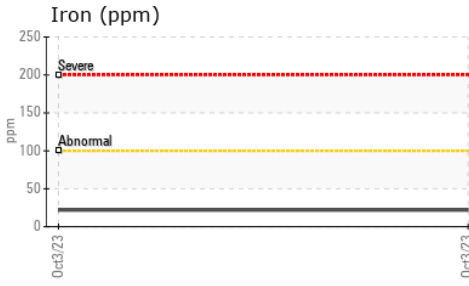

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0020780 **Received** : 25 Oct 2023
Lab Number : **02591703** **Diagnosed** : 26 Oct 2023
Unique Number : 5668782 **Diagnostician** : Wes Davis
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

Wajax Power Systems
 10955 Cote de Liesse
 Dorval, QC
 CA H9P 1A7
 Contact: Michel Corbeil
 mcorbeil@wajax.com
 T: (514)636-0680
 F: (514)636-8590

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.