




# PROBLEM SUMMARY


Area  
**BRUCE B/6/43230**  
 Machine Id  
**6-43230-P4-P IB Brg Drn**  
 Component  
**Inboard Bearing**  
 Fluid  
**ESSO NUTO H ISO 46 (--- GAL)**

Sample Rating Trend

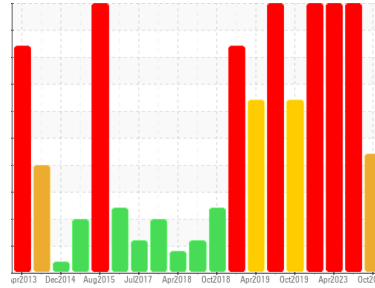

## COMPONENT CONDITION SUMMARY

Particle Trend

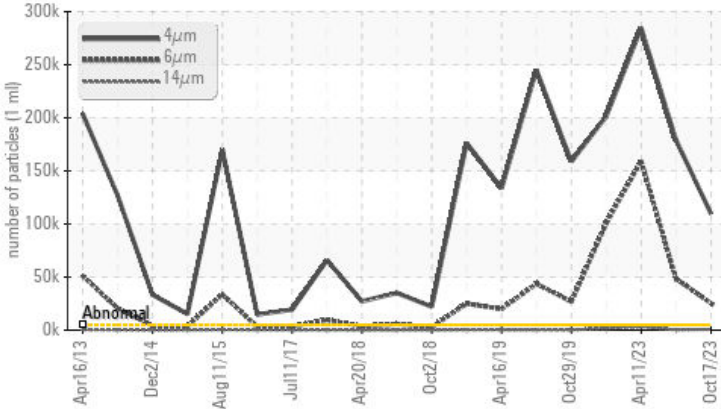

## RECOMMENDATION

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

## PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	SEVERE	SEVERE	SEVERE
Particles >4µm	>5000	109647	178919	284663
Particles >6µm	>1300	25331	48296	159306
Particles >14µm	>320	725	320	3013
Particles >21µm	>80	118	21	171
Oil Cleanliness	ISO 4406 (c) >19/17/15	24/22/17	25/23/15	25/24/19
PrtFilter			no image	no image

Customer Id: BRUTIV  
 Sample No.: WC0791594  
 Lab Number: 02591781  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Kevin Marson +1 (289)291-4644 x4644  
[Kevin.Marson@wearcheck.com](mailto:Kevin.Marson@wearcheck.com)


To change component or sample information:  
 Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	Resample in 30-45 days to monitor this situation.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.

HISTORICAL DIAGNOSIS


WEAR




**22 Sep 2023 Diag: Kevin Marson**

Check seals and/or filters for points of contaminant entry. Check seals and/or filters for points of contaminant entry. We advise that you check all areas where dirt can enter the system. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Copper ppm levels are severe. Bearing wear is indicated. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. There is a high amount of silt (particulates < 14 microns in size) present in the oil. Elemental level of silicon (Si) above normal indicating ingress of seal material. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

view report




WEAR




**11 Apr 2023 Diag: Kevin Marson**

Check seals and/or filters for points of contaminant entry. We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. No other corrective action is recommended at this time. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Chromium and copper and tin ppm levels are severe. Lead ppm levels are abnormal. Wear particle analysis indicates that the ferrous cutting particles are marginal. Bearing wear is indicated. Cutting wear particles are caused by either hard protuberances (mis-aligned components, etc.), or abrasives entering the system and embedding themselves in softer materials (sand, etc.), and gouging out mating surfaces. There is a high amount of particulates (2 to 100 microns in size) present in the oil. Elemental level of silicon (Si) above normal indicating ingress of seal material. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

view report




WEAR



**31 Jan 2023 Diag: Kevin Marson**

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Chromium ppm levels are severe. Copper and tin ppm levels are abnormal. Bearing wear is indicated. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. Particles >6µm are severely high. Oil Cleanliness are severely high. Particles >4µm are severely high. Silicon ppm levels are abnormally high. Particles >14µm are abnormally high. Particles >21µm are notably high. Elemental level of silicon (Si) above normal indicating ingress of seal material. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

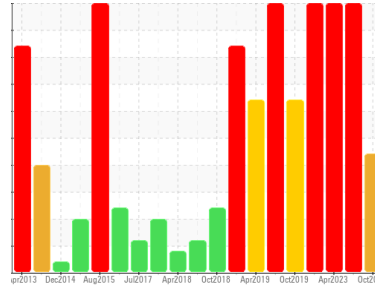

ISO



Area  
**BRUCE B/6/43230**  
Machine Id  
**6-43230-P4-P IB Brg Drn**  
Component  
**Inboard Bearing**  
Fluid  
**ESSO NUTO H ISO 46 (--- GAL)**

## DIAGNOSIS

### Recommendation

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code.

### Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0791594</b>	WC0845425	WC0603513
Sample Date	Client Info	<b>17 Oct 2023</b>	22 Sep 2023	11 Apr 2023
Machine Age	hrs	<b>0</b>	0	0
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>SEVERE</b>	SEVERE	SEVERE

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >10	<1	<1
Chromium	ppm	ASTM D5185(m) >5	<b>1</b>	4
Nickel	ppm	ASTM D5185(m) >5	<b>0</b>	<1
Titanium	ppm	ASTM D5185(m) >5	<b>0</b>	0
Silver	ppm	ASTM D5185(m)	<1	<1
Aluminum	ppm	ASTM D5185(m) >5	<b>0</b>	0
Lead	ppm	ASTM D5185(m) >5	<1	3
Copper	ppm	ASTM D5185(m) >5	<1	<b>12</b>
Tin	ppm	ASTM D5185(m) >5	<1	3
Antimony	ppm	ASTM D5185(m)	<b>0</b>	0
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0


## DR-FERROGRAPHY

method	limit/base	current	history1	history2
Large Particles	DR-Ferr*	<b>9.3</b>	2.9	15.9
Small Particles	DR-Ferr*	<b>3.0</b>	3.8	7.5
Total Particles	DR-Ferr*	<b>12.3</b>	6.7	23.4
Large Particles Percentage	%	<b>51.2</b>	0	35.9
Severity Index	DR-Ferr*	<b>59</b>	3	134

## FERROGRAPHY






method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*	2	3
Ferrous Sliding	Scale 0-10	ASTM D7684*		
Ferrous Cutting	Scale 0-10	ASTM D7684*		1
Ferrous Rolling	Scale 0-10	ASTM D7684*	1	1
Ferrous Break-in	Scale 0-10	ASTM D7684*		
Ferrous Spheres	Scale 0-10	ASTM D7684*		
Ferrous Black Oxides	Scale 0-10	ASTM D7684*		
Ferrous Red Oxides	Scale 0-10	ASTM D7684*		
Ferrous Corrosive	Scale 0-10	ASTM D7684*		
Ferrous Other	Scale 0-10	ASTM D7684*		
Nonferrous Rubbing	Scale 0-10	ASTM D7684*		
Nonferrous Sliding	Scale 0-10	ASTM D7684*		
Nonferrous Cutting	Scale 0-10	ASTM D7684*		
Nonferrous Rolling	Scale 0-10	ASTM D7684*		
Nonferrous Other	Scale 0-10	ASTM D7684*		
Carbonaceous Material	Scale 0-10	ASTM D7684*		
Lubricant Degradation	Scale 0-10	ASTM D7684*		
Sand/Dirt	Scale 0-10	ASTM D7684*	1	1
Fibres	Scale 0-10	ASTM D7684*		
Spheres	Scale 0-10	ASTM D7684*		
Other	Scale 0-10	ASTM D7684*		

Particle Filter (Magn: 200 x)

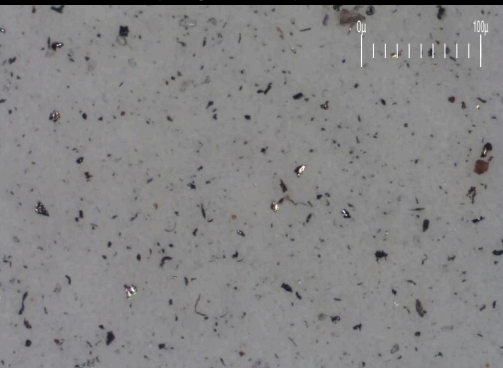



# OIL ANALYSIS REPORT

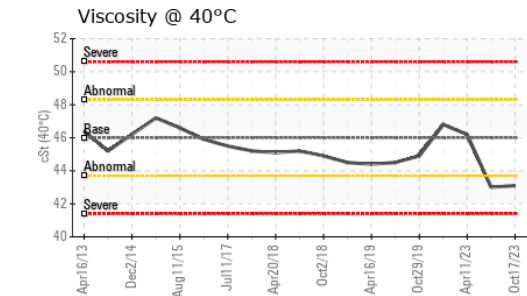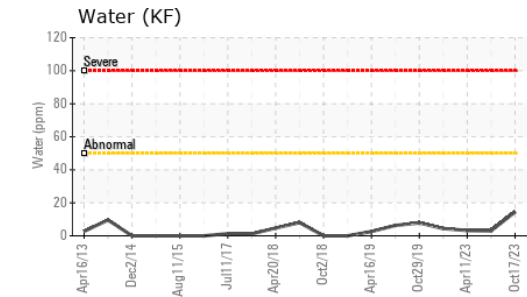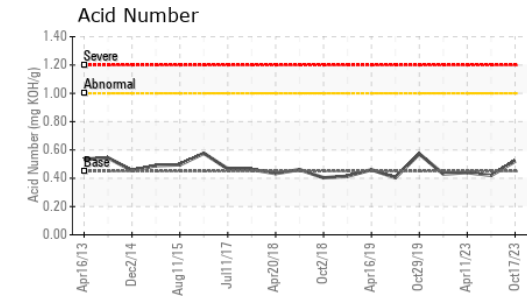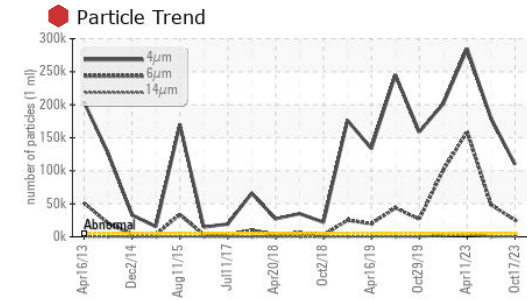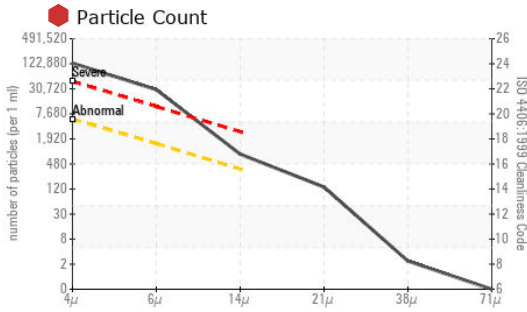

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<1	0
Barium	ppm	ASTM D5185(m)	0	<1	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	5	<1	0
Calcium	ppm	ASTM D5185(m)	50	53	56
Phosphorus	ppm	ASTM D5185(m)	330	345	383
Zinc	ppm	ASTM D5185(m)	410	437	442
Sulfur	ppm	ASTM D5185(m)	2700	5863	5831
Lithium	ppm	ASTM D5185(m)		<1	<1

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>5	1	13
Sodium	ppm	ASTM D5185(m)	>5	0	0
Potassium	ppm	ASTM D5185(m)	>20	0	<1
Water	%	ASTM D6304*	>0.005	0.001	0.001
ppm Water	ppm	ASTM D6304*	>50	14.5	3.2


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	109647	178919	284663
Particles >6µm	ASTM D7647	>1300	25331	48296	159306
Particles >14µm	ASTM D7647	>320	725	320	3013
Particles >21µm	ASTM D7647	>80	118	21	171
Particles >38µm	ASTM D7647	>20	2	1	1
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/15	24/22/17	25/23/15	25/24/19

FLUID DEGRADATION	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974*	0.45	0.52	0.42	0.44

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.005	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	46	43.1	43.0	46.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

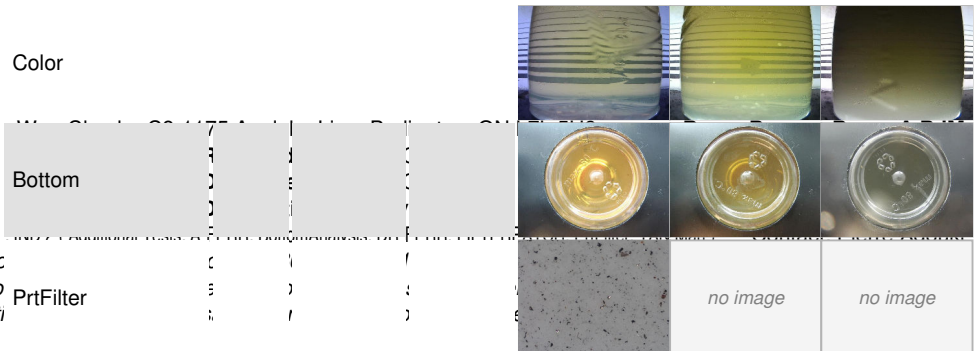

**Laboratory Sample No.**  
**Lab Number**  
**Unique Number**  
**Test Package**

To discuss this sample report, call  
 Test denoted (\*) outside scope of  
 Validity of results and interpretation