




OIL ANALYSIS REPORT

Sample Rating Trend

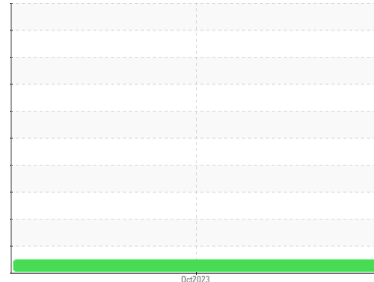

NORMAL



Machine Id
MOBILE DTE 832

Component
Reference New (Unused) Oil
Fluid
MOBIL DTE 832 (--- LTR)

DIAGNOSIS

Recommendation

This is the baseline readout on this new (unused) oil. The fluid is suitable for service.

Wear

{not applicable}

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. There is no indication of any contamination in the new (unused) oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC	---	---
Sample Date	Client Info		25 Oct 2023	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			NORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>5	0	---
Chromium	ppm	ASTM D5185(m)	>5	0	---
Nickel	ppm	ASTM D5185(m)	>5	0	---
Titanium	ppm	ASTM D5185(m)		0	---
Silver	ppm	ASTM D5185(m)	>5	<1	---
Aluminum	ppm	ASTM D5185(m)	>5	<1	---
Lead	ppm	ASTM D5185(m)	>5	0	---
Copper	ppm	ASTM D5185(m)	>5	0	---
Tin	ppm	ASTM D5185(m)	>5	0	---
Antimony	ppm	ASTM D5185(m)		0	---
Vanadium	ppm	ASTM D5185(m)		0	---
Beryllium	ppm	ASTM D5185(m)		0	---
Cadmium	ppm	ASTM D5185(m)		0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1	---
Barium	ppm	ASTM D5185(m)		<1	---
Molybdenum	ppm	ASTM D5185(m)		0	---
Manganese	ppm	ASTM D5185(m)		0	---
Magnesium	ppm	ASTM D5185(m)		0	---
Calcium	ppm	ASTM D5185(m)		1	---
Phosphorus	ppm	ASTM D5185(m)		1151	---
Zinc	ppm	ASTM D5185(m)		<1	---
Sulfur	ppm	ASTM D5185(m)		12	---
Lithium	ppm	ASTM D5185(m)		<1	---


CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	0	---
Sodium	ppm	ASTM D5185(m)		<1	---
Potassium	ppm	ASTM D5185(m)	>20	<1	---

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*		0	---
Nitration	Abs/cm	ASTM D7624*		2.8	---
Sulfation	Abs./1mm	ASTM D7415*		15.3	---

OIL ANALYSIS REPORT

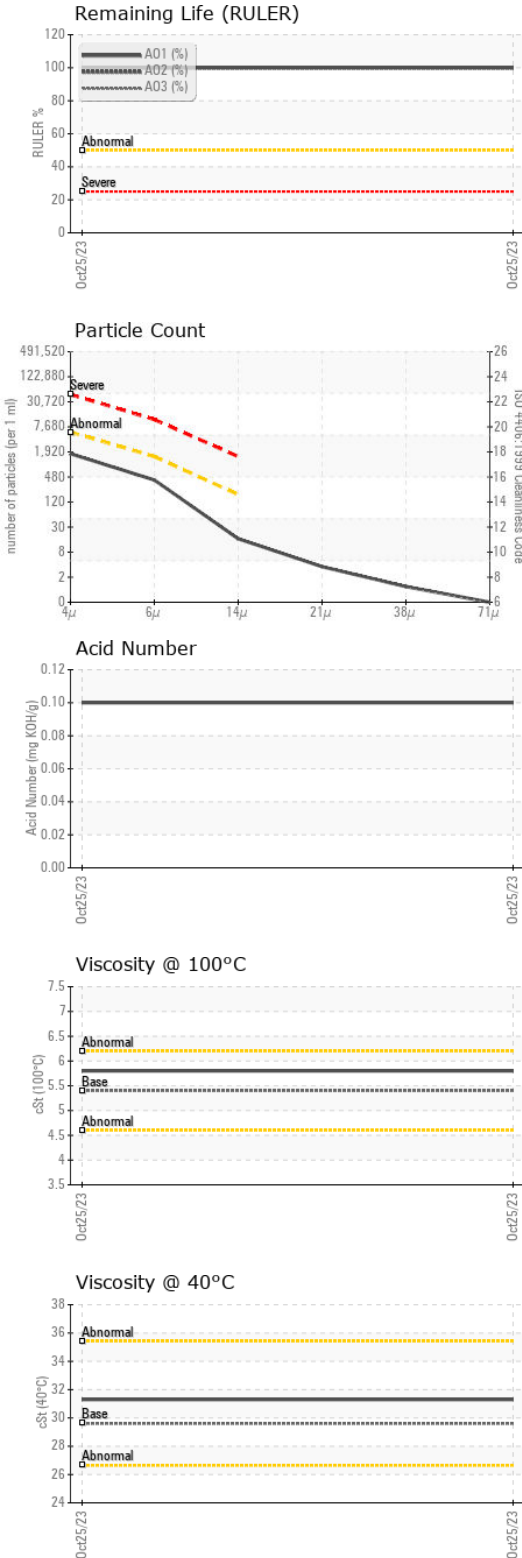

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	1523	---	---
Particles >6µm	ASTM D7647	>1300	357	---	---
Particles >14µm	ASTM D7647	>160	14	---	---
Particles >21µm	ASTM D7647	>40	3	---	---
Particles >38µm	ASTM D7647	>10	1	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	18/16/11	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm ASTM D7414*		3.6	---	---
Acid Number (AN)	mg KOH/g ASTM D974*		0.10	---	---
Anti-Oxidant 1	% ASTM D6971*	<25	100	---	---
Anti-Oxidant 2	% ASTM D6971*	<25	100	---	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	NONE	---	---
Yellow Metal	scalar Visual*	NONE	NONE	---	---
Precipitate	scalar Visual*	NONE	NONE	---	---
Silt	scalar Visual*	NONE	NONE	---	---
Debris	scalar Visual*	NONE	VLITE	---	---
Sand/Dirt	scalar Visual*	NONE	NONE	---	---
Appearance	scalar Visual*	NORML	NORML	---	---
Odor	scalar Visual*	NORML	NORML	---	---
Emulsified Water	scalar Visual*		NEG	---	---
Free Water	scalar Visual*		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	29.6	31.3	---	---
Visc @ 100°C	cSt ASTM D7279(m)	5.4	5.8	---	---
Viscosity Index (VI)	Scale ASTM D2270*	110	129	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC
Lab Number : **02592052**
Unique Number : 5669131
Test Package : IND 2 (Additional Tests: Bottom, FT-IR, ICP-NewOil, KV100, PRTCOUNT, RULer, TAN Man, VC

Mikan Inc.
 43 Sagona Avenue
 Mount Pearl, NL
 CA A1N 4P9
 Contact: Dina Marie Oldford
 doldford@mikan.ca
 T: (709)364-6619
 F: (709)364-3501

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.