




# PROBLEM SUMMARY

Sample Rating Trend

**WATER**




Area  
**SAB2**  
 Machine Id  
**SAB2 G22 Governor**  
 Component  
**Hydraulic System**  
 Fluid  
**ESSO TERESSO ISO 46 (6160 LTR)**

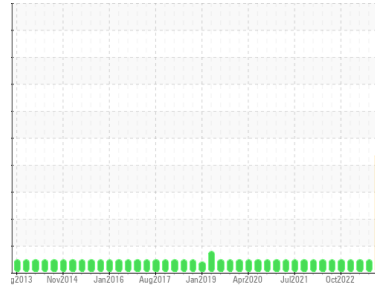

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

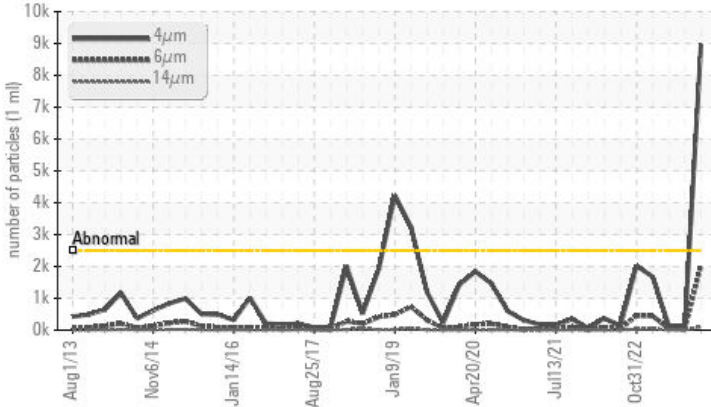

## RECOMMENDATION

We advise that you check for the source of water entry. Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you follow the water drain-off procedure for this component. We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL
Particles >4µm	ASTM D7647	>2500	▲ <b>8958</b>	108	138
Particles >6µm	ASTM D7647	>640	▲ <b>2015</b>	30	50
Particles >14µm	ASTM D7647	>80	▲ <b>107</b>	5	7
Particles >21µm	ASTM D7647	>20	▲ <b>30</b>	1	2
Oil Cleanliness	ISO 4406 (c)	>18/16/13	▲ <b>20/18/14</b>	14/12/10	14/13/10
Appearance	scalar Visual*	NORML	▲ <b>WGOIL</b>	NORML	NORML
Free Water	scalar Visual*		▲ <b>1%</b>	NEG	NEG

Customer Id: ONTQUE  
 Sample No.: WC0858095  
 Lab Number: 02592063  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Kevin Marson +1 (289)291-4644 x4644  
[Kevin.Marson@wearcheck.com](mailto:Kevin.Marson@wearcheck.com)

To change component or sample information:  
 Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Water Drain-off	---	---	?	We advise that you follow the water drain-off procedure for this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Water Access	---	---	?	We advise that you check for the source of water entry.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.

## HISTORICAL DIAGNOSIS

### 31 Jul 2023 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 05 Jun 2023 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 26 Jan 2023 Diag: Bill Quesnel

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report






# OIL ANALYSIS REPORT

Sample Rating Trend

**WATER**

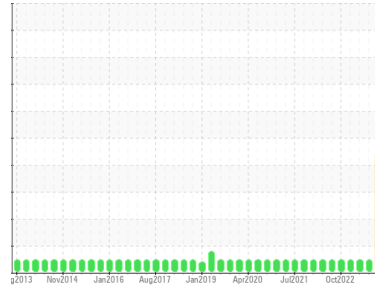

Area  
**SAB2**  
Machine Id  
**SAB2 G22 Governor**  
Component  
**Hydraulic System**  
Fluid  
**ESSO TERESSO ISO 46 (6160 LTR)**

## DIAGNOSIS

### Recommendation

We advise that you check for the source of water entry. Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you follow the water drain-off procedure for this component. We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. Free water present. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code.

### Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0858095</b>	WC0830395	WC0780493
Sample Date	Client Info		<b>25 Oct 2023</b>	31 Jul 2023	05 Jun 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185(m) >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m) >20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185(m) >20	<b>0</b>	0	0
Lead	ppm	ASTM D5185(m) >20	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185(m) >20	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	<1	<1
Barium	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	<1	0
Phosphorus	ppm	ASTM D5185(m) 2.4	<b>1</b>	1	<1
Zinc	ppm	ASTM D5185(m) 0	<b>1</b>	2	<1
Sulfur	ppm	ASTM D5185(m)	<b>1502</b>	1623	1509
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<b>0</b>	0	0
Sodium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Potassium	ppm	ASTM D5185(m) >20	<b>0</b>	<1	<1
Water	%	ASTM D6304* >0.05	<b>0.007</b>	---	---
ppm Water	ppm	ASTM D6304* >500	<b>72.7</b>	---	---

## FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	<b>▲ 8958</b>	108	138
Particles >6µm	ASTM D7647	>640	<b>▲ 2015</b>	30	50
Particles >14µm	ASTM D7647	>80	<b>▲ 107</b>	5	7
Particles >21µm	ASTM D7647	>20	<b>▲ 30</b>	1	2
Particles >38µm	ASTM D7647	>4	<b>4</b>	0	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>18/16/13	<b>▲ 20/18/14</b>	14/12/10	14/13/10

# OIL ANALYSIS REPORT


### Particle Trend

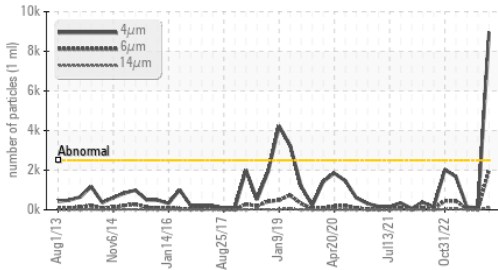


### Water (KF)

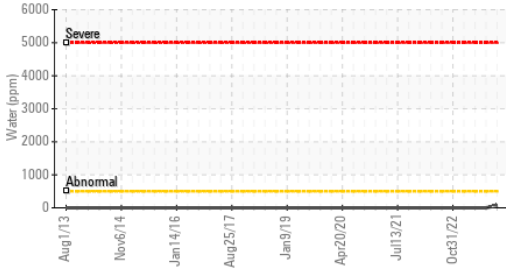


### Acid Number

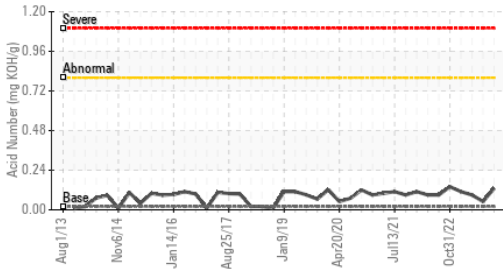

### Water (KF)

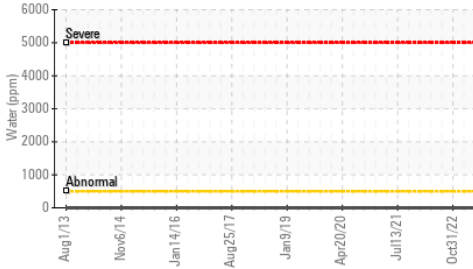

### Viscosity @ 40°C

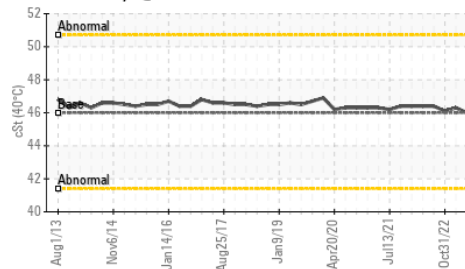


### FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN) mg KOH/g	ASTM D974*	0.02	<b>0.13</b>	0.05	0.09	
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>VLITE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>WGOIL</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	<b>.5%</b>	NEG	NEG
Free Water	scalar	Visual*		<b>1%</b>	NEG	NEG

### FLUID PROPERTIES


method	limit/base	current	history1	history2	
Visc @ 40°C cSt	ASTM D7279(m)	46	<b>45.9</b>	46.2	46.0

### SAMPLE IMAGES

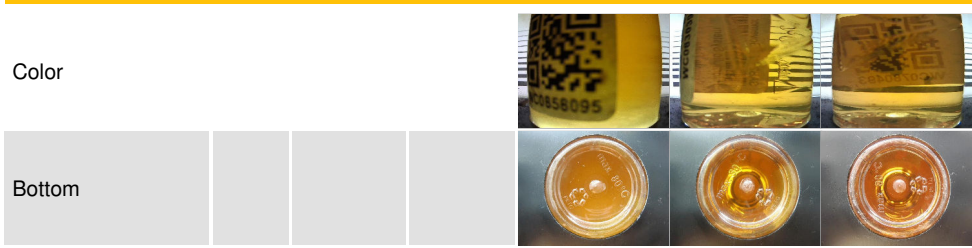


### GRAPHS


#### Ferrous Alloys

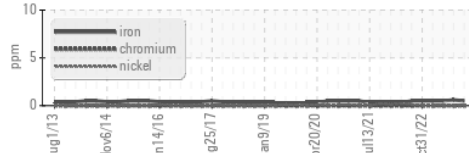


#### Non-ferrous Metals

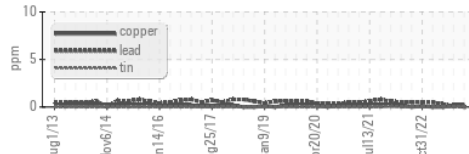


#### Viscosity @ 40°C

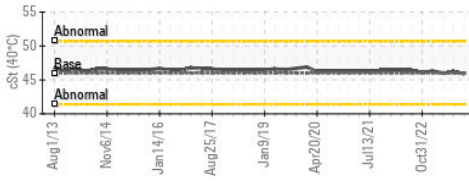

#### Particle Count

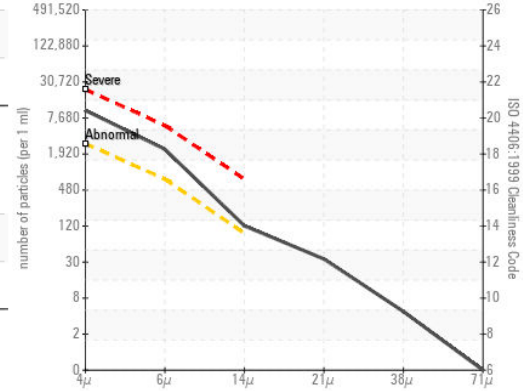

#### Acid Number

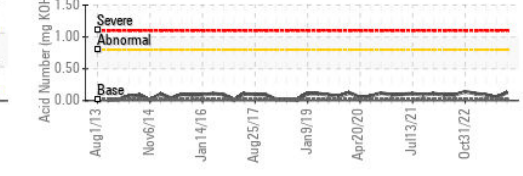

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0858095  
**Lab Number** : **02592063**  
**Unique Number** : 5669142  
**Test Package** : IND 2 ( Additional Tests: KF, TAN Man )  
**Received** : 26 Oct 2023  
**Diagnosed** : 31 Oct 2023  
**Diagnostician** : Kevin Marson

**Ontario Power Generation**  
 NIAGARA PLANT GROUP, 14000 NIAGARA PKWY  
 NIAGARA ON THE LAKE, ON  
 CA L0S 1J0  
 Contact: Alex Courtemanche  
 alex.courtemanche@opg.com  
 T: (905)357-0322  
 F: (905)357-6558

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.