


COMPONENT CONDITION SUMMARY

AW HYDRAULIC OIL ISO 46 (7000 LTR)

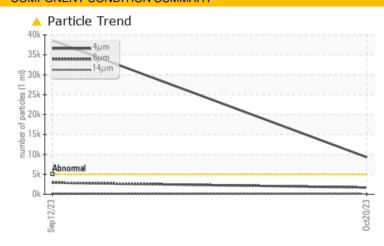

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS										
Sample Status			ATTENTION	ABNORMAL						
Particles >4µm	ASTM D7647	>5000	<u> </u>	▲ 38629						
Particles >6µm	ASTM D7647	>1300	🔺 1683	4 2909						
Oil Cleanliness	ISO 4406 (c)	>19/17/14	A 20/18/14	A 22/19/15						

Customer Id: APELAN Sample No.: WC0801116 Lab Number: 02592396 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Wes Davis +1 905-569-8600 x223 wesd@wearcheck.ca

To change component or sample information: Gloria Gonzalez +1 (289)291-4643 x4643 <u>gloria.gonzalez@wearcheck.com</u>

RECOMMENDED A	CTIONS			
Action	Status	Date	Done By	Description
Change Filter			?	We recommend you service the filters on this component.
Information Required			?	Please specify the brand, type, and viscosity of the oil on your next sample.

HISTORICAL DIAGNOSIS



12 Sep 2023 Diag: Kevin Marson

We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using Advanced Oil Monitoring (AOM) kits for this system. The AOM test package includes advanced level testing to determine the suitability of turbine and large industrial compressor oils for continued use. Component wear rates appear to be normal (unconfirmed). There is a moderate amount of particulates (2 to 100 microns in size) present in the oil. The oil viscosity is lower than typical, possibly indicating the addition of lighter grade oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service (unconfirmed). The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.





OIL ANALYSIS REPORT

Area [40994] **PRESEZZI PRESS #2**

Component **Hydraulic System** AW HYDRAULIC OIL ISO 46 (7000 LTR)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear


All component wear rates are normal.

Contamination

There is a light amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

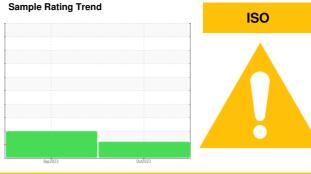

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0801116	WC0801127	
Sample Date		Client Info		20 Oct 2023	12 Sep 2023	
Machine Age	hrs	Client Info		0	0	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				ATTENTION	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	3	1	
Chromium	ppm	ASTM D5185(m)	>20	<1	<1	
Nickel	ppm	ASTM D5185(m)	>20	0	<1	
Titanium	ppm	ASTM D5185(m)		0	0	
Silver	ppm	ASTM D5185(m)		<1	0	
Aluminum	ppm	ASTM D5185(m)	>20	0	<1	
Lead	ppm	ASTM D5185(m)	>20	<1	0	
Copper	ppm	ASTM D5185(m)	>20	8	3	
Tin	ppm	ASTM D5185(m)	>20	<1	0	
Antimony	ppm	ASTM D5185(m)		0	0	
Vanadium	ppm	ASTM D5185(m)		0	0	
Beryllium	ppm	ASTM D5185(m)		0	0	
Cadmium	ppm	ASTM D5185(m)		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	5	<1	<1	
Barium	ppm	ASTM D5185(m)	5	<1	0	
Molybdenum	ppm	ASTM D5185(m)	5	0	<1	
Manganese	ppm	ASTM D5185(m)		0	0	
Magnesium	ppm	ASTM D5185(m)	25	2	4	
Calcium	ppm	ASTM D5185(m)	200	52	43	
Phosphorus	ppm	ASTM D5185(m)	300	306	329	
Zinc	ppm	ASTM D5185(m)	370	386	379	
Sulfur	ppm	ASTM D5185(m)	2500	914	914	
Lithium	ppm	ASTM D5185(m)		<1	<1	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon		ASTM D5185(m)	>15	<1	<1	
	ppm		>15	4	6	
Sodium Potassium	ppm ppm	ASTM D5185(m) ASTM D5185(m)	>20	4	0	
FLUID CLEANLIN		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	▲ 9310	▲ 38629	
'						
Particles >6µm		ASTM D7647 ASTM D7647	>1300 >160	▲ 1683 93	▲ 2909 ▲ 236	
Particles >14µm Particles >21µm				93 19	▲ 85	
•		ASTM D7647		0		
Particles >38µm		ASTM D7647	>10		3	
Particles >71µm Oil Cleanliness		ASTM D7647 ISO 4406 (c)	>3 >19/17/14	0 <u>20/18/14</u>	22/19/15	
FLUID DEGRADA		method	limit/base	current	history1	history2
		ASTM D974*		0.46	0.35	
Acid Number (AN)	mg KOH/g	AG I WI D9/4	0.57	0.40	0.00	

0.35 Contact/Location: Gregg Baker - APELAN

Report Id: APELAN [WCAMIS] 02592396 (Generated: 10/30/2023 08:39:30) Rev: 1



Acid Number

1.00

OIL ANALYSIS REPORT

method


limit/base

current


history1


history2

VISUAL





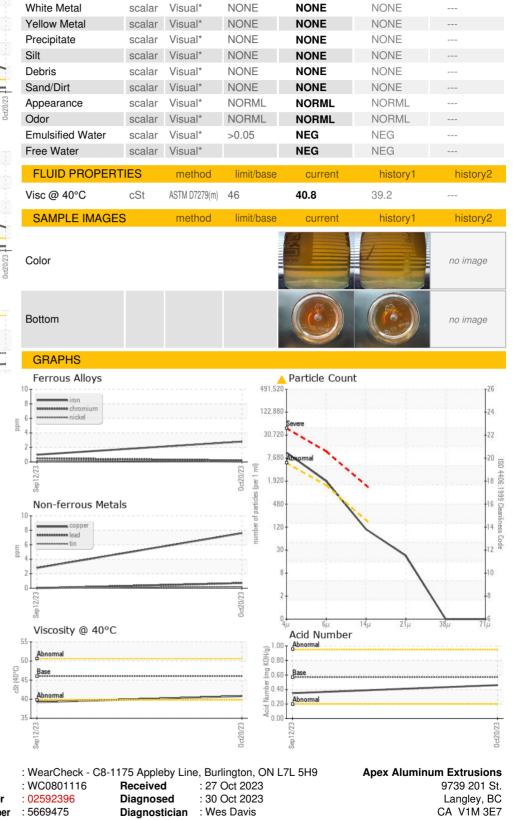

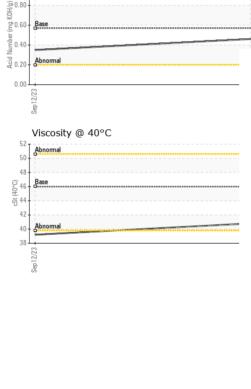

Laboratory CALA Sample No. Lab Number ISO 17025:2017 Accredited Unique Number Laboratory Test Package : IND 2 (Additional Tests: TAN Man) Contact: Gregg Baker gbaker@apexextrusions.ca To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. T: (604)882-3542 Validity of results and interpretation are based on the sample and information as supplied.

F: