




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

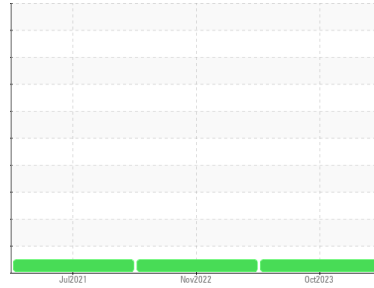

Area
[0419]
 Machine Id
1678 - PORTABLE GENSET #2
 Component
Diesel Engine
 Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	WC0860136	WC0747636	WC0602801	
Sample Date	Client Info	29 Oct 2023	01 Nov 2022	08 Jul 2021	
Machine Age	hrs	Client Info	0	139	123
Oil Age	hrs	Client Info	0	15	0
Oil Changed	Client Info	Changed	Changed	Changed	
Sample Status		NORMAL	NORMAL	NORMAL	

CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >2.1	<1.0	<1.0	<1.0
Water	WC Method >0.21	NEG	NEG	NEG
Glycol	WC Method	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >51	9	3	2
Chromium	ppm ASTM D5185(m) >11	0	0	0
Nickel	ppm ASTM D5185(m) >5	0	<1	<1
Titanium	ppm ASTM D5185(m)	0	<1	0
Silver	ppm ASTM D5185(m) >3	<1	0	0
Aluminum	ppm ASTM D5185(m) >31	2	1	2
Lead	ppm ASTM D5185(m) >26	0	<1	<1
Copper	ppm ASTM D5185(m) >26	<1	<1	<1
Tin	ppm ASTM D5185(m) >4	0	0	0
Antimony	ppm ASTM D5185(m)	0	<1	<1
Vanadium	ppm ASTM D5185(m)	0	0	0
Beryllium	ppm ASTM D5185(m)	0	0	0
Cadmium	ppm ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 250	73	6	74
Barium	ppm ASTM D5185(m) 10	<1	0	0
Molybdenum	ppm ASTM D5185(m) 100	89	6	84
Manganese	ppm ASTM D5185(m)	0	<1	0
Magnesium	ppm ASTM D5185(m) 450	41	10	15
Calcium	ppm ASTM D5185(m) 3000	2138	2204	2121
Phosphorus	ppm ASTM D5185(m) 1150	969	921	1093
Zinc	ppm ASTM D5185(m) 1350	1120	957	1149
Sulfur	ppm ASTM D5185(m) 4250	3079	3109	3359
Lithium	ppm ASTM D5185(m)	<1	<1	<1

CONTAMINANTS


method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >22	4	3	4
Sodium	ppm ASTM D5185(m) >158	2	2	3
Potassium	ppm ASTM D5185(m) >20	0	1	<1

INFRA-RED


method	limit/base	current	history1	history2
Soot %	% ASTM D7844* >3	0	0	0
Nitration	Abs/cm ASTM D7624* >20	8.3	5.7	7.2
Sulfation	Abs./1mm ASTM D7415* >30	17.4	16.3	16.7



OIL ANALYSIS REPORT

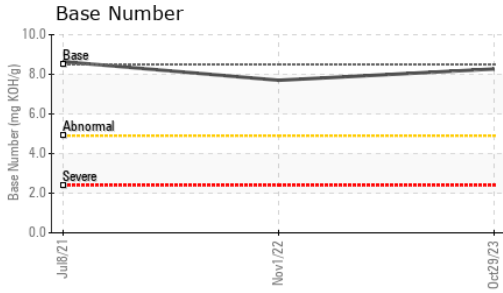









FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	ASTM D7414*	>25	13.6	9.7	12.4
Base Number (BN)	mg KOH/g	ASTM D2896*	8.5	8.27	7.70	8.64

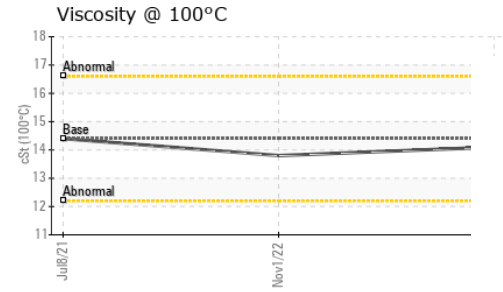

VISUAL	method	limit/base	current	history1	history2	
Emulsified Water	scalar	Visual*	>0.21	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	14.1	13.8	14.4

GRAPHS

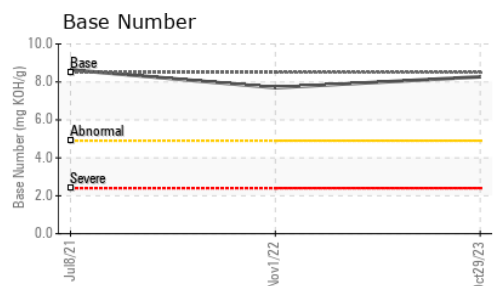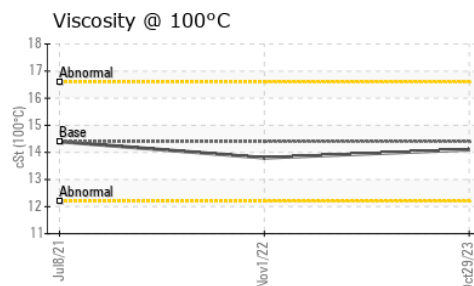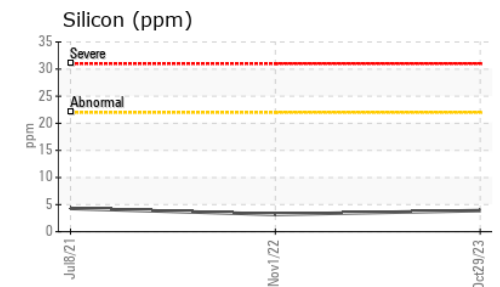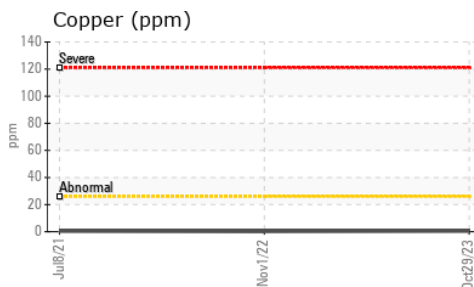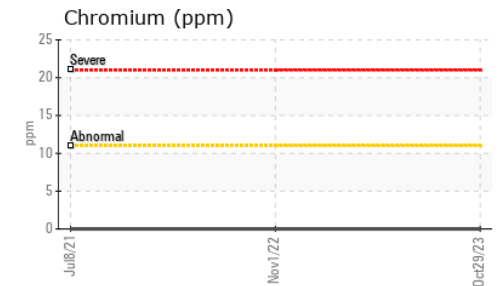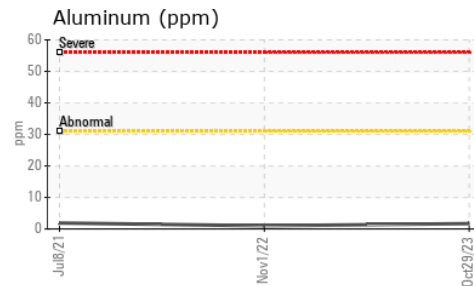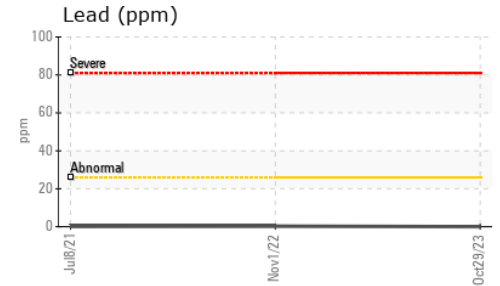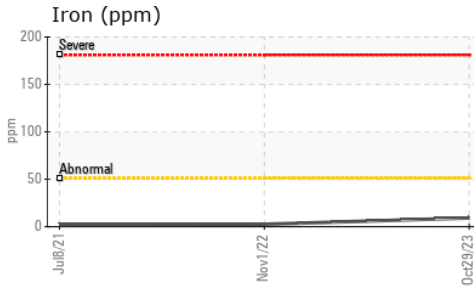

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0860136 **Received** : 30 Oct 2023
Lab Number : **02592551** **Diagnosed** : 30 Oct 2023
Unique Number : 5669630 **Diagnostician** : Wes Davis
Test Package : MOB 2

Lighthouse Electric
 6714 6th Conc South
 Amherstburg, ON
 CA N9V 0C8
 Contact: Brad Purdie
 brad_lighthouse@hotmail.com
 T: (519)730-1310
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.