




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

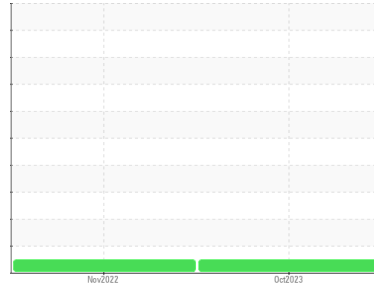

Machine Id  
**1685 - STONEY POINT PUMP STATION #1**

Component  
**Diesel Engine**

Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0860138</b>	WC0759211	---
Sample Date	Client Info		<b>17 Oct 2023</b>	14 Nov 2022	---
Machine Age	hrs	Client Info	<b>1137</b>	1143	---
Oil Age	hrs	Client Info	<b>0</b>	23	---
Oil Changed	Client Info		<b>Changed</b>	Changed	---
Sample Status			<b>NORMAL</b>	NORMAL	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	---
Glycol	WC Method		<b>NEG</b>	NEG	---

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>80	<b>12</b>	12	---
Chromium	ppm	ASTM D5185(m)	>6	<b>0</b>	0	---
Nickel	ppm	ASTM D5185(m)	>2	<b>0</b>	<1	---
Titanium	ppm	ASTM D5185(m)	>2	<b>0</b>	<1	---
Silver	ppm	ASTM D5185(m)	>2	<b>&lt;1</b>	0	---
Aluminum	ppm	ASTM D5185(m)	>20	<b>1</b>	2	---
Lead	ppm	ASTM D5185(m)	>95	<b>&lt;1</b>	<1	---
Copper	ppm	ASTM D5185(m)	>85	<b>&lt;1</b>	<1	---
Tin	ppm	ASTM D5185(m)	>9	<b>0</b>	0	---
Antimony	ppm	ASTM D5185(m)		<b>0</b>	<1	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	---
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	<1	---

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	250	<b>76</b>	66	---
Barium	ppm	ASTM D5185(m)	10	<b>&lt;1</b>	0	---
Molybdenum	ppm	ASTM D5185(m)	100	<b>85</b>	75	---
Manganese	ppm	ASTM D5185(m)		<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185(m)	450	<b>42</b>	17	---
Calcium	ppm	ASTM D5185(m)	3000	<b>2057</b>	2122	---
Phosphorus	ppm	ASTM D5185(m)	1150	<b>925</b>	1042	---
Zinc	ppm	ASTM D5185(m)	1350	<b>1078</b>	1083	---
Sulfur	ppm	ASTM D5185(m)	4250	<b>2991</b>	3225	---
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	---

## CONTAMINANTS



	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>25	<b>7</b>	5	---
Sodium	ppm	ASTM D5185(m)	>158	<b>2</b>	3	---
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	<1	---

## INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*		<b>0</b>	0	---
Nitration	Abs/cm	ASTM D7624*	>20	<b>7.4</b>	7.8	---
Sulfation	Abs./1mm	ASTM D7415*	>30	<b>16.9</b>	17.6	---



# OIL ANALYSIS REPORT







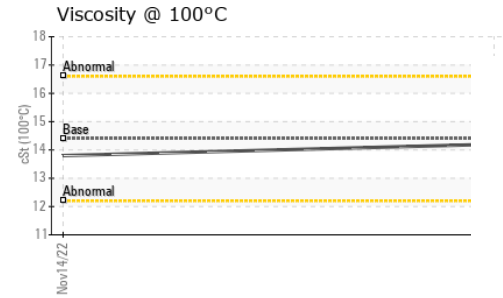
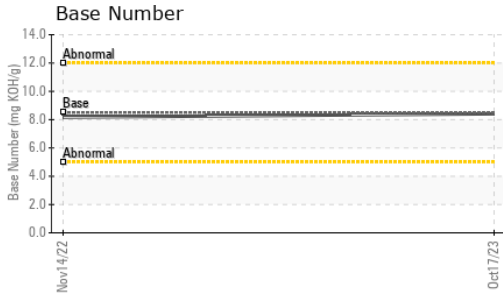


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>12.8</b>	13.0	---
Base Number (BN)	mg KOH/g	ASTM D2896*	8.5	<b>8.41</b>	8.17	---

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.1	<b>NEG</b>	NEG	---
Free Water	scalar	Visual*		<b>NEG</b>	NEG	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	<b>14.2</b>	13.8	---

## GRAPHS

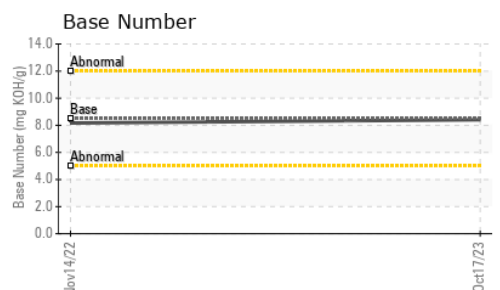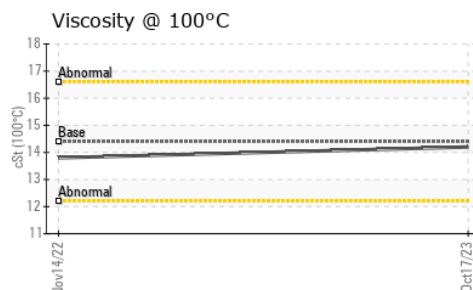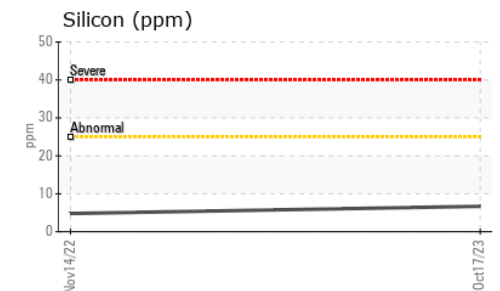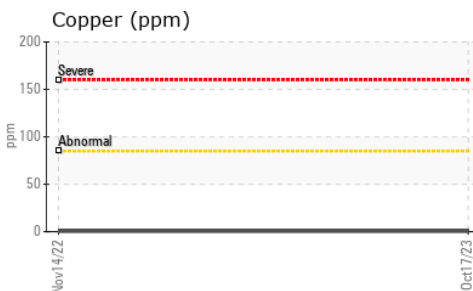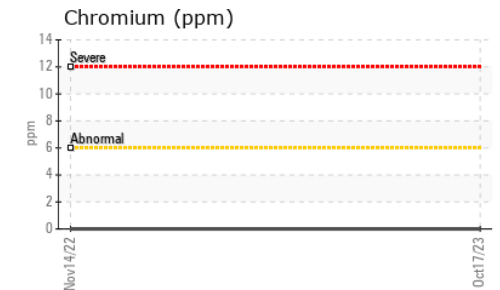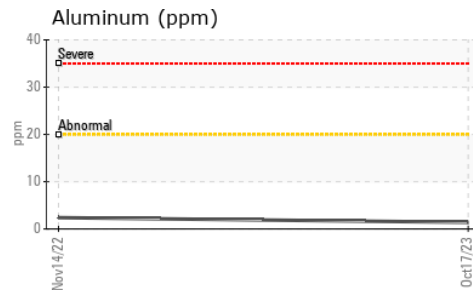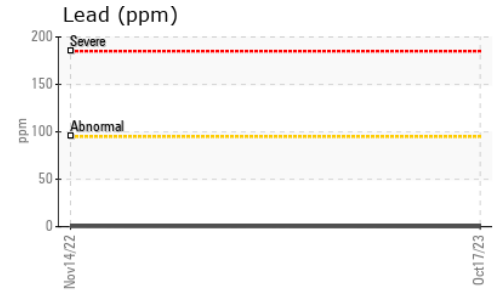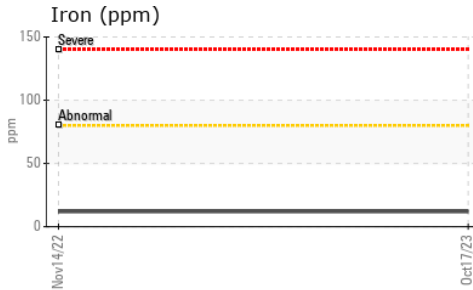

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0860138 **Received** : 30 Oct 2023  
**Lab Number** : **02592555** **Diagnosed** : 01 Nov 2023  
**Unique Number** : 5669634 **Diagnostician** : Wes Davis  
**Test Package** : MOB 2

**Lighthouse Electric**  
 6714 6th Conc South  
 Amherstburg, ON  
 CA N9V 0C8  
 Contact: Brad Purdie  
 brad\_lighthouse@hotmail.com  
 T: (519)730-1310  
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.