OIL ANALYSIS REPORT

Sample Rating Trend

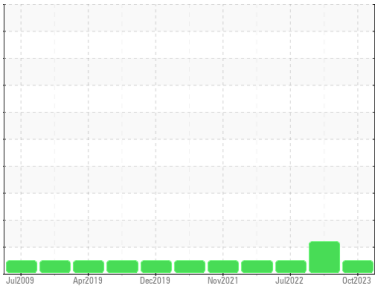

NORMAL

Area
System 31 - Crude Separator System
Machine Id
N-3104A TRANSFORMER, COALESCER STEP UP 600V 3 PH
Component
Transformer Oil
Fluid
IRVING TRANSFORMER OIL (--- LTR)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor. Insufficient sample was received to conduct all the routine laboratory tests (Interfacial Tension).

Wear
{not applicable}

Contamination
The water content is negligible. There is no indication of any contamination in the transformer oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the transformer oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**PP**	PP	PP
Sample Date		Client Info		**29 Oct 2023**	16 Apr 2023	28 Jul 2022
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**NORMAL**	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>125	**0**	<1	0
Chromium	ppm	ASTM D5185(m)		**0**	0	0
Nickel	ppm	ASTM D5185(m)		**0**	<1	0
Titanium	ppm	ASTM D5185(m)		**0**	0	0
Silver	ppm	ASTM D5185(m)	>2	**<1**	0	0
Aluminum	ppm	ASTM D5185(m)	>5	**0**	<1	<1
Lead	ppm	ASTM D5185(m)	>30	**<1**	0	0
Copper	ppm	ASTM D5185(m)	>10	**<1**	0	0
Tin	ppm	ASTM D5185(m)	>2	**0**	0	0
Antimony	ppm	ASTM D5185(m)		**0**	0	0
Vanadium	ppm	ASTM D5185(m)		**0**	0	0
Beryllium	ppm	ASTM D5185(m)		**0**	0	0
Cadmium	ppm	ASTM D5185(m)		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		**<1**	0	0
Barium	ppm	ASTM D5185(m)		**<1**	0	0
Molybdenum	ppm	ASTM D5185(m)		**0**	0	0
Manganese	ppm	ASTM D5185(m)		**0**	0	0
Magnesium	ppm	ASTM D5185(m)		**0**	0	0
Calcium	ppm	ASTM D5185(m)		**0**	0	0
Phosphorus	ppm	ASTM D5185(m)		**0**	0	<1
Zinc	ppm	ASTM D5185(m)		**<1**	<1	<1
Sulfur	ppm	ASTM D5185(m)		**853**	896	881
Lithium	ppm	ASTM D5185(m)		**<1**	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	**0**	0	0
Sodium	ppm	ASTM D5185(m)		**<1**	0	0
Potassium	ppm	ASTM D5185(m)	>20	**0**	<1	<1
Water	%	ASTM D6304*	>0.0035	**0.003**	0.001	0.001
ppm Water	ppm	ASTM D6304*	>35	**29.5**	5.1	0.9

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		**0.02**	▲ 0.06	0.02

OIL ANALYSIS REPORT

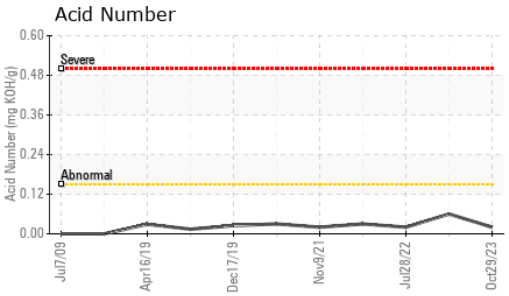

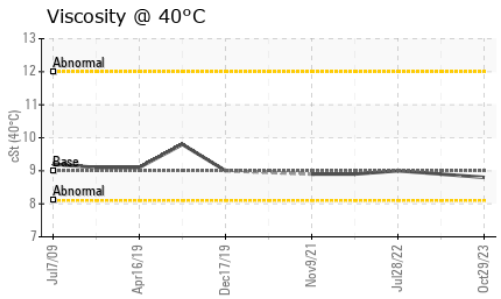

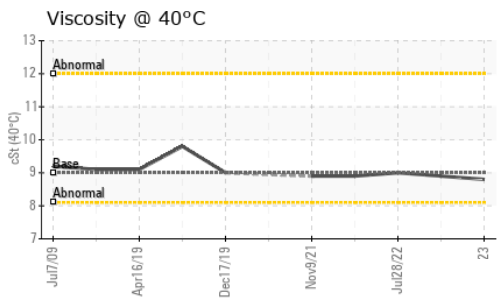

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Precipitate	scalar	Visual*	NONE	**NONE**	NONE	NONE
Silt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Debris	scalar	Visual*	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Appearance	scalar	Visual*	NORML	**NORML**	NORML	NORML
Odor	scalar	Visual*	NORML	**NORML**	NORML	NORML

FLUID PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		ASTM D4052(e)	0.865	**0.875**	0.874	0.874
Visc @ 40°C	cSt	ASTM D7279(m)	9	**8.8**	8.9	9
Interfacial Tension	mN/m	ASTM D971(e)*		**---**	27.78	27.91
ASTM Color	scalar	ASTM D1500(e)		**L1.5**	<1.5	<1.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

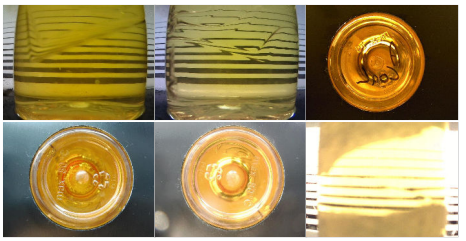

GRAPHS

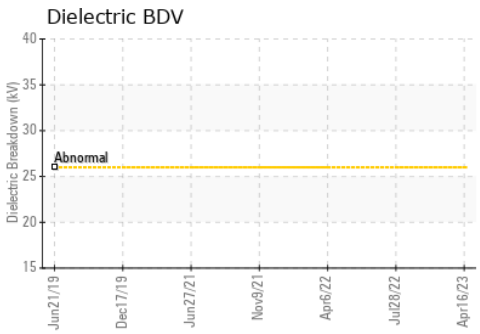

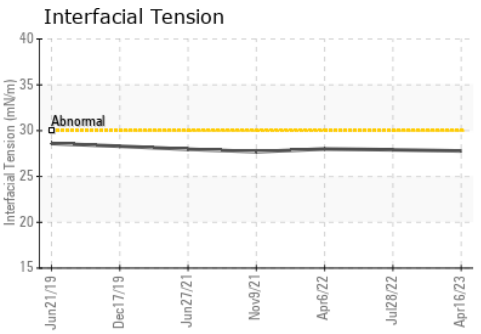

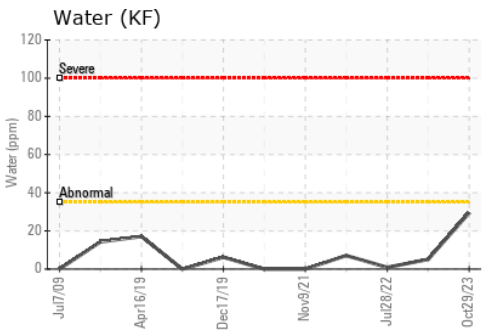

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PP
Lab Number : 02592791
Unique Number : 5669870
Test Package : TRF 1 (Additional Tests: ICP, KV40)

Recieved : 30 Oct 2023
Diagnosed : 18 Dec 2023
Diagnostician : Bill Quesnel

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

HIBERNIA MGMT & DEVELOPMENT CO. LTD
SUITE 1000,, 100 NEW GOWER STREET
ST.JOHNS, NL
CA A1C 6K3
Contact: Christopher Michelau
christopher.j.michelau@exxonmobil.com
T:
F: (709)722-3766