



OIL ANALYSIS REPORT

Sample Rating Trend


COMBUSTION



Machine Id
Pioneer GEN2TRANSFORMER (S/N 616458-1)

Component
Transformer Oil

Fluid
TRANSFORMER MINERAL API II (2260 LTR)

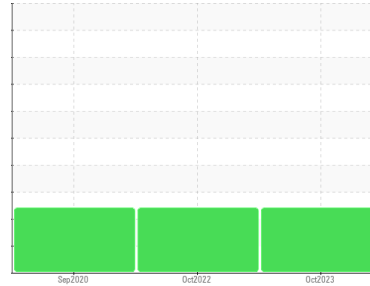

DIAGNOSIS

Recommendation

We recommend an early resample to monitor this condition. No other corrective action is recommended at this time. Diagnostician`s Note: Syringe only received, no sample bottle received so standard testing (IFT, acidity, dielectric, power factor) could not be tested.

Wear

{not applicable}

Contamination

Carbon Monoxide >=350 (0.035%), Carbon Dioxide >=2500 (0.25%): Thermal decomposition of cellulose.

Fluid Condition

The condition of the transformer oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0850749	WC0752822	WC0500723
Sample Date	Client Info	24 Oct 2023	31 Oct 2022	25 Sep 2020
Machine Age	hrs	0	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.0035	NEG	NEG	NEG

DISSOLVED GAS ANALYSIS (DGA)

method	limit/base	current	history1	history2
DGA - H2	ppm	5	5	3
DGA - O2	ppm	8677	10368	15144
DGA - N2	ppm	69590	48092	82392
DGA - CO	ppm	▲ 819	▲ 679	▲ 652
DGA - CO2	ppm	▲ 5400	▲ 4662	▲ 4153
DGA - Methane	ppm	10	10	9
DGA - Acetylene	ppm	0	0	0
DGA - Ethylene	ppm	8	14	6
DGA - Ethane	ppm	1	1	0
DGA - Total Gas Content	%	84510	63831	102359
DGA - Total Combustible Gas	ppm	843	709	670

VISUAL




method	limit/base	current	history1	history2		
White Metal	scalar	Visual*	NONE	---	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	---	NONE	NONE
Precipitate	scalar	Visual*	NONE	---	NONE	NONE
Silt	scalar	Visual*	NONE	---	NONE	NONE
Debris	scalar	Visual*	NONE	---	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	---	NONE	NONE
Appearance	scalar	Visual*	NORML	---	NORML	NORML
Odor	scalar	Visual*	NORML	---	NORML	NORML

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color			<i>no image</i>	
Bottom			<i>no image</i>	

OIL ANALYSIS REPORT

GRAPHS

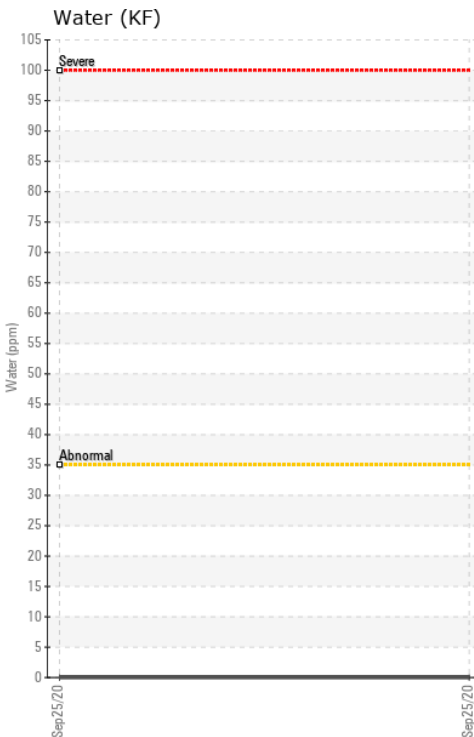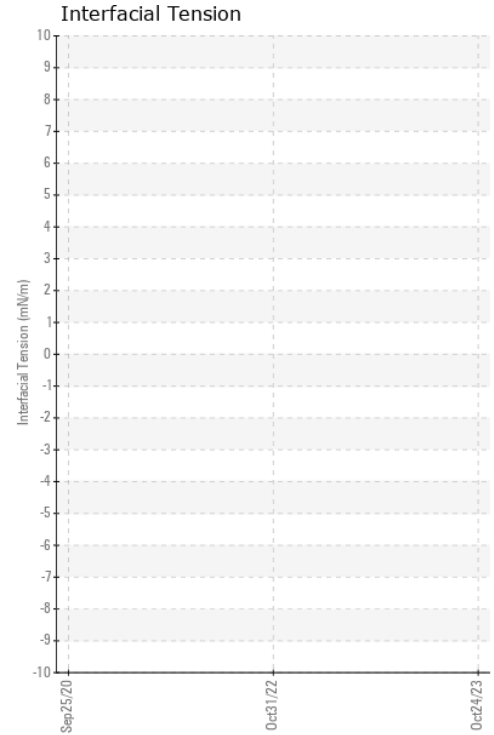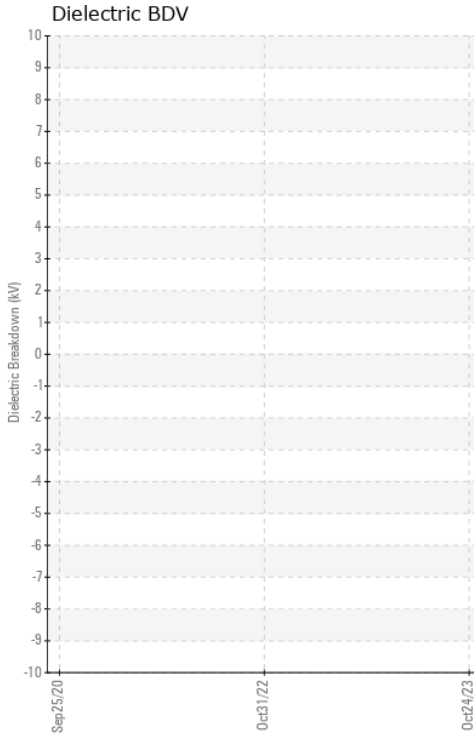

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0850749 **Received** : 30 Oct 2023
Lab Number : 02592858 **Diagnosed** : 21 Nov 2023
Unique Number : 5669937 **Diagnostician** : Bill Quesnel
Test Package : TEST (Additional Tests: DGA)

BRODER ELECTRIC
 14 GRENFELL CRESCENT, SUITE 100
 NEPEAN, ON
 CA K2G 0G2
 Contact: Carly Joudoin
 carly@broderelectric.ca
 T: (613)224-1176
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.