



FUEL REPORT

Sample Rating Trend

NORMAL



Area
[49689]
 Machine Id
GAMDO ATS
 Component
Diesel Fuel
 Fluid
No.2 DIESEL FUEL (LOW-SULPHUR) (--- GAL)



DIAGNOSIS

Recommendation

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. Resample at the next service interval to monitor.

Corrosion

{not applicable}

Contaminants

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. There is no indication of any contamination in the diesel fuel.

Fuel Condition

All laboratory tests indicate that this sample meets specifications for No.2 diesel fuel, low sulfur (US EPA/CGSB-3.517-3 type B).

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	CU0021676	---	---
Sample Date	Client Info	04 Dec 2023	---	---
Machine Age	hrs Client Info	0	---	---
Sample Status		NORMAL	---	---

PHYSICAL PROPERTIES

method	limit/base	current	history1	history2	
Specific Gravity	ASTM D1298*	0.839	0.829	---	---
Fuel Color	text Visual Screen*	Yllow	Red	---	---
Visc @ 40°C	cSt ASTM D7279(m)	3.0	2.1	---	---
Pensky-Martens Flash Point	°C ASTM D7215*	52	49	---	---

SULFUR CONTENT

method	limit/base	current	history1	history2	
Sulfur	ppm ASTM D5185(m)	250	27	---	---

DISTILLATION

method	limit/base	current	history1	history2	
Initial Boiling Point	°C ASTM D2887*	165	154	---	---
5% Distillation Point	°C ASTM D2887*		173	---	---
10% Distill Point	°C ASTM D2887*	201	181	---	---
15% Distillation Point	°C ASTM D2887*		189	---	---
20% Distill Point	°C ASTM D2887*	216	197	---	---
30% Distill Point	°C ASTM D2887*	230	212	---	---
40% Distill Point	°C ASTM D2887*	243	227	---	---
50% Distill Point	°C ASTM D2887*	255	242	---	---
60% Distill Point	°C ASTM D2887*	267	257	---	---
70% Distill Point	°C ASTM D2887*	280	272	---	---
80% Distill Point	°C ASTM D2887*	295	290	---	---
85% Distillation Point	°C ASTM D2887*		303	---	---
90% Distill Point	°C ASTM D2887*	310	316	---	---
95% Distillation Point	°C ASTM D2887*		338	---	---
Final Boiling Point	°C ASTM D2887*	341	363	---	---

IGNITION QUALITY

method	limit/base	current	history1	history2	
API Gravity	ASTM D1298*	37.7	39	---	---
Cetane Index	ASTM D4737*	<40.0	47	---	---

CONTAMINANTS






method	limit/base	current	history1	history2	
Silicon	ppm ASTM D5185(m)	<1.0	2	---	---
Sodium	ppm ASTM D5185(m)	<0.1	0	---	---
Potassium	ppm ASTM D5185(m)	<0.1	<1	---	---
Water	% ASTM D6304*	<0.05	0.002	---	---
ppm Water	ppm ASTM D6304*	<500	18	---	---

FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>2500	536	---	---
Particles >6µm	ASTM D7647	>640	152	---	---
Particles >14µm	ASTM D7647	>80	17	---	---
Particles >21µm	ASTM D7647	>20	6	---	---
Particles >38µm	ASTM D7647	>4	1	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	16/14/11	---	---






FUEL REPORT

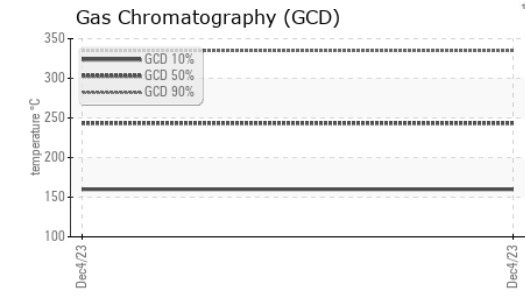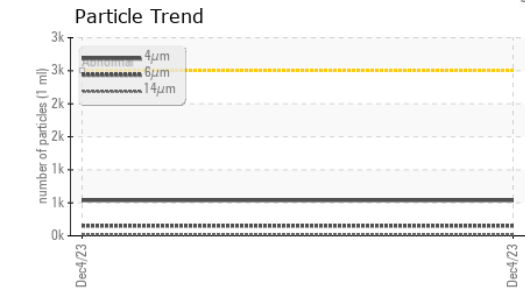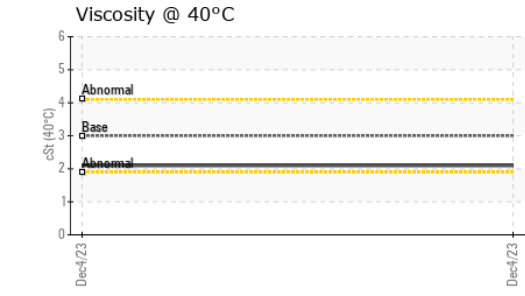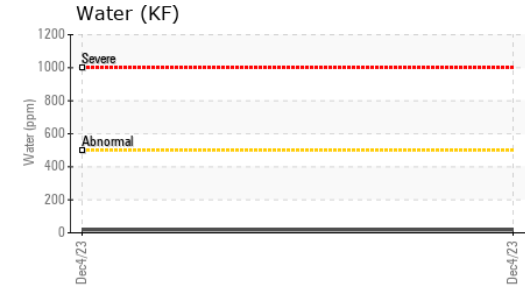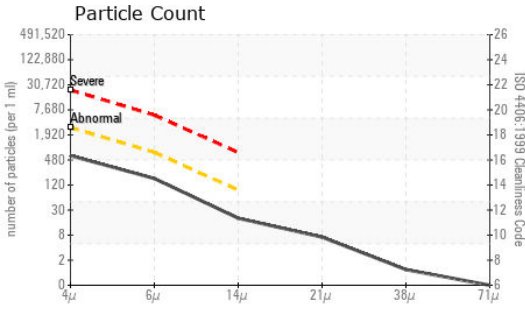

HEAVY METALS	method	limit/base	current	history1	history2	
Aluminum	ppm	ASTM D5185(m)	<0.1	0	---	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	---	---
Lead	ppm	ASTM D5185(m)	<0.1	0	---	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	---	---
Iron	ppm	ASTM D5185(m)	<0.1	<1	---	---
Calcium	ppm	ASTM D5185(m)	<0.1	<1	---	---
Magnesium	ppm	ASTM D5185(m)	<0.1	0	---	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	<1	---	---
Zinc	ppm	ASTM D5185(m)	<0.1	<1	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

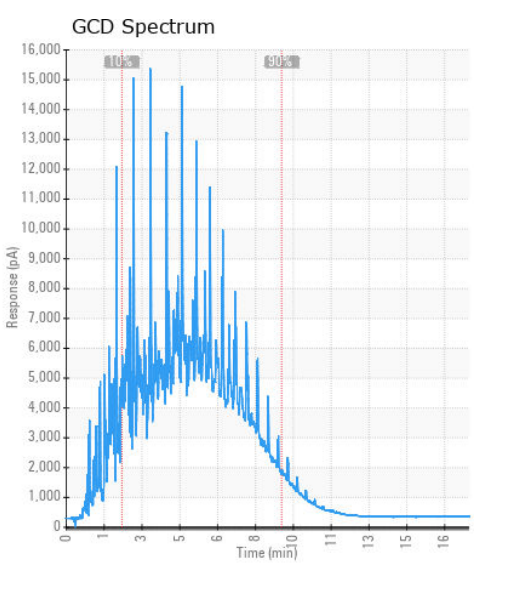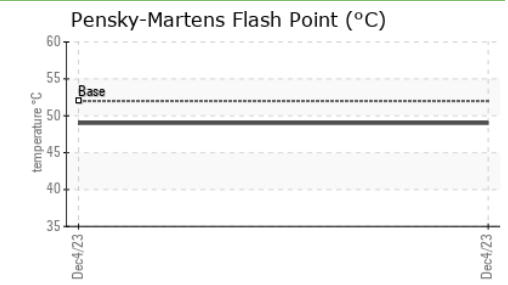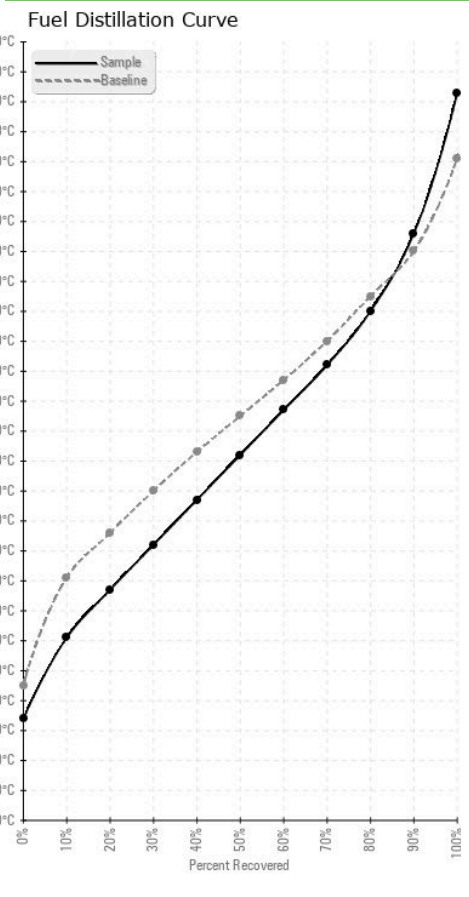

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **CUMMINS EASTERN CANADA INC.**
Sample No. : CU0021676 **Received** : 05 Dec 2023 122 CLYDE AVENUE
Lab Number : 02601070 **Diagnosed** : 07 Dec 2023 MOUNT PEARL, NL
Unique Number : 5694155 **Diagnostician** : Kevin Marson CA A1N 4S3
Test Package : FUEL (Additional Tests: CC Flash, GC-PercFuel, PrtCount) Contact: JUANITA BRANTON
 To discuss this sample report, contact Customer Service at 1-800-268-2131. JUANITA.BRANTON@CUMMINS.COM
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. T: (709)747-0157
 Validity of results and interpretation are based on the sample and information as supplied. F: (709)747-1084