



FUEL REPORT

Sample Rating Trend

ISO



Area
[49687]

Machine Id
CLARKES HEAD ATS

Component
Diesel Fuel

Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)



DIAGNOSIS

Recommendation

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. We advise that you filter this fluid before use. We recommend you service the filters on this component. Resample at the next service interval to monitor.

Corrosion

{not applicable}

Contaminants

There is a light amount of silt (particulates < 14 microns in size) present in the fuel. The water content is negligible.

Fuel Condition

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B).

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	CU0021677	---	---
Sample Date	Client Info	04 Dec 2023	---	---
Machine Age	hrs Client Info	0	---	---
Sample Status		ATTENTION	---	---

PHYSICAL PROPERTIES

method	limit/base	current	history1	history2	
Specific Gravity	ASTM D1298*	0.839	0.846	---	---
Fuel Color	text Visual Screen*	Yllow	Yllow	---	---
Visc @ 40°C	cSt ASTM D7279(m)	3.0	2.1	---	---
Pensky-Martens Flash Point	°C ASTM D7215*	52	58.8	---	---

SULFUR CONTENT

method	limit/base	current	history1	history2	
Sulfur	ppm ASTM D5185(m)	10	15	---	---

DISTILLATION

method	limit/base	current	history1	history2	
Initial Boiling Point	°C ASTM D2887*	165	168	---	---
5% Distillation Point	°C ASTM D2887*		187	---	---
10% Distill Point	°C ASTM D2887*	201	198	---	---
15% Distillation Point	°C ASTM D2887*		206	---	---
20% Distill Point	°C ASTM D2887*	216	214	---	---
30% Distill Point	°C ASTM D2887*	230	228	---	---
40% Distill Point	°C ASTM D2887*	243	241	---	---
50% Distill Point	°C ASTM D2887*	255	253	---	---
60% Distill Point	°C ASTM D2887*	267	265	---	---
70% Distill Point	°C ASTM D2887*	280	276	---	---
80% Distill Point	°C ASTM D2887*	295	288	---	---
85% Distillation Point	°C ASTM D2887*		296	---	---
90% Distill Point	°C ASTM D2887*	310	304	---	---
95% Distillation Point	°C ASTM D2887*		316	---	---
Final Boiling Point	°C ASTM D2887*	341	339	---	---

IGNITION QUALITY

method	limit/base	current	history1	history2	
API Gravity	ASTM D1298*	37.7	35	---	---
Cetane Index	ASTM D4737*	<40.0	44	---	---

CONTAMINANTS






method	limit/base	current	history1	history2	
Silicon	ppm ASTM D5185(m)	<1.0	0	---	---
Sodium	ppm ASTM D5185(m)	<0.1	0	---	---
Potassium	ppm ASTM D5185(m)	<0.1	<1	---	---
Water	% ASTM D6304*	<0.05	0.003	---	---
ppm Water	ppm ASTM D6304*	<500	34	---	---

FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>2500	▲ 3590	---	---
Particles >6µm	ASTM D7647	>640	▲ 737	---	---
Particles >14µm	ASTM D7647	>80	24	---	---
Particles >21µm	ASTM D7647	>20	4	---	---
Particles >38µm	ASTM D7647	>4	0	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	▲ 19/17/12	---	---






FUEL REPORT

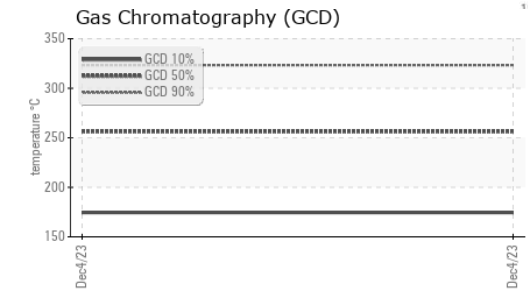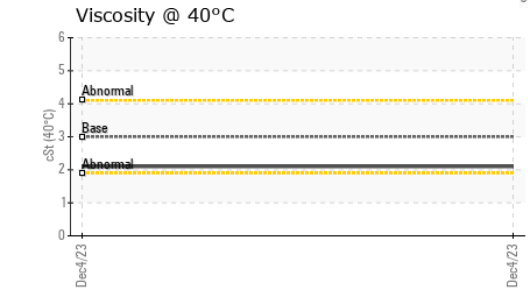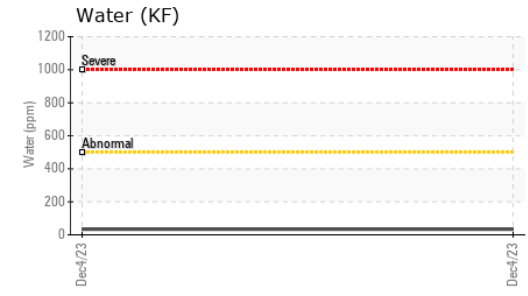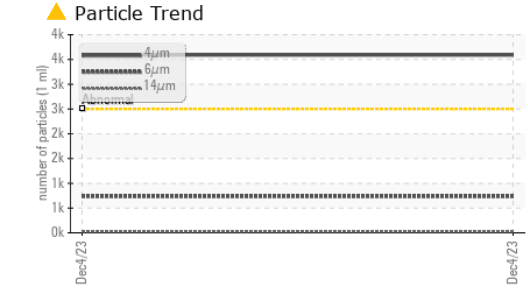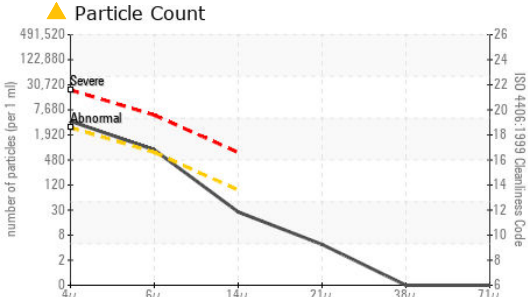

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	0	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	---
Lead	ppm	ASTM D5185(m)	<0.1	0	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	---
Iron	ppm	ASTM D5185(m)	<0.1	<1	---
Calcium	ppm	ASTM D5185(m)	<0.1	0	---
Magnesium	ppm	ASTM D5185(m)	<0.1	0	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	0	---
Zinc	ppm	ASTM D5185(m)	<0.1	0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

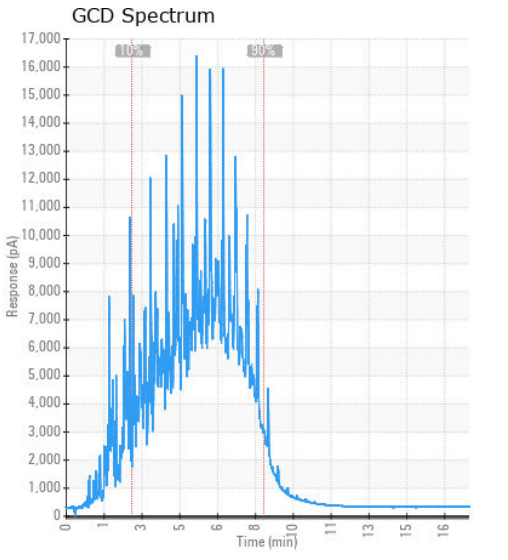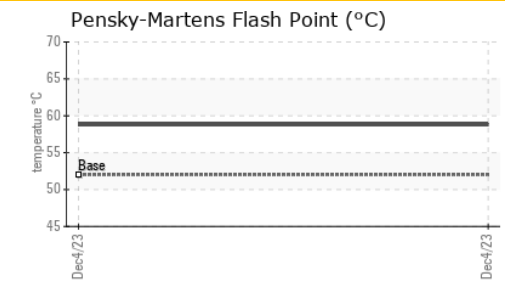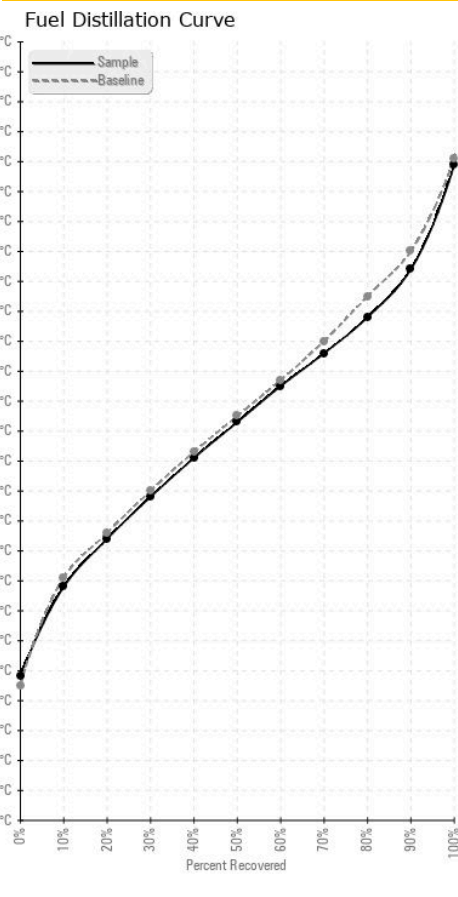

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CU0021677
Lab Number : 02601073
Unique Number : 5694158
Test Package : FUEL (Additional Tests: CC Flash, GC-PercFuel, PrtCount)

CUMMINS EASTERN CANADA INC.
 122 CLYDE AVENUE
 MOUNT PEARL, NL
 CA A1N 4S3
 Contact: JUANITA BRANTON
 JUANITA.BRANTON@CUMMINS.COM
 T: (709)747-0157
 F: (709)747-1084

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.