




# OIL ANALYSIS REPORT

Sample Rating Trend

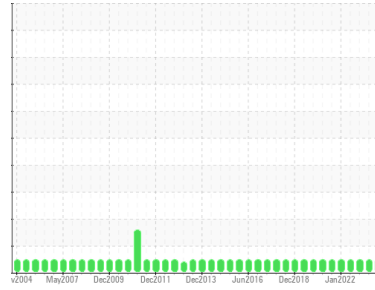

**NORMAL**



Machine Id  
**LBK G3 GOV**

Component  
**Governor System**

Fluid  
**ESSO TERESSO ISO 68 (100 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0706110</b>	WC0706101	WC0455702
Sample Date	Client Info			<b>22 Nov 2023</b>	26 Oct 2023	26 Apr 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	Not Chngd	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	NEG






WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		<b>0</b>	0	0
Iron	ppm	ASTM D5185(m)	>50	<b>&lt;1</b>	0	<1
Chromium	ppm	ASTM D5185(m)	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>10	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	0
Aluminum	ppm	ASTM D5185(m)	>3	<b>0</b>	<1	0
Lead	ppm	ASTM D5185(m)	>75	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185(m)	>15	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185(m)	>55	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	>5	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	4.5	<b>&lt;1</b>	<1	<1
Barium	ppm	ASTM D5185(m)	0.4	<b>&lt;1</b>	<1	0
Molybdenum	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185(m)	0	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185(m)	0.7	<b>5</b>	8	4
Zinc	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	<1	<1
Sulfur	ppm	ASTM D5185(m)	1315	<b>1728</b>	1722	1771
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>8	<b>0</b>	0	0
Sodium	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0



# OIL ANALYSIS REPORT

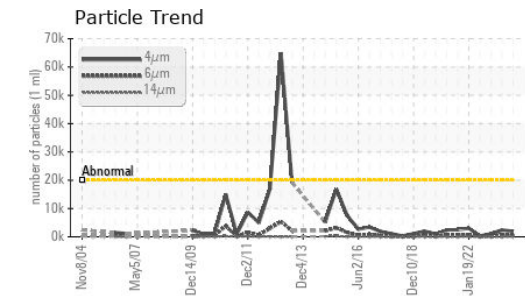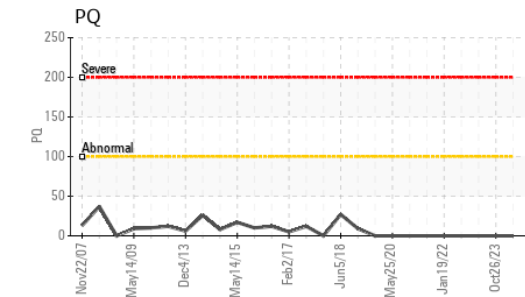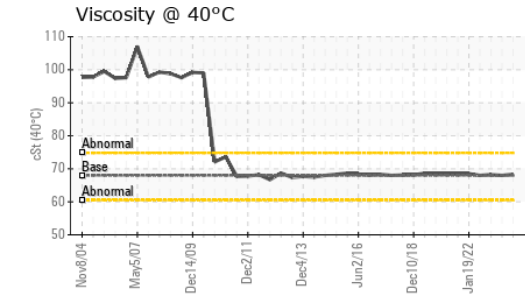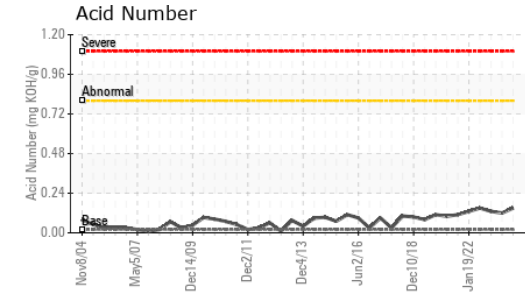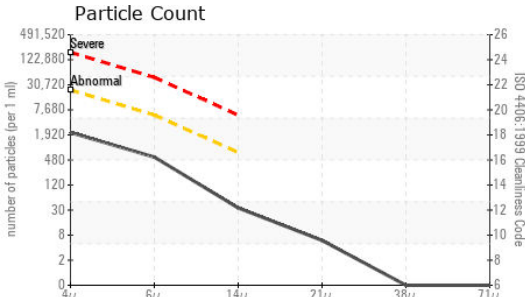

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0706110 **Received** : 07 Dec 2023  
**Lab Number** : 02601539 **Diagnosed** : 09 Dec 2023  
**Unique Number** : 5694624 **Diagnostician** : Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: PQ, PrtCount, TAN Man )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>1918</b>	2417	1090
Particles >6µm	ASTM D7647	>5000	<b>495</b>	631	237
Particles >14µm	ASTM D7647	>640	<b>30</b>	32	18
Particles >21µm	ASTM D7647	>160	<b>5</b>	6	6
Particles >38µm	ASTM D7647	>40	<b>0</b>	1	0
Particles >71µm	ASTM D7647	>10	<b>0</b>	1	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>18/16/12</b>	18/16/12	17/15/11


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974*	0.02	<b>0.15</b>	0.12	0.13

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar Visual*	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	68	<b>68.3</b>	68.0	68.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color



Bottom



**NEWFOUNDLAND POWER INC.**  
 50 DUFFY PLACE, PO BOX 8910  
 ST. JOHNS, NL  
 CA A1B 3P6  
 Contact: Paul Martin  
 pmartin@newfoundlandpower.com  
 T:  
 F: (709)737-2926