




# PROBLEM SUMMARY


Area  
**Water Injection**  
 Machine Id  
**V684225 POOL 1 WATER INJECTION PUMP SKID #2**  
 Component  
**Lube System**  
 Fluid  
**MOBIL DTE OIL LIGHT (--- LTR)**

Sample Rating Trend

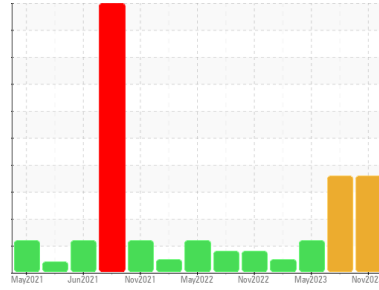

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

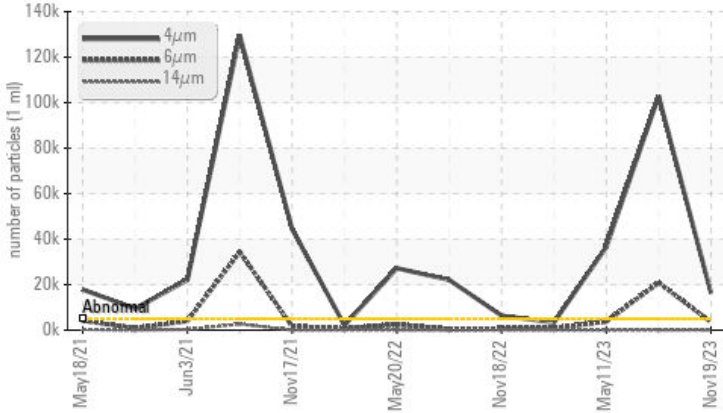

## RECOMMENDATION

We advise that you check for the source of water entry. Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you use off-line filtration with water adsorbent filters to attempt to remove the water from this oil. We advise that you follow the water drain-off procedure for this component. We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

## PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	SEVERE	ABNORMAL
Particles >4µm	ASTM D7647	>5000	▲ 16343	102821	▲ 36550	
Particles >6µm	ASTM D7647	>1300	▲ 3543	20876	▲ 3814	
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 21/19/13	24/22/14	▲ 22/19/11	
Appearance	scalar Visual*	NORML	▲ WGOIL	NORML	NORML	
Free Water	scalar Visual*		▲ 5%	NEG	NEG	

Customer Id: EXXSTJ  
 Sample No.: PP13931249  
 Lab Number: 02601547  
 Test Package: MAR 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Kevin Marson +1 (289)291-4644 x4644  
[Kevin.Marson@wearcheck.com](mailto:Kevin.Marson@wearcheck.com)

To change component or sample information:  
 Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Water Drain-off	---	---	?	We advise that you follow the water drain-off procedure for this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Water Access	---	---	?	We advise that you check for the source of water entry.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.
Filter Fluid	---	---	?	We advise that you use off-line filtration with water adsorbent filters to attempt to remove the water from this oil.

## HISTORICAL DIAGNOSIS

### 14 Oct 2023 Diag: Wes Davis

ISO



Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



### 11 May 2023 Diag: Wes Davis

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



### 18 Feb 2023 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

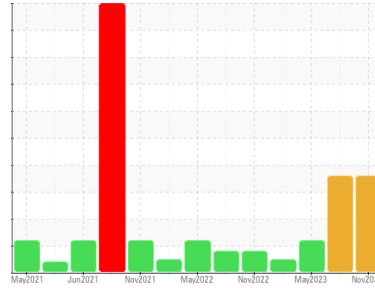

**WATER**



Area  
**Water Injection**  
 Machine Id  
**V684225 POOL 1 WATER INJECTION PUMP SKID #2**  
 Component  
**Lube System**  
 Fluid  
**MOBIL DTE OIL LIGHT (--- LTR)**

## DIAGNOSIS

### ▲ Recommendation

We advise that you check for the source of water entry. Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you use off-line filtration with water adsorbent filters to attempt to remove the water from this oil. We advise that you follow the water drain-off procedure for this component. We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. Free water present.

### Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PP13931249</b>	PP13915533	PP13807971
Sample Date	Client Info	<b>19 Nov 2023</b>	14 Oct 2023	11 May 2023
Machine Age	hrs	<b>0</b>	0	0
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	SEVERE	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m) >20	<1	<1	<1
Chromium	ppm	ASTM D5185(m) >10	0	0	0
Nickel	ppm	ASTM D5185(m) >10	<1	<1	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	<1	<1	0
Aluminum	ppm	ASTM D5185(m) >10	0	0	0
Lead	ppm	ASTM D5185(m) >20	<1	<1	<1
Copper	ppm	ASTM D5185(m) >20	3	2	2
Tin	ppm	ASTM D5185(m) >10	0	0	0
Antimony	ppm	ASTM D5185(m)	0	0	<1
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	<1	<1	0
Barium	ppm	ASTM D5185(m)	0	<1	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	2	5	5
Calcium	ppm	ASTM D5185(m)	2	1	0
Phosphorus	ppm	ASTM D5185(m)	101	97	108
Zinc	ppm	ASTM D5185(m)	29	30	24
Sulfur	ppm	ASTM D5185(m)	631	621	623
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m) >15	4	0	0
Sodium	ppm	ASTM D5185(m)	3	14	3
Potassium	ppm	ASTM D5185(m) >20	0	<1	<1
Water	%	ASTM D6304* >0.05	<b>0.051</b>	---	---
ppm Water	ppm	ASTM D6304* >500	<b>510</b>	---	---


## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	▲ <b>16343</b>	● 102821	▲ 36550
Particles >6µm	ASTM D7647 >1300	▲ <b>3543</b>	● 20876	▲ 3814
Particles >14µm	ASTM D7647 >160	<b>76</b>	100	17
Particles >21µm	ASTM D7647 >40	<b>8</b>	24	2
Particles >38µm	ASTM D7647 >10	<b>1</b>	2	0
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >19/17/14	▲ <b>21/19/13</b>	● 24/22/14	▲ 22/19/11




# OIL ANALYSIS REPORT


## Particle Trend

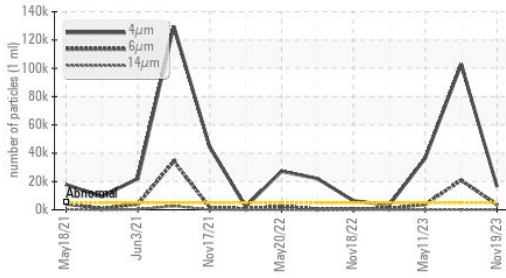


## Water (KF)

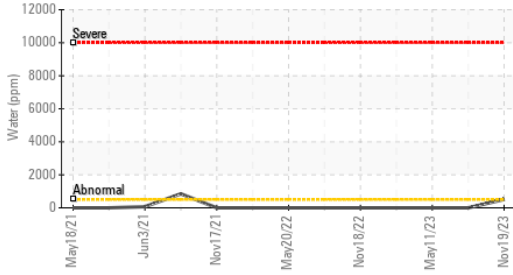


## Acid Number

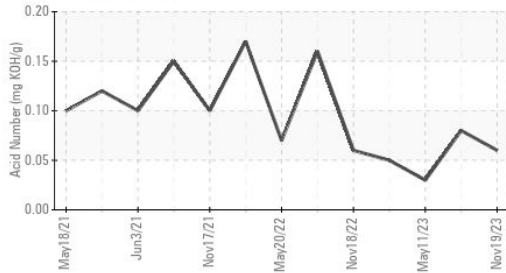

## Water (KF)

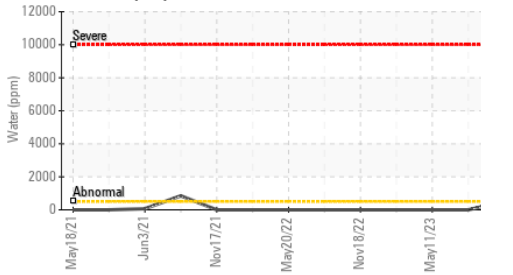

## Viscosity @ 40°C

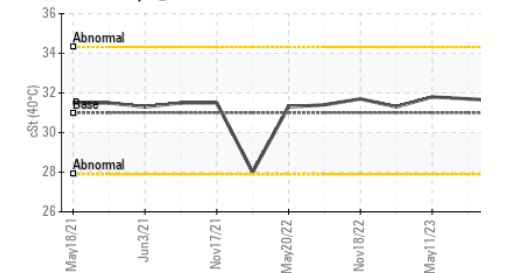


## FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN) mg KOH/g	ASTM D974*	<b>0.06</b>	0.08	0.03		
VISUAL						
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>▲ WGOIL</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	<b>.2%</b>	NEG	NEG
Free Water	scalar	Visual*		<b>▲ 5%</b>	NEG	NEG

## FLUID PROPERTIES


method	limit/base	current	history1	history2
Visc @ 40°C cSt	ASTM D7279(m)	<b>31.6</b>	31.7	31.8

## SAMPLE IMAGES

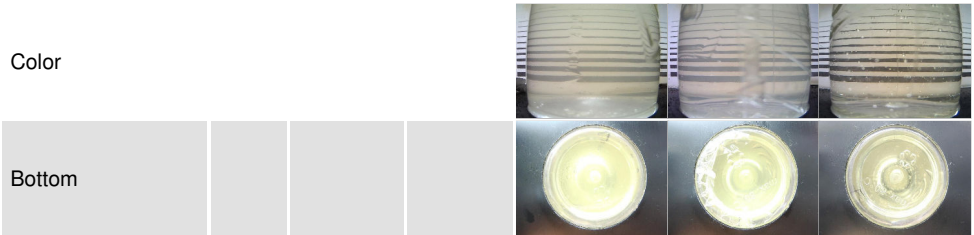


## GRAPHS


### Ferrous Alloys

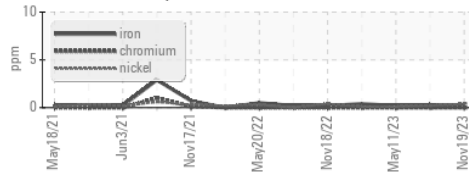


### Non-ferrous Metals

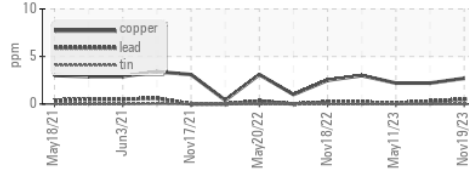


### Viscosity @ 40°C

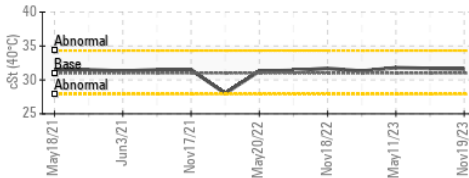

### Particle Count

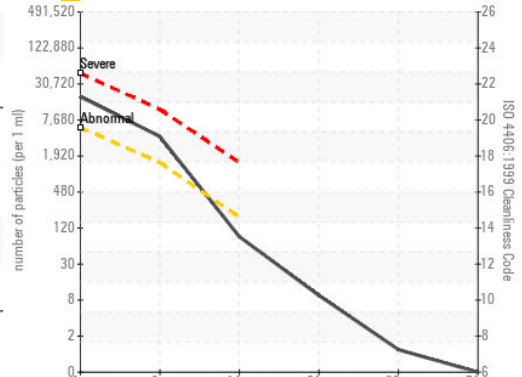

### Acid Number

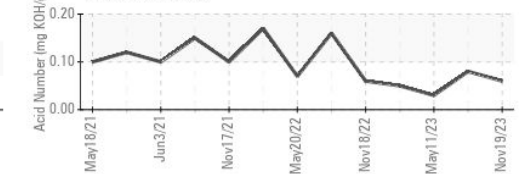

ISO 17025:2017  
Accredited  
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
Sample No. : PP13931249  
Lab Number : **02601547**  
Unique Number : 5694632  
Test Package : MAR 2 ( Additional Tests: KF, TAN Man )

Received : 07 Dec 2023  
Diagnosed : 11 Dec 2023  
Diagnostician : Kevin Marson

**ExxonMobil Canada East Ltd.**

Hebron-Materials and Repair Coordin, Suite 1000, 100 New Gow  
St. John's, NL  
CA A1C 6K3

Contact: Liam Maher  
liam.m.maher@exxonmobil.com

T: (709)273-3729

F: