

COOLANT REPORT

#1706 - PRIMORD PUMP STATION

Component

Coolant

EXTENDED LIFE COOLANT (--- GAL)

Sample Rating Trend **NORMAL**

Recommendation

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) EXTENDED LIFE COOLANT. Please confirm.

Corrosion

All component wear rates are normal.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition


The condition of the coolant is acceptable for the time in service.

				Nov2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0883527		
Sample Date		Client Info		20 Nov 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
PHYSICAL TEST F	RESULTS	method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*		1.067		
pH	Scale 0-14	ASTM D1287*	9.0	7.95		
Nitrites	ppm	Alcan Test Kit*		880		
Reserve Alkalinity	Scale 0-20	ASTM D1121*		3.2		
Percentage Glycol	%	ASTM D3321*	50	49.9		
Freezing Point	°C	ASTM D3321*	-40	-33		
Carboxylate						
CORROSION INH	IBITORS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)		28		
Phosphorus	ppm	ASTM D5185(m)		58		
Boron	ppm	ASTM D5185(m)		92		
Molybdenum	ppm	ASTM D5185(m)		263		
CORROSION		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>15	0		
Aluminum	ppm	ASTM D5185(m)	>10	3		
Copper	ppm	ASTM D5185(m)	>10	3		
Lead	ppm	ASTM D5185(m)	>10	0		
Tin	ppm	ASTM D5185(m)	>10	0		
Silver	ppm	ASTM D5185(m)	>10	<1		
Zinc	ppm	ASTM D5185(m)		0		
CARRIER SALTS	3	method	limit/base	current	history1	history2
Sodium	ppm	ASTM D5185(m)		1652		
Potassium	ppm	ASTM D5185(m)		8801		
			12 - 25 //		12.4	history2
SCALE POTENTI	IAL	method	limit/base	current	history1	nistory2
Calcium	ppm	ASTM D5185(m)	>100	2		
Magnesium	ppm	ASTM D5185(m)	>40	0		
Hardness	mg/L CaCO3	In-house*	<75	3		
VISUAL		method	limit/base	current	history1	history2
Coolant Color		Visual*	Orange/R	Red		
Coolant Appearance		Visual*	Clear	Clear		
Color					no image	no image
Bottom					no image	no image

Contact/Location: Ken Olesen - LIGAMH



COOLANT REPORT

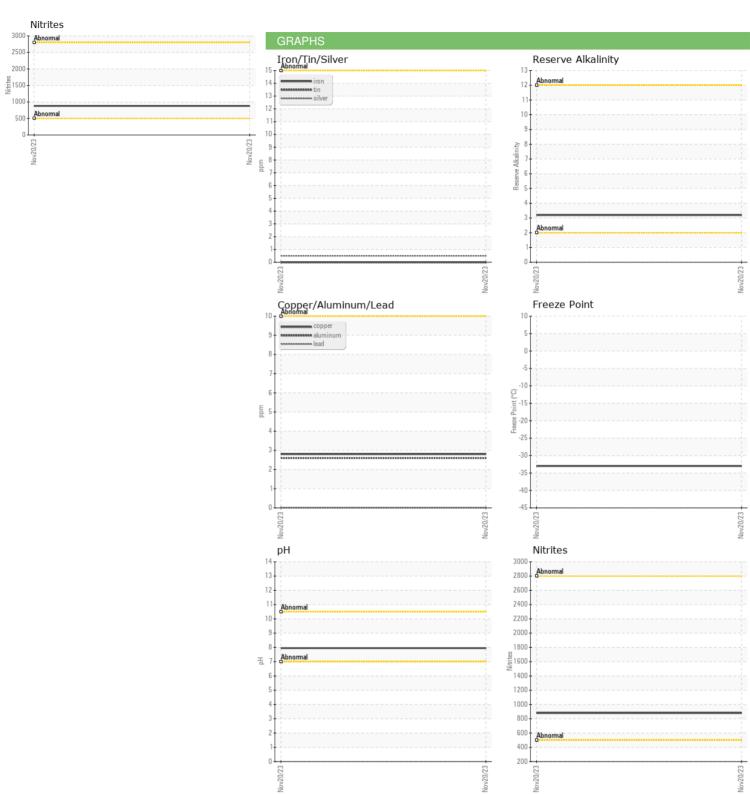



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No. Lab Number Unique Number : 5694793 Test Package : COOL

: WC0883527 : 02601708

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Received

: 07 Dec 2023 Diagnosed : 08 Dec 2023

Diagnostician : Wes Davis

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

Lighthouse Electric 6714 6th Conc South Amherstburg, ON CA N9V 0C8 Contact: Ken Olesen kolesen.lighthouse@gmail.com

> T: (519)730-1310 F: (519)730-1310