




FUEL REPORT

Sample Rating Trend

NORMAL



Area
[123965106]
 Machine Id
C-FTXF
 Component
Jet Fuel
 Fluid
JET FUEL Type A (--- GAL)

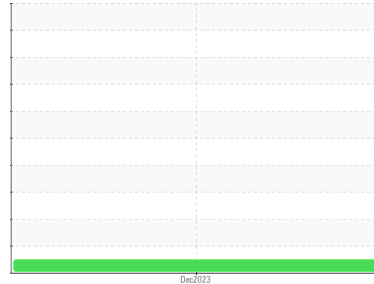

DIAGNOSIS

Recommendation

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. Resample at the next service interval to monitor.

Wear

{not applicable}

Contamination

There is no bacteria or fungus (yeast and/or mold) present in the sample. The water content is negligible. The fuel phase was tested for microbes, as there was no separate water phase present in the sample. The MicrobMonitor2 test kit was used to test for microbiological contamination in the sample. There is no indication of any contamination in the jet fuel.

Fluid Condition

All laboratory tests indicate that this sample appears to be Jet Fuel Type A.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0872240	---	---
Sample Date	Client Info	06 Dec 2023	---	---
Machine Age	hrs Client Info	0	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		NORMAL	---	---

PHYSICAL PROPERTIES

method	limit/base	current	history1	history2
Specific Gravity	ASTM D1298*	0.812	---	---
Fuel Color	text Visual Screen*	Clear	---	---
Visc @ 40°C	cSt ASTM D7279(m)	1.4	---	---
Pensky-Martens Flash Point	°C ASTM D7215*	53.9	---	---
Pour Point	°C ASTM D97*	-63	---	---

SULFUR CONTENT

method	limit/base	current	history1	history2
Sulfur	ppm ASTM D5185(m)	533	---	---

DISTILLATION

method	limit/base	current	history1	history2
Initial Boiling Point	°C ASTM D2887*	162	---	---
5% Distillation Point	°C ASTM D2887*	178	---	---
10% Distill Point	°C ASTM D2887*	182	---	---
15% Distillation Point	°C ASTM D2887*	186	---	---
20% Distill Point	°C ASTM D2887*	191	---	---
30% Distill Point	°C ASTM D2887*	198	---	---
40% Distill Point	°C ASTM D2887*	205	---	---
50% Distill Point	°C ASTM D2887*	213	---	---
60% Distill Point	°C ASTM D2887*	221	---	---
70% Distill Point	°C ASTM D2887*	228	---	---
80% Distill Point	°C ASTM D2887*	239	---	---
85% Distillation Point	°C ASTM D2887*	247	---	---
90% Distill Point	°C ASTM D2887*	256	---	---
95% Distillation Point	°C ASTM D2887*	269	---	---
Final Boiling Point	°C ASTM D2887*	287	---	---

IGNITION QUALITY

method	limit/base	current	history1	history2
API Gravity	ASTM D1298*	42	---	---
Cetane Index	ASTM D4737*	46	---	---

CONTAMINANTS


method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m)	0	---	---
Sodium	ppm ASTM D5185(m)	0	---	---
Potassium	ppm ASTM D5185(m)	<1	---	---
Water	% ASTM D6304*	0.002	---	---
ppm Water	ppm ASTM D6304*	21	---	---

MICROBIAL


method	limit/base	current	history1	history2
Microbes	CFU/L ASTM D6469*	0	---	---




FUEL REPORT

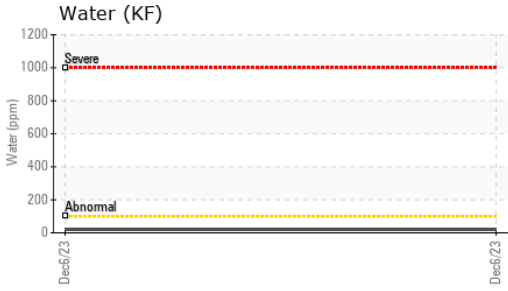





HEAVY METALS	method	limit/base	current	history1	history2	
Aluminum	ppm	ASTM D5185(m)	<0.1	0	---	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	---	---
Lead	ppm	ASTM D5185(m)	<0.1	0	---	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	---	---
Iron	ppm	ASTM D5185(m)	<0.1	<1	---	---
Calcium	ppm	ASTM D5185(m)	<0.1	0	---	---
Magnesium	ppm	ASTM D5185(m)	<0.1	0	---	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	<1	---	---
Zinc	ppm	ASTM D5185(m)	<0.1	0	---	---

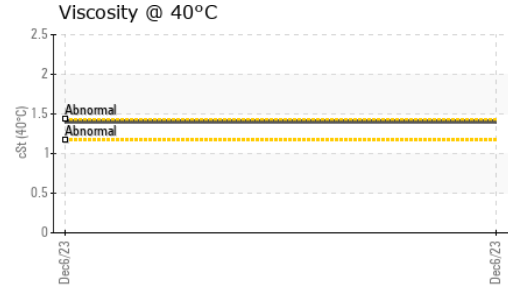

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

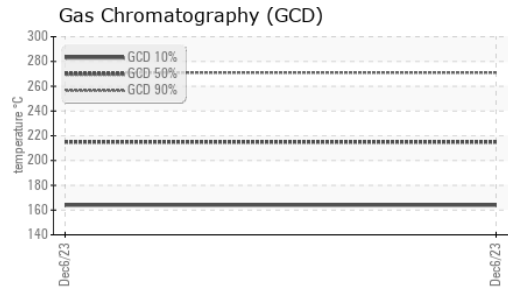

GRAPHS

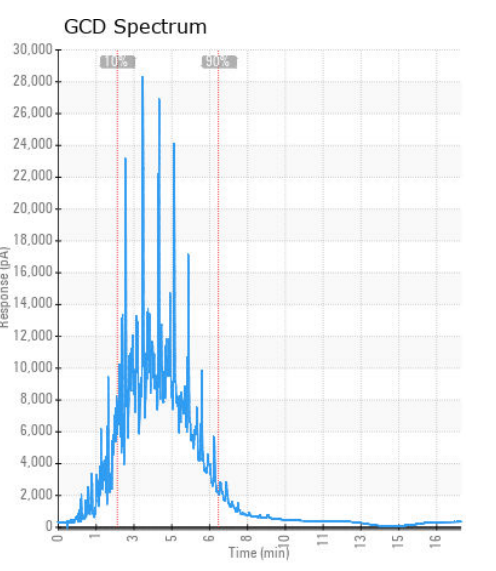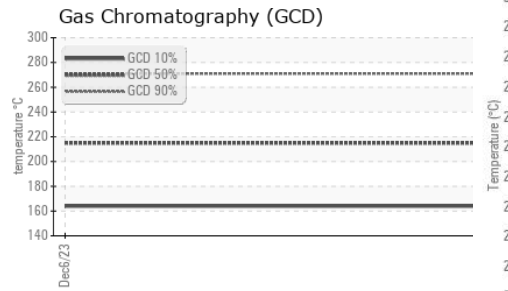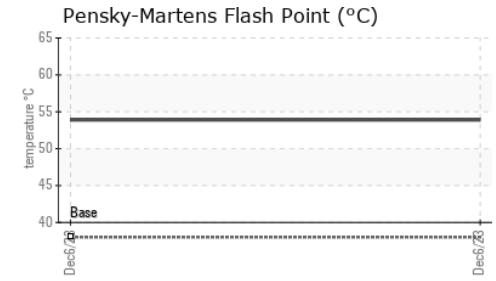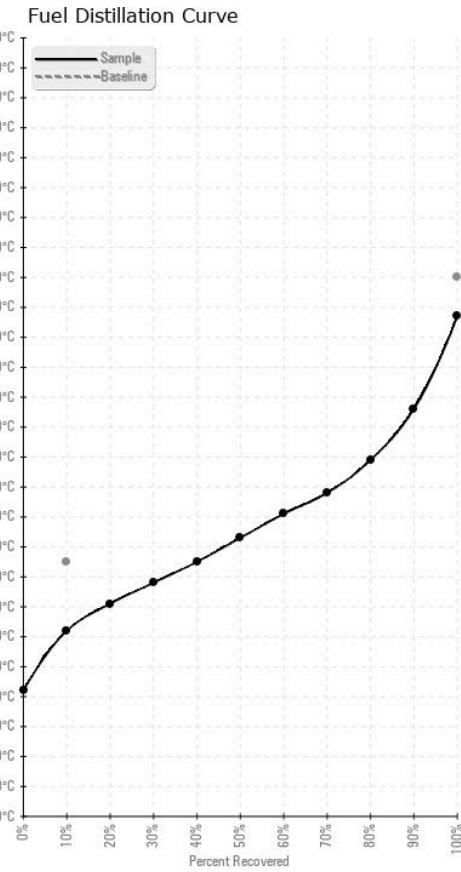

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0872240 **Received** : 07 Dec 2023
Lab Number : 02601730 **Diagnosed** : 12 Dec 2023
Unique Number : 5694815 **Diagnostician** : Kevin Marson
Test Package : FUEL (Additional Tests: CC Flash, GC-PercFuel)

SUNWING AIRLINES
 44 FASKEN DRIVE, UNIT 12/13
 ETOBICOKE, ON
 CA M9W 5M8
 Contact: Geoff Carroll
 gcarroll@flysunwing.com
 T: (416)802-9643
 F: (416)640-1595

*To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.*