


OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

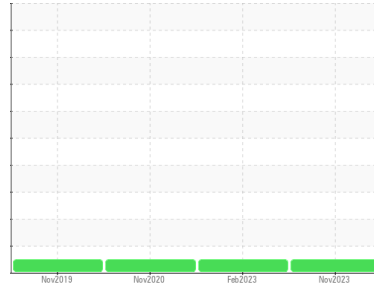

Area
TOWN OF DIEPPE [6100214117]
Machine Id
ECAXB068GDB
Component
Diesel Engine
Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

Metal levels are typical for a new component breaking in.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WA0019600	WA0019133	WA0015695
Sample Date	Client Info			16 Nov 2023	22 Feb 2023	06 Nov 2020
Machine Age	hrs	Client Info		284	263	204
Oil Age	hrs	Client Info		20	49	20
Oil Changed	Client Info			Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<1.0	<1.0	<1.0
Water	WC Method	>0.2		NEG	NEG	NEG


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>100	5	7	8
Chromium	ppm	ASTM D5185(m)	>20	0	0	<1
Nickel	ppm	ASTM D5185(m)	>2	<1	0	0
Titanium	ppm	ASTM D5185(m)	>2	0	<1	0
Silver	ppm	ASTM D5185(m)	>2	<1	0	0
Aluminum	ppm	ASTM D5185(m)	>25	<1	<1	1
Lead	ppm	ASTM D5185(m)	>40	<1	0	0
Copper	ppm	ASTM D5185(m)	>330	1	1	2
Tin	ppm	ASTM D5185(m)	>15	0	0	<1
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	250	5	7	103
Barium	ppm	ASTM D5185(m)	10	<1	0	<1
Molybdenum	ppm	ASTM D5185(m)	100	49	12	41
Manganese	ppm	ASTM D5185(m)		0	<1	<1
Magnesium	ppm	ASTM D5185(m)	450	795	184	445
Calcium	ppm	ASTM D5185(m)	3000	1259	2164	1289
Phosphorus	ppm	ASTM D5185(m)	1150	933	936	712
Zinc	ppm	ASTM D5185(m)	1350	1084	980	812
Sulfur	ppm	ASTM D5185(m)	4250	2594	2927	2619
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	6	8	9
Sodium	ppm	ASTM D5185(m)	>158	2	2	2
Potassium	ppm	ASTM D5185(m)	>20	15	<1	1
Glycol	%	ASTM D7922*		0.0	NEG	NEG

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	5.1	6.1	5.3
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.9	18.2	15.0

OIL ANALYSIS REPORT









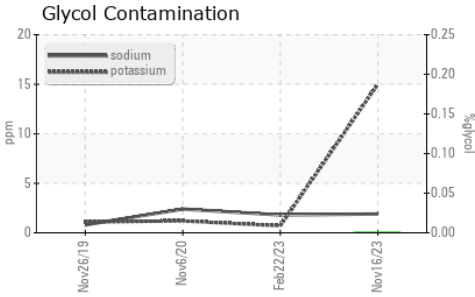


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	12.9	10.3	8.5

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	14.5	13.8	9.8

GRAPHS

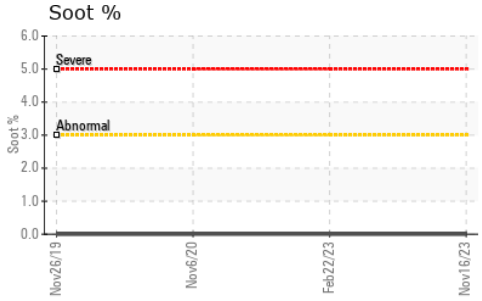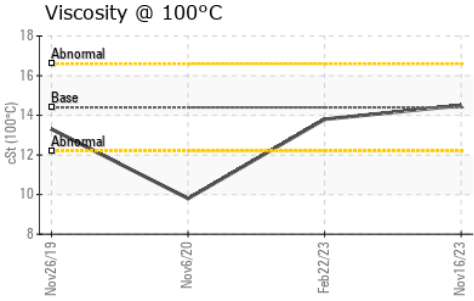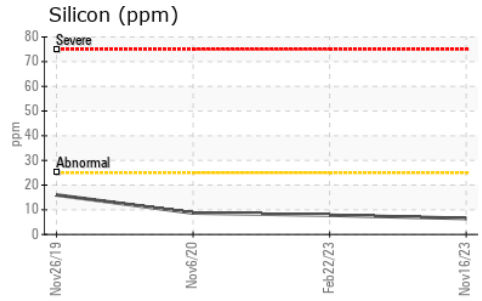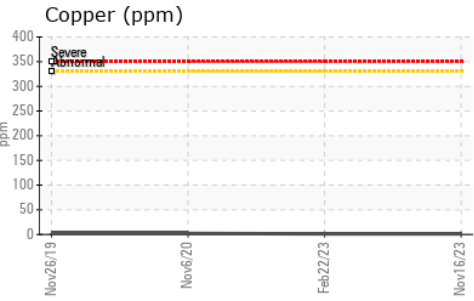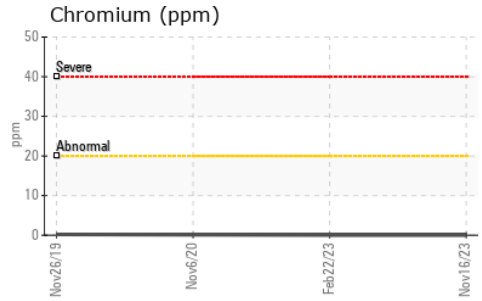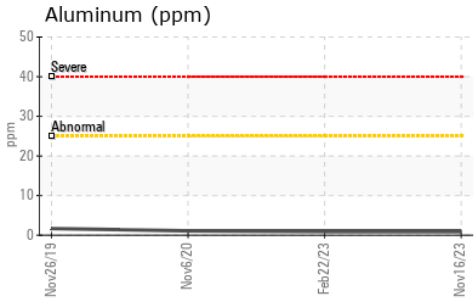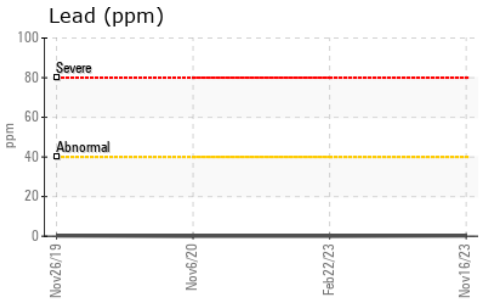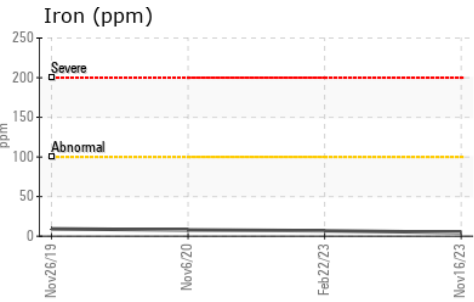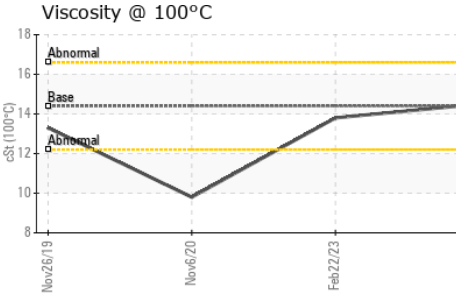

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0019600 **Received** : 08 Dec 2023
Lab Number : **02601764** **Diagnosed** : 09 Dec 2023
Unique Number : 5694849 **Diagnostician** : Wes Davis
Test Package : MOB 1 (Additional Tests: Glycol)

Wajax Power Systems
 485 VENTURE DR
 MONCTON, NB
 CA E1H 2P4
 Contact: Doug Balsler
 dbalsler@wajax.com
 T: (506)855-5371
 F: (506)870-4448

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.