




# OIL ANALYSIS REPORT

Sample Rating Trend

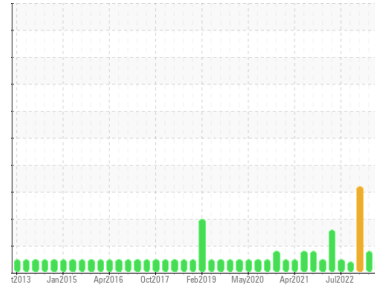

**NORMAL**



Area

**8**

Machine Id

**8-301-MB FM#1 Trunion - Feed End**

Component

**Drive End Journal Bearing**

Fluid

**MOBIL MOBILGEAR SHC 460 (350 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0869928</b>	WC0842767	WC0818199
Sample Date	Client Info		<b>29 Nov 2023</b>	14 Sep 2023	17 May 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	ABNORMAL	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>2	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >60	<b>49</b>	▲ 89	▲ 85
Chromium	ppm	ASTM D5185(m) >20	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	<1
Silver	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185(m) >4	<b>2</b>	2	▲ 6
Lead	ppm	ASTM D5185(m) >250	<b>3</b>	4	6
Copper	ppm	ASTM D5185(m) >125	<b>5</b>	5	9
Tin	ppm	ASTM D5185(m) >80	<b>50</b>	56	▲ 84
Antimony	ppm	ASTM D5185(m)	<b>6</b>	7	10
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 5.7	<b>16</b>	15	8
Barium	ppm	ASTM D5185(m) 0.0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m) 0.0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m) 0.0	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185(m) 0.0	<b>1</b>	2	4
Calcium	ppm	ASTM D5185(m) 0.0	<b>41</b>	39	116
Phosphorus	ppm	ASTM D5185(m) 180	<b>370</b>	425	395
Zinc	ppm	ASTM D5185(m) 0.8	<b>&lt;1</b>	2	2
Sulfur	ppm	ASTM D5185(m) 4270	<b>4416</b>	4693	4836
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1


## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >50	<b>9</b>	9	19
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	1
Potassium	ppm	ASTM D5185(m) >20	<b>2</b>	2	7


## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>177031</b>	195136	582727
Particles >6µm	ASTM D7647	>320000	<b>142602</b>	155097	▲ 424748
Particles >14µm	ASTM D7647	>160000	<b>25919</b>	27296	27955
Particles >21µm	ASTM D7647	>40000	<b>2178</b>	2661	878
Particles >38µm	ASTM D7647	>10000	<b>8</b>	2	1
Particles >71µm	ASTM D7647	>2500	<b>5</b>	1	0
Oil Cleanliness	ISO 4406 (c)	>--/25/24	<b>25/24/22</b>	25/24/22	▲ 26/26/22


### Particle Trend

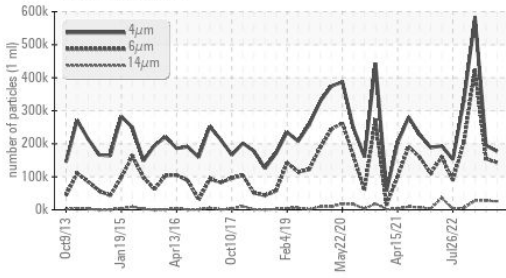


### Acid Number

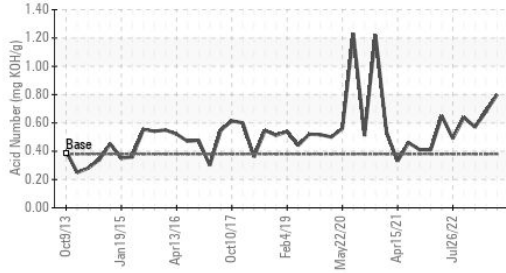

### Viscosity @ 40°C

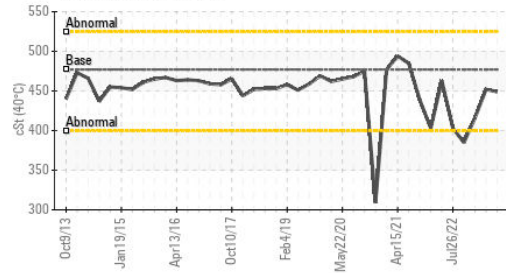

### Particle Trend

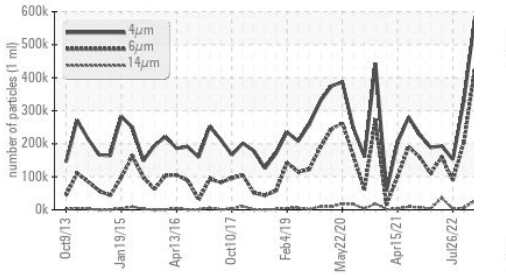


### FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN) mg KOH/g	ASTM D974*	0.38	<b>0.80</b>	0.68	0.57	
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	VLITE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>2	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

### FLUID PROPERTIES


method	limit/base	current	history1	history2		
Visc @ 40°C	cSt	ASTM D7279(m)	477	<b>449</b>	452	416

### SAMPLE IMAGES

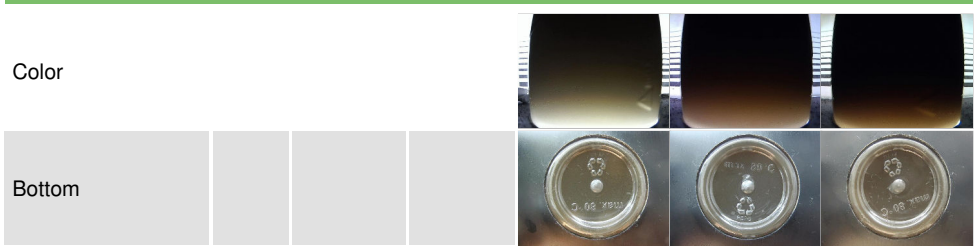


### GRAPHS


#### Ferrous Alloys

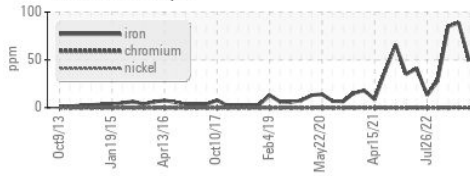


#### Non-ferrous Metals

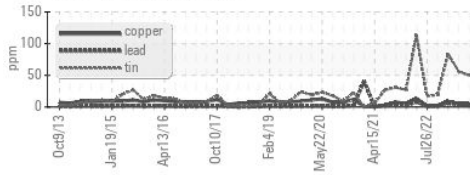


#### Viscosity @ 40°C

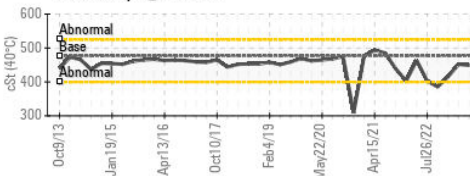

#### Particle Count

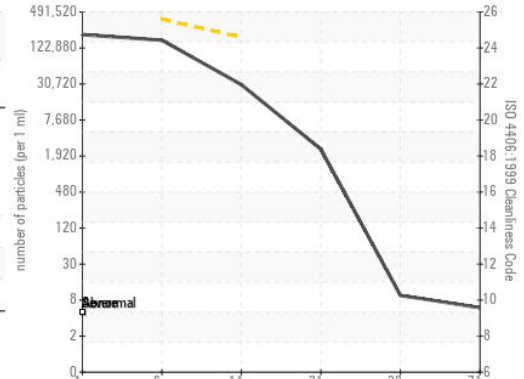

#### Acid Number

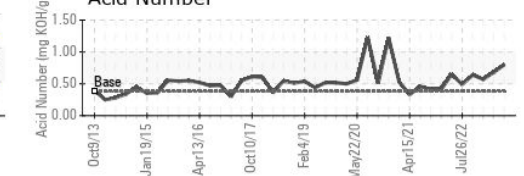

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0869928  
**Lab Number** : 02602018  
**Unique Number** : 5695103  
**Test Package** : IND 2 ( Additional Tests: TAN Man )

**Received** : 08 Dec 2023  
**Diagnosed** : 11 Dec 2023  
**Diagnostician** : Kevin Marson

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**ST. MARYS CEMENT CO.**  
 400 BOWMANVILLE AVENUE  
 BOWMANVILLE, ON  
 CA L1C 7B5  
 Contact: Lou Traiforos  
 lou.traiforos@vcimentos.com  
 T: (905)440-5874  
 F: (905)623-4695