




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

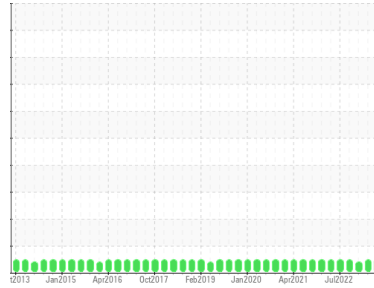

Area

7

Machine Id

7-3-110 Aumund Conveyor from Kiln Cooler

Component

Conveyor

Fluid

MOBIL SHC 630 (150 LTR)

DIAGNOSIS

Recommendation

Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. The fluid was specified as MOBIL SHC 630, however, a fluid match indicates that this fluid is ISO 320 Synthetic (PAO) Gear Oil. Please confirm the oil type and grade on your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

Viscosity of sample indicates oil is within ISO 320 range, advise investigate. This plus the additive levels indicates that this is not the same brand, or type of oil as reported. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0869907	WC0842739	WC0818179
Sample Date	Client Info			22 Nov 2023	05 Sep 2023	16 May 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		0	0	0
Iron	ppm	ASTM D5185(m)	>150	10	8	6
Chromium	ppm	ASTM D5185(m)	>10	0	<1	0
Nickel	ppm	ASTM D5185(m)	>10	<1	<1	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		<1	0	0
Aluminum	ppm	ASTM D5185(m)	>25	<1	0	<1
Lead	ppm	ASTM D5185(m)	>100	0	0	0
Copper	ppm	ASTM D5185(m)	>50	<1	0	0
Tin	ppm	ASTM D5185(m)	>10	0	0	0
Antimony	ppm	ASTM D5185(m)	>5	0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0.3	27	11	31
Barium	ppm	ASTM D5185(m)	0.0	<1	0	0
Molybdenum	ppm	ASTM D5185(m)	0.0	0	0	0
Manganese	ppm	ASTM D5185(m)	0.0	0	0	0
Magnesium	ppm	ASTM D5185(m)	0.1	0	0	0
Calcium	ppm	ASTM D5185(m)	0.0	<1	<1	0
Phosphorus	ppm	ASTM D5185(m)	864	398	441	464
Zinc	ppm	ASTM D5185(m)	2.0	2	4	2
Sulfur	ppm	ASTM D5185(m)	36	4937	5084	5177
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>50	3	4	3
Sodium	ppm	ASTM D5185(m)		2	2	1
Potassium	ppm	ASTM D5185(m)	>20	0	0	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.45	0.94	1.02	0.84




OIL ANALYSIS REPORT

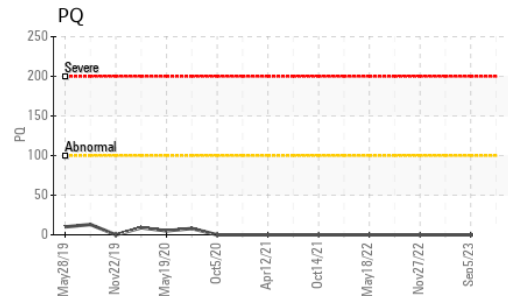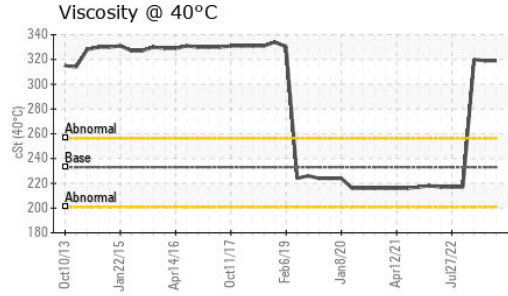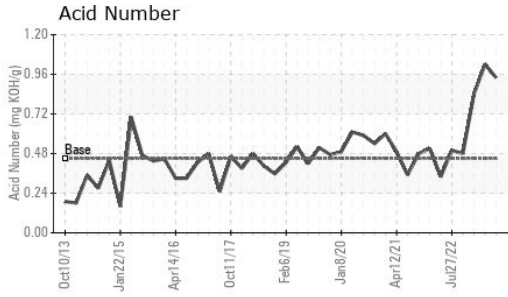






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	233	319	▲ 320

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

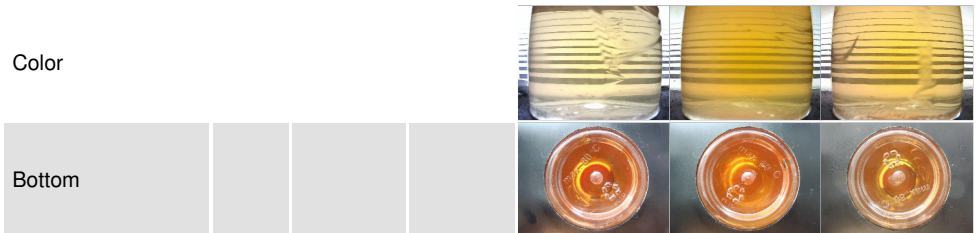

GRAPHS

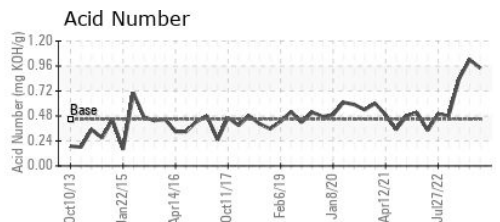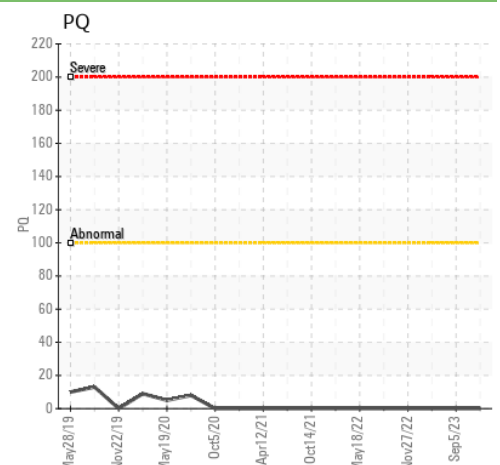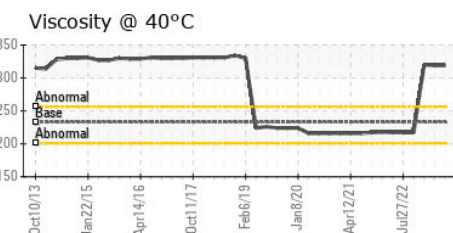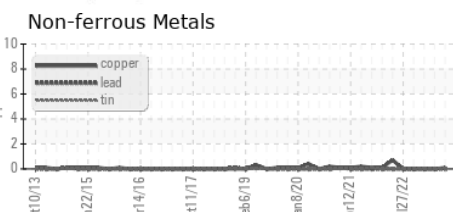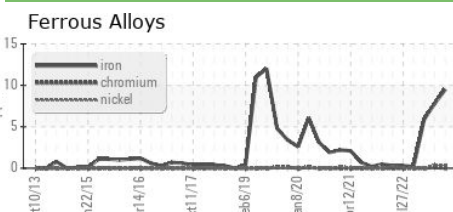

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0869907 **Received** : 08 Dec 2023
Lab Number : 02602019 **Diagnosed** : 11 Dec 2023
Unique Number : 5695104 **Diagnostician** : Kevin Marson
Test Package : IND 2

ST. MARYS CEMENT CO.
 400 BOWMANVILLE AVENUE
 BOWMANVILLE, ON
 CA L1C 7B5
 Contact: Carlos Barberi
 carlos.barberi@vcimentos.com
 T: (905)623-3341
 F: (905)623-4695

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.