



OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area

5

Machine Id


5-3-164 Rotary Air Lock from 5-3-160

Component

Gear Unit

Fluid

MOBIL SHC 634 (200 LTR)

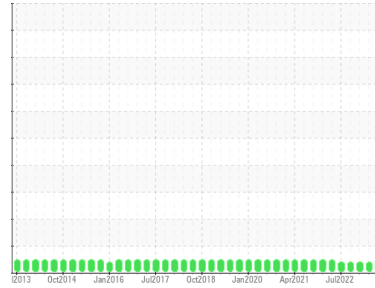

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

Viscosity of sample indicates oil is within ISO 320 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0869858	WC0842663	WC0818130
Sample Date	Client Info		23 Nov 2023	07 Sep 2023	18 May 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >150	12	7	4
Chromium	ppm	ASTM D5185(m) >10	0	0	0
Nickel	ppm	ASTM D5185(m) >10	0	<1	0
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	<1	0	0
Aluminum	ppm	ASTM D5185(m) >25	0	<1	<1
Lead	ppm	ASTM D5185(m) >100	0	0	0
Copper	ppm	ASTM D5185(m) >50	<1	0	0
Tin	ppm	ASTM D5185(m) >10	0	0	0
Antimony	ppm	ASTM D5185(m) >5	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0.2	<1	<1	<1
Barium	ppm	ASTM D5185(m) 0.0	2	2	3
Molybdenum	ppm	ASTM D5185(m) 0.0	0	0	0
Manganese	ppm	ASTM D5185(m) 0.0	0	0	0
Magnesium	ppm	ASTM D5185(m) 0.3	0	0	0
Calcium	ppm	ASTM D5185(m) 0.0	1	<1	0
Phosphorus	ppm	ASTM D5185(m) 825	434	476	518
Zinc	ppm	ASTM D5185(m) 1.7	<1	1	<1
Sulfur	ppm	ASTM D5185(m) 35	58	25	42
Lithium	ppm	ASTM D5185(m)	<1	<1	<1





CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >50	19	21	23
Sodium	ppm	ASTM D5185(m)	<1	<1	0
Potassium	ppm	ASTM D5185(m) >20	0	0	0

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		153062	167324	121395
Particles >6µm	ASTM D7647	>320000	73053	59024	24896
Particles >14µm	ASTM D7647	>160000	1196	1004	792
Particles >21µm	ASTM D7647	>40000	146	159	150
Particles >38µm	ASTM D7647	>10000	11	3	1
Particles >71µm	ASTM D7647	>2500	9	0	0
Oil Cleanliness	ISO 4406 (c)	>--/25/24	24/23/17	25/23/17	24/22/17

OIL ANALYSIS REPORT

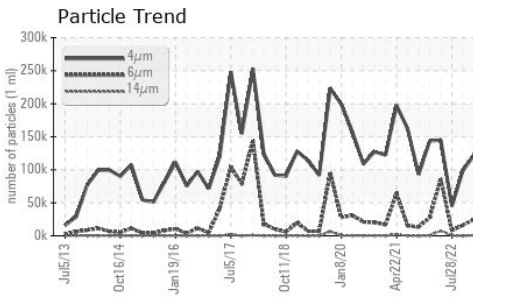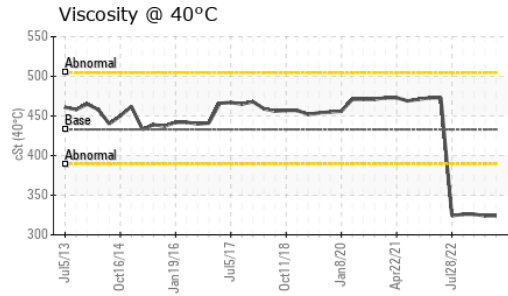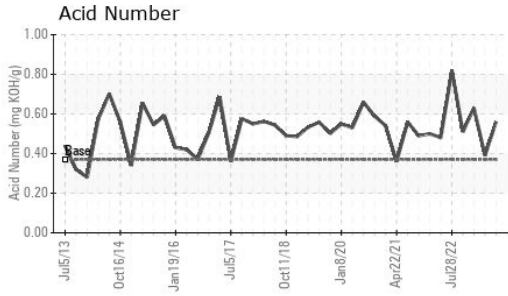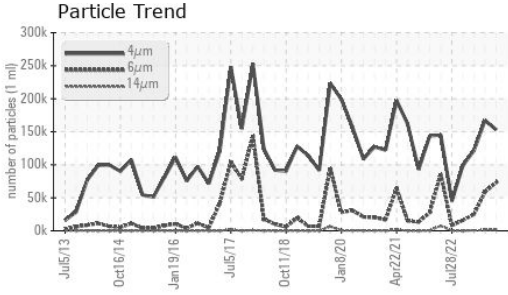


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.37	0.56	0.39	0.63






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	VLITE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	433	324	▲ 324	▲ 326

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

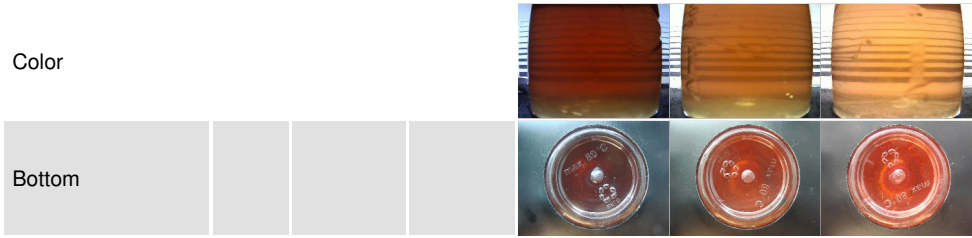

GRAPHS

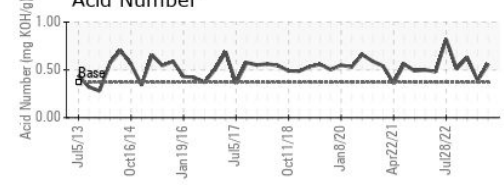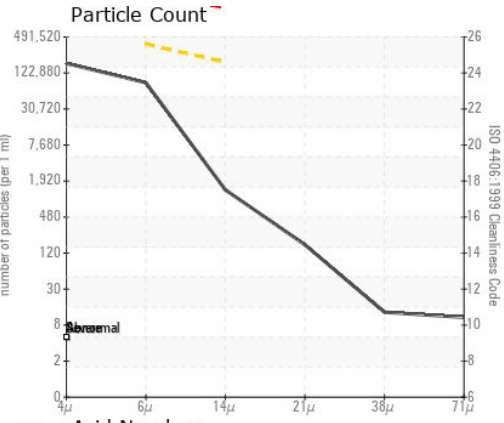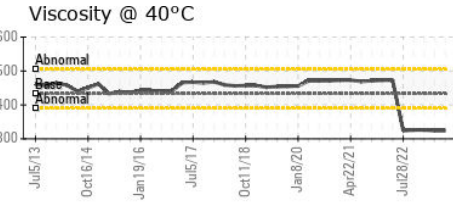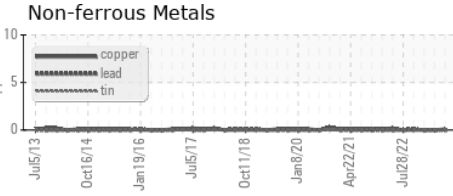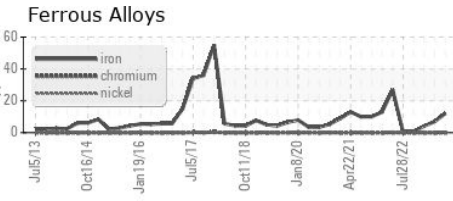

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0869858 **Received** : 08 Dec 2023
Lab Number : **02602042** **Diagnosed** : 11 Dec 2023
Unique Number : 5695127 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: PrtCount, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

ST. MARYS CEMENT CO.
 400 BOWMANVILLE AVENUE
 BOWMANVILLE, ON
 CA L1C 7B5
 Contact: Lou Traiforos
 lou.traiforos@vcimentos.com
 T: (905)440-5874
 F: (905)623-4695