OIL ANALYSIS REPORT

Sample Rating Trend

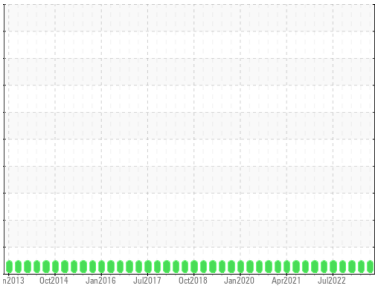

NORMAL

Area
6
Machine Id
6-3-140 Stand-By Tower Elevator
Component
Gear Unit
Fluid
MOBIL SHC 632 (30 LTR)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0869880**	WC0842685	WC0818152
Sample Date		Client Info		**01 Nov 2023**	15 Aug 2023	15 May 2023
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**NORMAL**	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.1	**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		**0**	0	0
Iron	ppm	ASTM D5185(m)	>150	**0**	0	0
Chromium	ppm	ASTM D5185(m)	>10	**0**	0	0
Nickel	ppm	ASTM D5185(m)	>10	**<1**	<1	0
Titanium	ppm	ASTM D5185(m)		**0**	0	0
Silver	ppm	ASTM D5185(m)		**<1**	0	0
Aluminum	ppm	ASTM D5185(m)	>25	**<1**	0	0
Lead	ppm	ASTM D5185(m)	>100	**0**	0	0
Copper	ppm	ASTM D5185(m)	>50	**<1**	0	0
Tin	ppm	ASTM D5185(m)	>10	**0**	0	0
Antimony	ppm	ASTM D5185(m)	>5	**0**	0	0
Vanadium	ppm	ASTM D5185(m)		**0**	0	0
Beryllium	ppm	ASTM D5185(m)		**0**	0	0
Cadmium	ppm	ASTM D5185(m)		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0.6	**1**	<1	0
Barium	ppm	ASTM D5185(m)	0.0	**<1**	0	0
Molybdenum	ppm	ASTM D5185(m)	0.0	**0**	0	0
Manganese	ppm	ASTM D5185(m)	0.0	**0**	0	0
Magnesium	ppm	ASTM D5185(m)	0.0	**0**	0	0
Calcium	ppm	ASTM D5185(m)	0.0	**<1**	2	0
Phosphorus	ppm	ASTM D5185(m)	807	**397**	457	477
Zinc	ppm	ASTM D5185(m)	0.6	**3**	4	3
Sulfur	ppm	ASTM D5185(m)	153	**52**	36	60
Lithium	ppm	ASTM D5185(m)		**<1**	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>50	**14**	17	17
Sodium	ppm	ASTM D5185(m)		**<1**	0	0
Potassium	ppm	ASTM D5185(m)	>20	**0**	0	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.35	**0.29**	0.36	0.34

OIL ANALYSIS REPORT

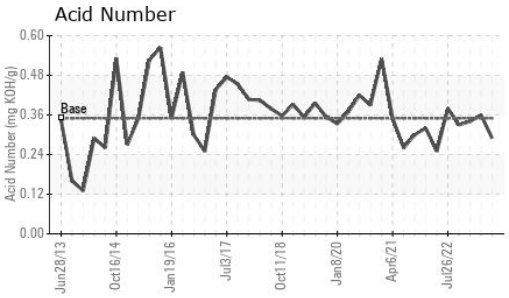

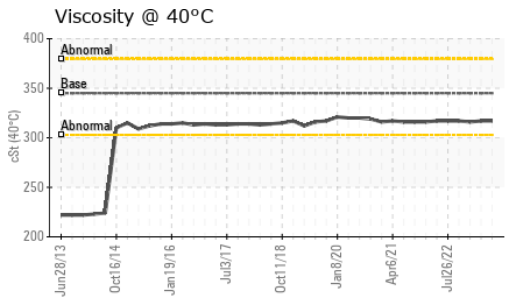

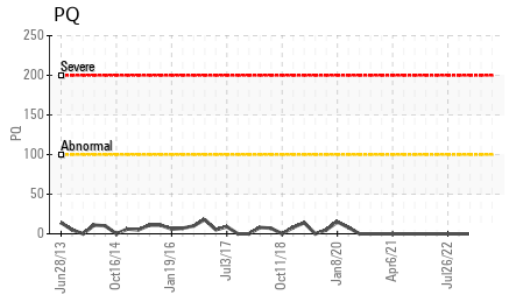

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Precipitate	scalar	Visual*	NONE	**NONE**	NONE	NONE
Silt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Debris	scalar	Visual*	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	**NONE**	NONE	VLITE
Appearance	scalar	Visual*	NORML	**NORML**	NORML	NORML
Odor	scalar	Visual*	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	**NEG**	NEG	NEG
Free Water	scalar	Visual*		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	345	**317**	317	316

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

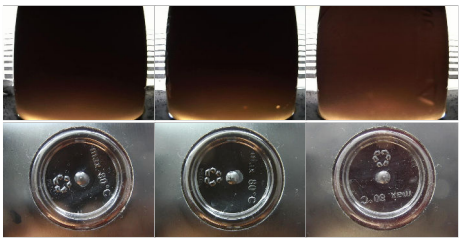

GRAPHS

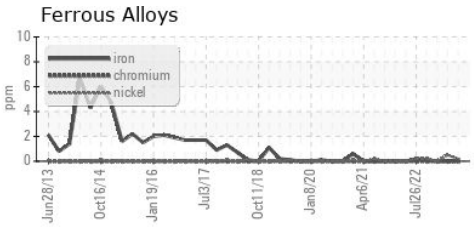

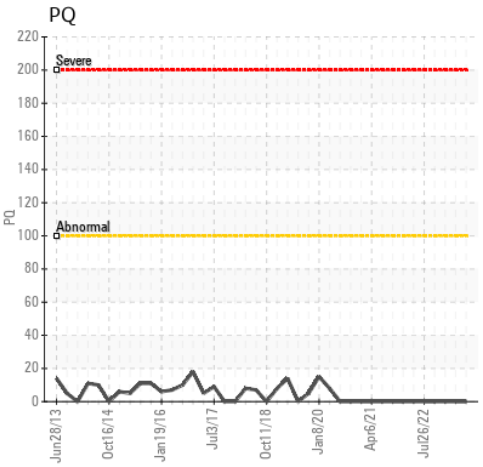

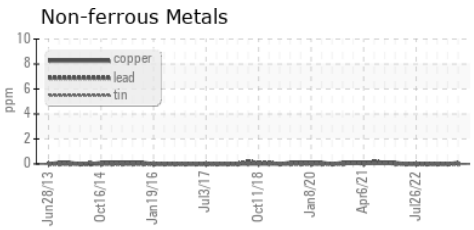

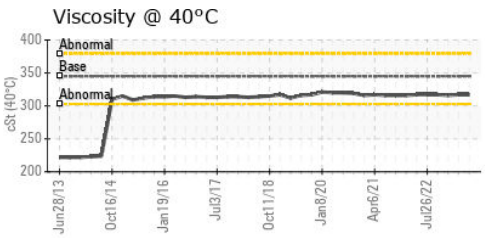

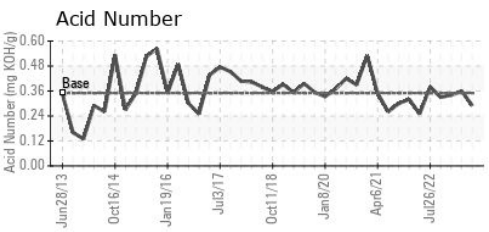

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0869880 **Received** : 08 Dec 2023
Lab Number : 02602062 **Diagnosed** : 09 Dec 2023
Unique Number : 5695147 **Diagnostician** : Wes Davis
Test Package : IND 2 (Additional Tests: TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

ST. MARYS CEMENT CO.
400 BOWMANVILLE AVENUE
BOWMANVILLE, ON
CA L1C 7B5
Contact: Lou Traiforos
lou.traiforos@vcimentos.com
T: (905)440-5874
F: (905)623-4695