



OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area
[328823]
 Machine Id
NO UNIT CU0021504
 Component
Diesel Engine
 Fluid
NOT GIVEN (--- GAL)



DIAGNOSIS

Recommendation

Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition. Veuillez préciser la marque et le modèle du composant lors du prochain échantillon. Veuillez préciser la marque, le type et la viscosité de l'huile lors de votre prochain échantillon.

Wear

Les taux d'usure de tous les composants sont normaux.

Contamination

Il n'y a aucun indice de contamination dans l'huile.

Fluid Condition

L'état de l'huile est acceptable pour la durée de service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		CU0021504	---	---
Sample Date	Client Info		10 Dec 2023	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			NORMAL	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	---	---
Water	WC Method	>0.2	NEG	---	---
Glycol	WC Method		NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >100	2	---	---
Chromium	ppm	ASTM D5185(m) >20	0	---	---
Nickel	ppm	ASTM D5185(m) >4	<1	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m) >3	0	---	---
Aluminum	ppm	ASTM D5185(m) >20	<1	---	---
Lead	ppm	ASTM D5185(m) >40	<1	---	---
Copper	ppm	ASTM D5185(m) >330	<1	---	---
Tin	ppm	ASTM D5185(m) >15	0	---	---
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	39	---	---
Barium	ppm	ASTM D5185(m)	<1	---	---
Molybdenum	ppm	ASTM D5185(m)	46	---	---
Manganese	ppm	ASTM D5185(m)	0	---	---
Magnesium	ppm	ASTM D5185(m)	794	---	---
Calcium	ppm	ASTM D5185(m)	1152	---	---
Phosphorus	ppm	ASTM D5185(m)	729	---	---
Zinc	ppm	ASTM D5185(m)	840	---	---
Sulfur	ppm	ASTM D5185(m)	1979	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	3	---	---
Sodium	ppm	ASTM D5185(m)	3	---	---
Potassium	ppm	ASTM D5185(m) >20	0	---	---

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844* >3	0	---	---
Nitration	Abs/cm	ASTM D7624* >20	6.3	---	---
Sulfation	Abs./1mm	ASTM D7415* >30	20.0	---	---



OIL ANALYSIS REPORT








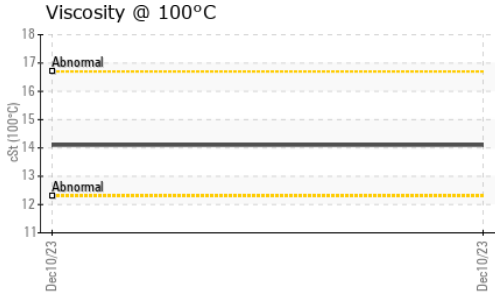


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	16.5	---	---

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)		14.1	---	---

GRAPHS		method	limit/base	current	history1	history2
--------	--	--------	------------	---------	----------	----------

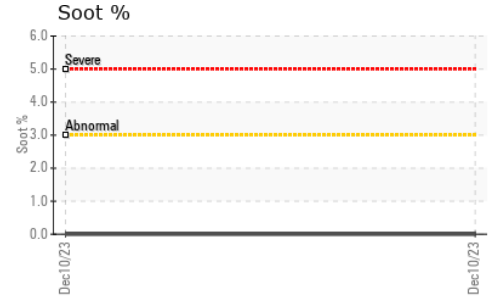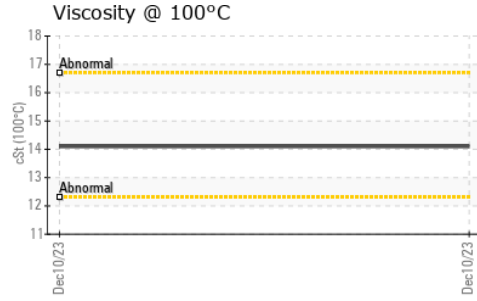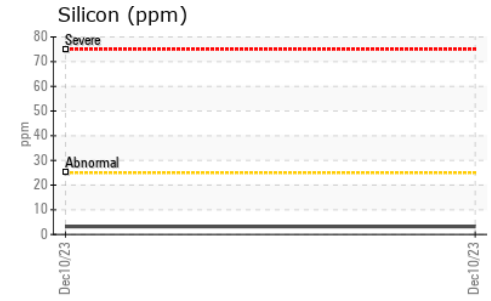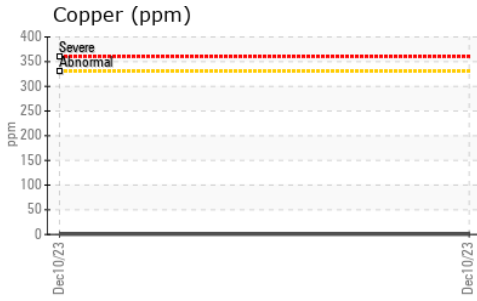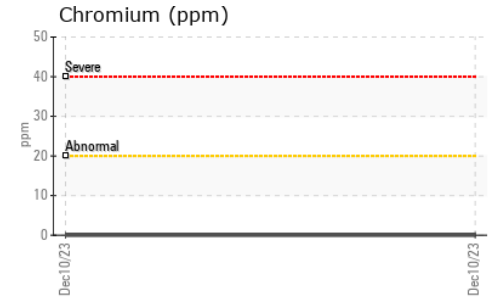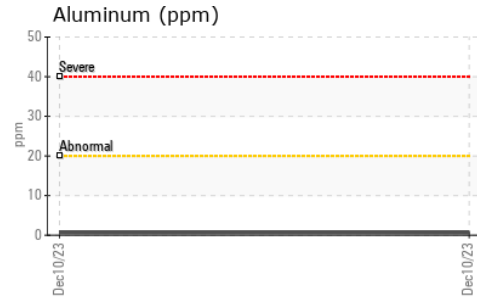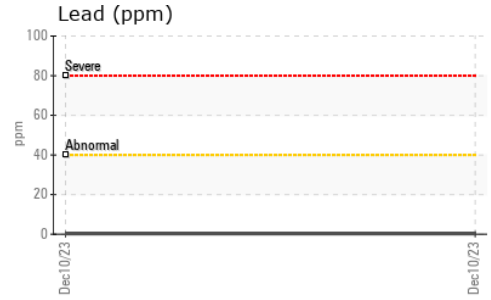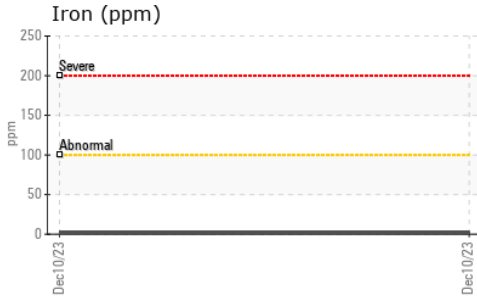

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CU0021504
Lab Number : 02602153
Unique Number : 5695238
Test Package : MOB 1

CUMMINS EASTERN CANADA LP
 315 AV LIBERTE
 CANDIAC, QC
 CA J5R 6Z7
 Contact: Thomas Owens
 is275@cummins.com
 T: (450)638-6863
 F: (450)638-1202

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.