




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

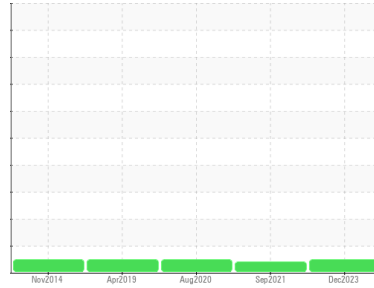

Area  
**[101781]**  
 Machine Id  
**G1 (S/N 33199718)**  
 Component  
**Diesel Engine**  
 Fluid  
**VALVOLINE 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

Metal levels are typical for a new component breaking in.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	<b>CU0021021</b>	CU0018102	CU0016855	
Sample Date	Client Info	<b>08 Dec 2023</b>	21 Sep 2021	19 Aug 2020	
Machine Age	hrs	Client Info	<b>124</b>	95	88
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	Changed	Changed	
Sample Status		<b>NORMAL</b>	ABNORMAL	NORMAL	

## CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >3.0	<b>&lt;1.0</b>	0.4	<1.0
Water	WC Method >0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >90	<b>2</b>	2	2
Chromium	ppm ASTM D5185(m) >20	<b>0</b>	0	0
Nickel	ppm ASTM D5185(m) >2	<b>&lt;1</b>	<1	<1
Titanium	ppm ASTM D5185(m) >2	<b>0</b>	<1	3
Silver	ppm ASTM D5185(m) >2	<b>0</b>	0	<1
Aluminum	ppm ASTM D5185(m) >20	<b>&lt;1</b>	<1	<1
Lead	ppm ASTM D5185(m) >40	<b>0</b>	<1	0
Copper	ppm ASTM D5185(m) >330	<b>&lt;1</b>	<1	<1
Tin	ppm ASTM D5185(m) >15	<b>0</b>	0	0
Antimony	ppm ASTM D5185(m)	<b>0</b>	0	<1
Vanadium	ppm ASTM D5185(m)	<b>0</b>	0	<1
Beryllium	ppm ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 39	<b>44</b>	61	54
Barium	ppm ASTM D5185(m) 1	<b>&lt;1</b>	0	<1
Molybdenum	ppm ASTM D5185(m) 49	<b>47</b>	38	47
Manganese	ppm ASTM D5185(m) 1	<b>0</b>	<1	<1
Magnesium	ppm ASTM D5185(m) 616	<b>775</b>	611	649
Calcium	ppm ASTM D5185(m) 1554	<b>1186</b>	1383	1461
Phosphorus	ppm ASTM D5185(m) 899	<b>696</b>	1030	1021
Zinc	ppm ASTM D5185(m) 1069	<b>823</b>	1133	1181
Sulfur	ppm ASTM D5185(m) 2624	<b>1946</b>	2535	2674
Lithium	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS


method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >25	<b>5</b>	4	4
Sodium	ppm ASTM D5185(m)	<b>3</b>	3	2
Potassium	ppm ASTM D5185(m) >20	<b>0</b>	<1	0

## INFRA-RED

method	limit/base	current	history1	history2
Soot %	% ASTM D7844* >6	<b>0</b>	0	0
Nitration	Abs/cm ASTM D7624* >20	<b>6.7</b>	6.2	6.2
Sulfation	Abs./1mm ASTM D7415* >30	<b>20.0</b>	19.6	18.6




# OIL ANALYSIS REPORT

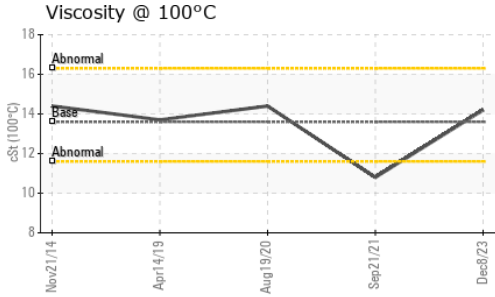

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	<b>16.9</b>	15.6	15.5
VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	13.6	<b>14.2</b>	▲ 10.8	14.4

## GRAPHS

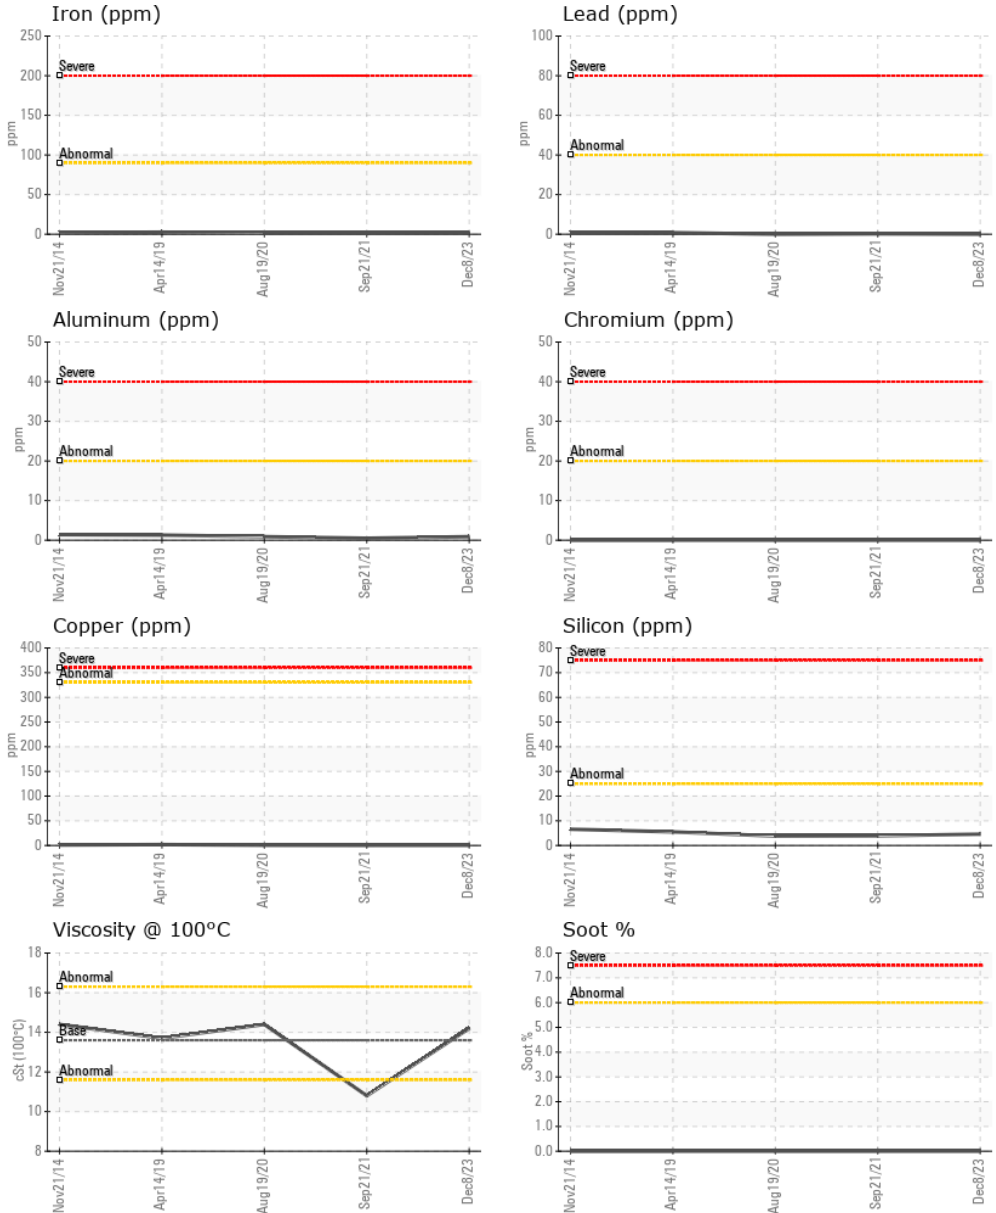

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : CU0021021 **Received** : 12 Dec 2023  
**Lab Number** : **02602522** **Diagnosed** : 12 Dec 2023  
**Unique Number** : 5695607 **Diagnostician** : Wes Davis  
**Test Package** : MOB 1

**CUMMINS EASTERN CANADA LP**  
 3189 SWANSEA CRESCENT  
 OTTAWA, ON  
 CA K1G 3W5  
 Contact: Cindy Harrison  
 cindy.harrison@cummins.com  
 T: (613)736-1146  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.