


OIL ANALYSIS REPORT

Sample Rating Trend

VISCOSITY

Area
[6100237723]
Machine Id
PE4045T943905

Component
Diesel Engine
Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

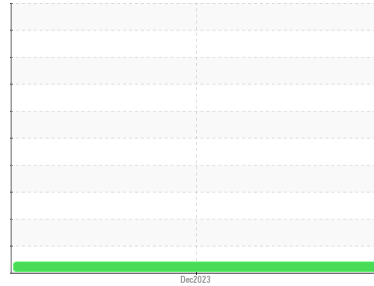

DIAGNOSIS

Recommendation

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. No other corrective action is recommended at this time.

Wear

Metal levels are typical for a new component breaking in.

Contamination

Light fuel dilution occurring. No other contaminants were detected in the oil.

Fluid Condition

Viscosity of sample indicates oil is within SAE 30 range, advise investigate. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WA0021031	---	---
Sample Date	Client Info		06 Dec 2023	---	---
Machine Age	hrs	Client Info	246	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		Changed	---	---
Sample Status			ABNORMAL	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.21	NEG	---	---
Glycol	WC Method		NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>51	29	---
Chromium	ppm	ASTM D5185(m)	>11	<1	---
Nickel	ppm	ASTM D5185(m)	>5	<1	---
Titanium	ppm	ASTM D5185(m)		0	---
Silver	ppm	ASTM D5185(m)	>3	0	---
Aluminum	ppm	ASTM D5185(m)	>31	9	---
Lead	ppm	ASTM D5185(m)	>26	19	---
Copper	ppm	ASTM D5185(m)	>26	154	---
Tin	ppm	ASTM D5185(m)	>4	2	---
Antimony	ppm	ASTM D5185(m)		0	---
Vanadium	ppm	ASTM D5185(m)		0	---
Beryllium	ppm	ASTM D5185(m)		0	---
Cadmium	ppm	ASTM D5185(m)		0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	250	230	---
Barium	ppm	ASTM D5185(m)	10	2	---
Molybdenum	ppm	ASTM D5185(m)	100	262	---
Manganese	ppm	ASTM D5185(m)		4	---
Magnesium	ppm	ASTM D5185(m)	450	873	---
Calcium	ppm	ASTM D5185(m)	3000	1465	---
Phosphorus	ppm	ASTM D5185(m)	1150	852	---
Zinc	ppm	ASTM D5185(m)	1350	1058	---
Sulfur	ppm	ASTM D5185(m)	4250	2464	---
Lithium	ppm	ASTM D5185(m)		1	---


CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>22	31	---
Sodium	ppm	ASTM D5185(m)	>158	5	---
Potassium	ppm	ASTM D5185(m)	>20	3	---
Fuel	%	ASTM D7593*	>2.1	1.2	---

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	0	---
Nitration	Abs/cm	ASTM D7624*	>20	8.4	---
Sulfation	Abs./1mm	ASTM D7415*	>30	22.9	---

OIL ANALYSIS REPORT










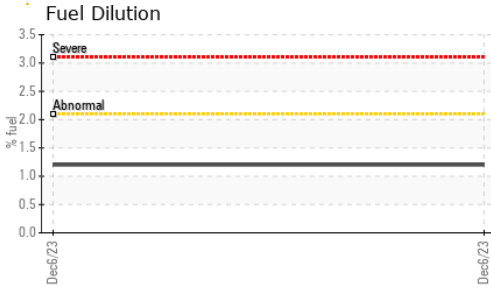


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	18.4	---	---

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.21	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	▲ 10.3	---	---

GRAPHS

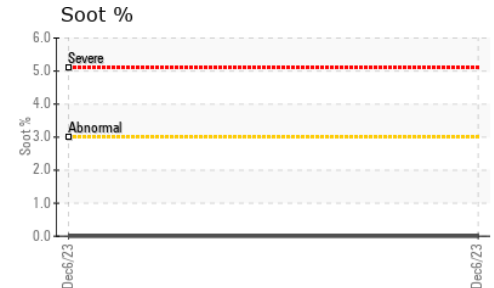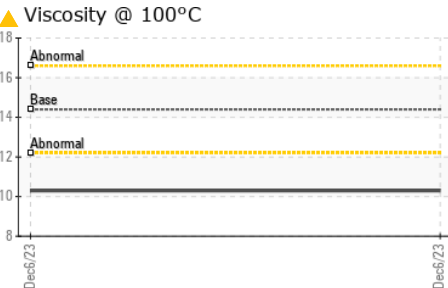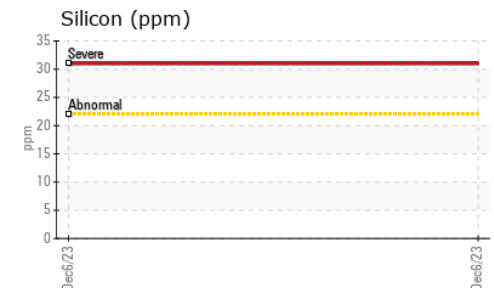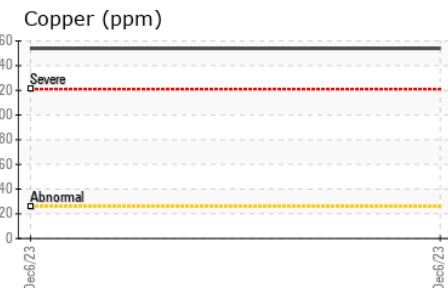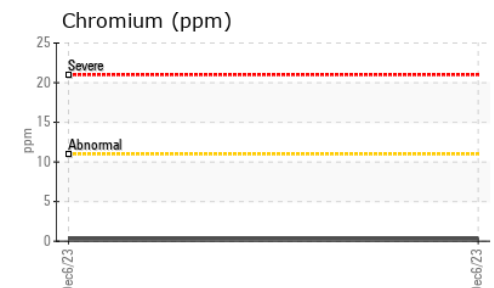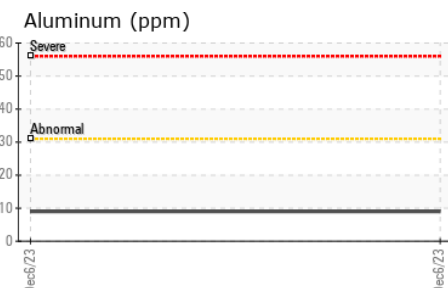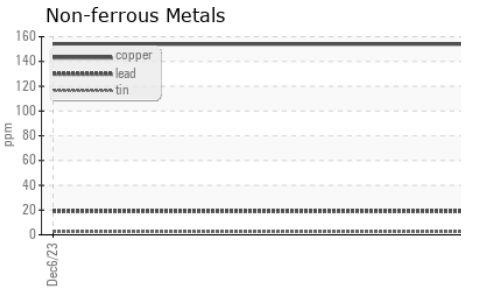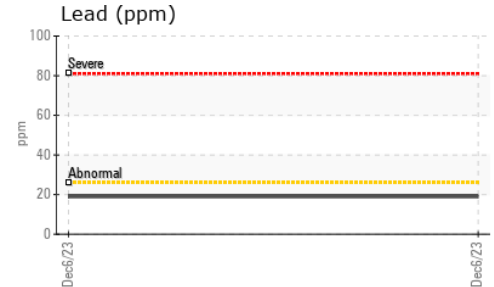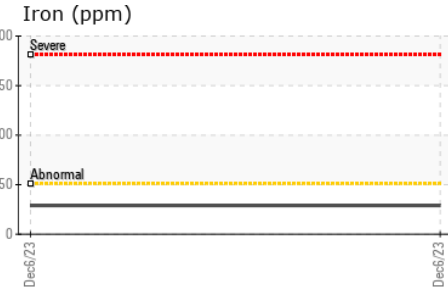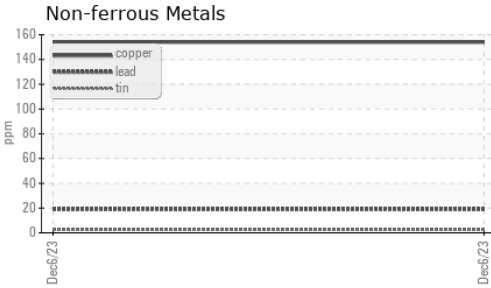

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0021031 **Received** : 12 Dec 2023
Lab Number : **02602523** **Diagnosed** : 13 Dec 2023
Unique Number : 5695608 **Diagnostician** : Kevin Marson
Test Package : MOB 1 (Additional Tests: FuelDilution, PercentFuel)

Wajax Power Systems
 70 Raddall Avenue
 Dartmouth, NS
 CA B3B 1T7
 Contact: Holly Hinton
 hhinton@wajax.com
 T:
 F: (902)468-3325

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.