

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area
[218860]
Machine Id
E6L01042
Component
Diesel Engine
Fluid
DIESEL ENGINE OIL SAE 30 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) DIESEL ENGINE OIL SAE 30. Please confirm.

Wear

Metal levels are typical for a new component breaking in.

Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WA0020720	---	---
Sample Date	Client Info			06 Dec 2023	---	---
Machine Age	hrs	Client Info		208	---	---
Oil Age	hrs	Client Info		50	---	---
Oil Changed	Client Info			Changed	---	---
Sample Status				NORMAL	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	NEG	---	---
Glycol	WC Method			NEG	---	---



WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>100	2	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>2	0	---	---
Titanium	ppm	ASTM D5185(m)	>2	0	---	---
Silver	ppm	ASTM D5185(m)	>2	0	---	---
Aluminum	ppm	ASTM D5185(m)	>25	1	---	---
Lead	ppm	ASTM D5185(m)	>40	0	---	---
Copper	ppm	ASTM D5185(m)	>330	<1	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Antimony	ppm	ASTM D5185(m)		0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
Beryllium	ppm	ASTM D5185(m)		0	---	---
Cadmium	ppm	ASTM D5185(m)		0	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	250	85	---	---
Barium	ppm	ASTM D5185(m)	10	<1	---	---
Molybdenum	ppm	ASTM D5185(m)	100	46	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)	450	408	---	---
Calcium	ppm	ASTM D5185(m)	3000	1768	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	958	---	---
Zinc	ppm	ASTM D5185(m)	1350	1103	---	---
Sulfur	ppm	ASTM D5185(m)	4250	2674	---	---
Lithium	ppm	ASTM D5185(m)		<1	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	6	---	---
Sodium	ppm	ASTM D5185(m)	>75	3	---	---
Potassium	ppm	ASTM D5185(m)	>20	<1	---	---
Fuel	%	ASTM D7593*	>5	0.9	---	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	4.8	---	---
Sulfation	Abs.1mm	ASTM D7415*	>30	20.1	---	---

OIL ANALYSIS REPORT







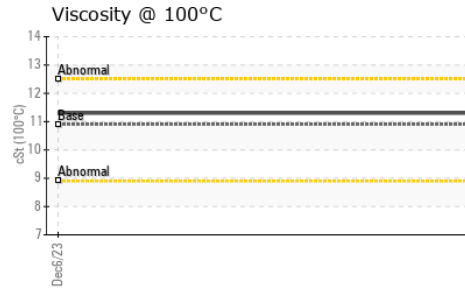
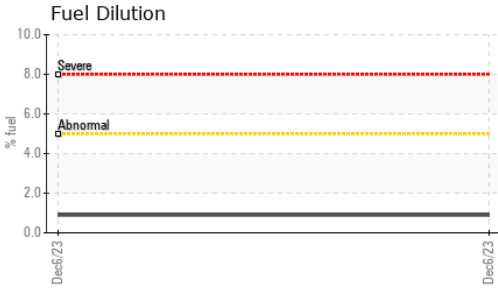


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	16.5	---	---

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	10.9	11.3	---	---

GRAPHS

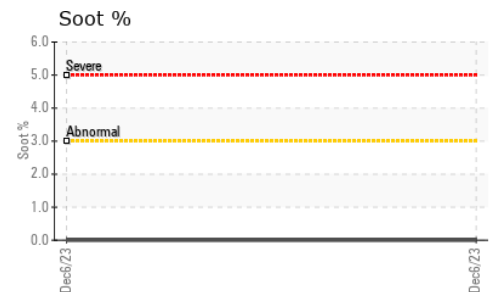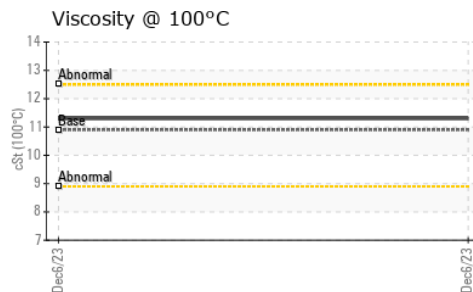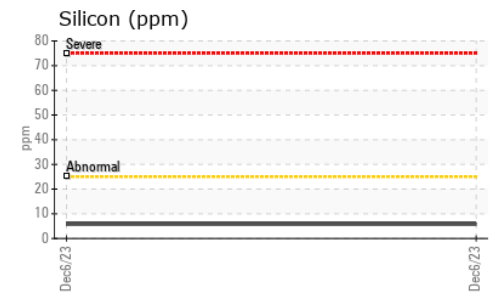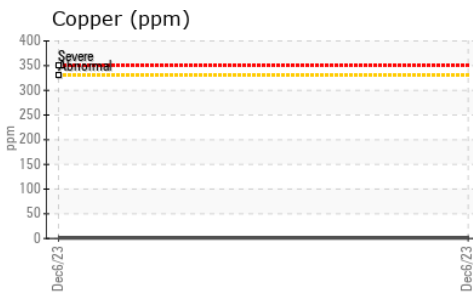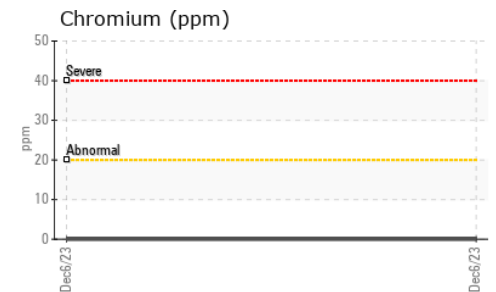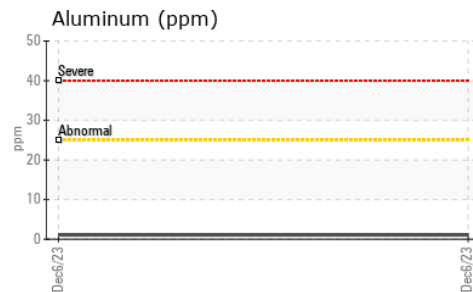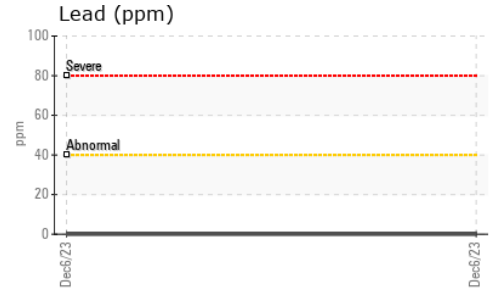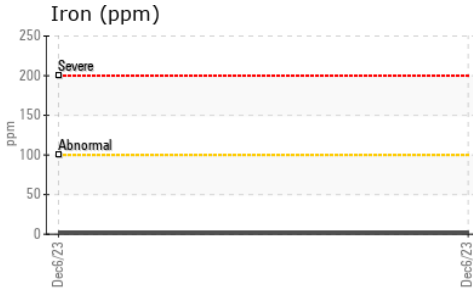

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0020720 **Received** : 12 Dec 2023
Lab Number : **02602525** **Diagnosed** : 13 Dec 2023
Unique Number : 5695610 **Diagnostician** : Wes Davis
Test Package : MOB 1 (Additional Tests: FuelDilution, PercentFuel)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Wajax Power Systems
 70 Raddall Avenue
 Dartmouth, NS
 CA B3B 1T7
 Contact: Danelle Hoffman
 dhoffman@wajax.com
 T: (902)468-6200
 F: (902)468-3325