




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

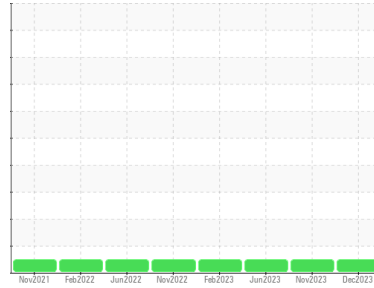

Area  
**MAPLE LODGE [4501231062]**  
 Machine Id  
**FRICK C2 (S/N 10241E97081902)**  
 Component  
**Screw Compressor**  
 Fluid  
**CIMCO TYPE A (100 LTR)**

## DIAGNOSIS

- Recommendation**  
 Resample at the next service interval to monitor.
- Wear**  
 All component wear rates are normal.
- Contamination**  
 The water content is negligible. There is no indication of any contamination in the oil.
- Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0885218</b>	WC0871350	WC0821203
Sample Date	Client Info		<b>07 Dec 2023</b>	24 Nov 2023	20 Jun 2023
Machine Age	hrs	Client Info	<b>58304</b>	1754	1754
Oil Age	hrs	Client Info	<b>4704</b>	1754	1754
Oil Changed	Client Info		<b>Not Changed</b>	Not Changed	Not Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	0	0
Iron	ppm	ASTM D5185(m) >60	<b>4</b>	3	2
Chromium	ppm	ASTM D5185(m) >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	0
Aluminum	ppm	ASTM D5185(m) >5	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185(m) >10	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185(m) >30	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m) >15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Barium	ppm	ASTM D5185(m)	<b>&lt;1</b>	5	5
Molybdenum	ppm	ASTM D5185(m)	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185(m)	<b>4</b>	<1	<1
Phosphorus	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	<1
Zinc	ppm	ASTM D5185(m)	<b>2</b>	2	3
Sulfur	ppm	ASTM D5185(m)	<b>32</b>	41	82
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >50	<b>&lt;1</b>	2	2
Sodium	ppm	ASTM D5185(m)	<b>0</b>	1	<1
Potassium	ppm	ASTM D5185(m) >20	<b>0</b>	0	<1
Water	%	ASTM D6304* >0.1	<b>0.002</b>	0.001	0.001
ppm Water	ppm	ASTM D6304* >1000	<b>23</b>	11	1.4

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.05	<b>0.02</b>	0.05	0.03




# OIL ANALYSIS REPORT

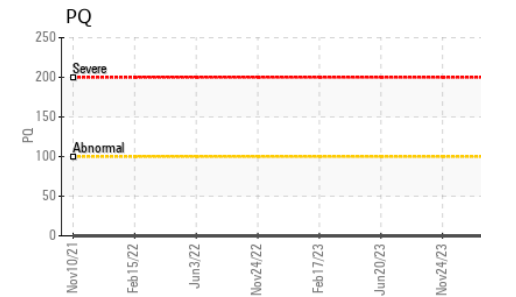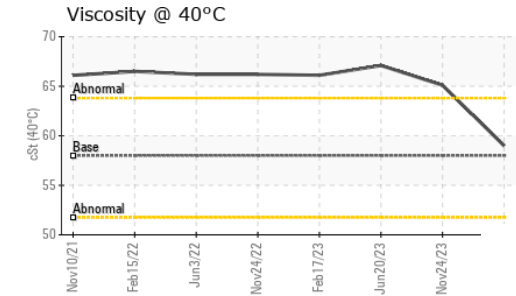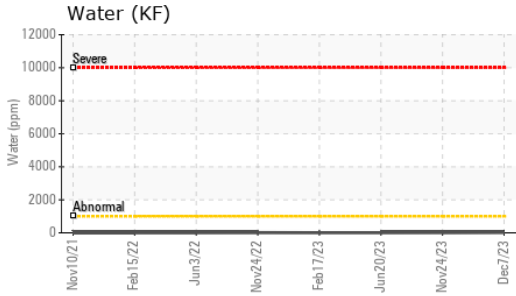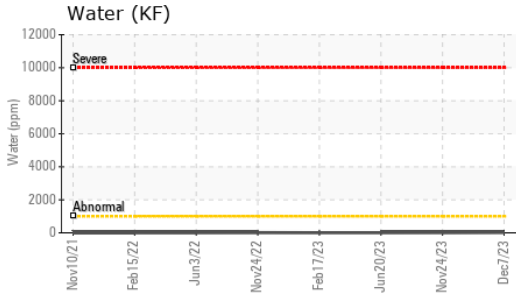






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	AMMON	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	58	59.0	65.1	67.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

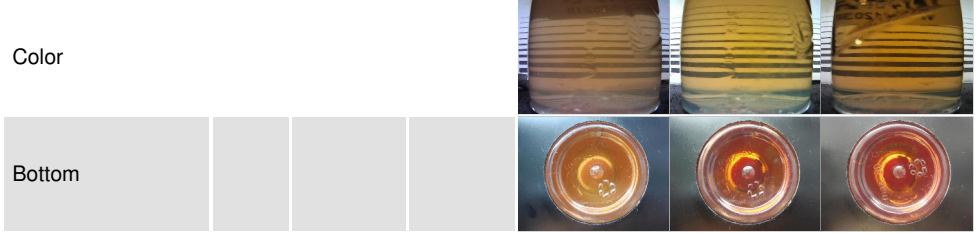

## GRAPHS

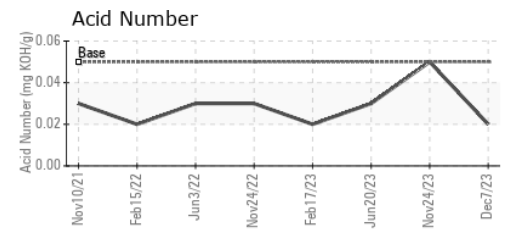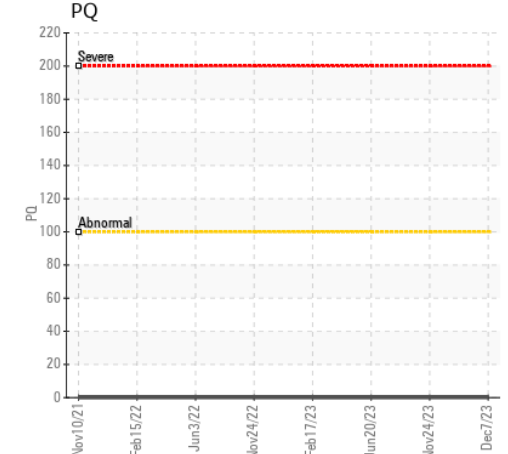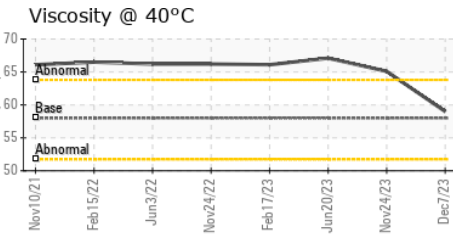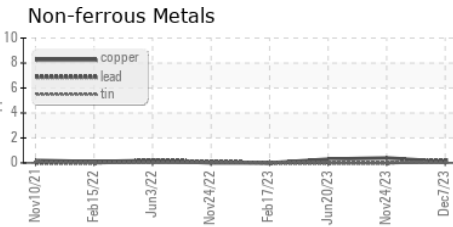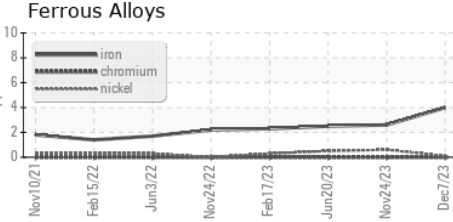

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0885218 **Received** : 12 Dec 2023  
**Lab Number** : 02602637 **Diagnosed** : 13 Dec 2023  
**Unique Number** : 5695722 **Diagnostician** : Wes Davis  
**Test Package** : IND 2 ( Additional Tests: KF, TAN Man )

**CIMCO Refrigeration**  
 1551 Corporate Drive  
 Burlington, ON  
 CA L7L 6M3  
 Contact: DAVID PARISE  
 DPARISE@ToROMONT.COM  
 T: (416)465-7581  
 F: (416)465-8815

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.