




PROBLEM SUMMARY


Sample Rating Trend

WEAR

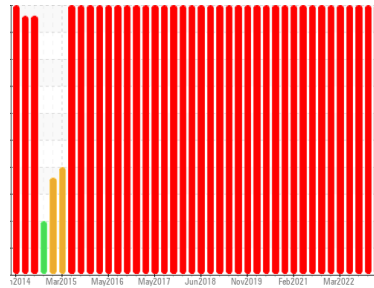

Area
BRUCE B/8/43230
 Machine Id
8-43230-P4-P OB Brg Drn
 Component
Outboard Bearing
 Fluid
ESSO NUTO H ISO 46 (--- GAL)

COMPONENT CONDITION SUMMARY

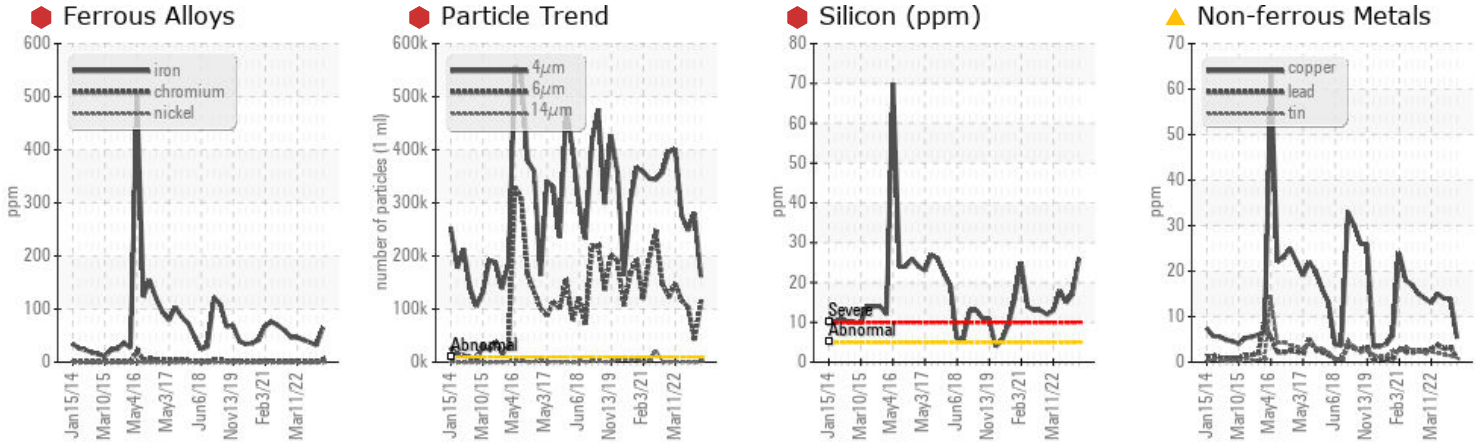

RECOMMENDATION

Check seals and/or filters for points of contaminant entry. We advise that you check all areas where dirt can enter the system. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend either performing an oil change or oil filtration. We cannot recommend specific action as we have limited information with regards to reservoir capacity and/or lubricant type. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

PROBLEMATIC TEST RESULTS

Sample Status			SEVERE	SEVERE	SEVERE	
Iron	ppm	ASTM D5185(m)	>10	65	32	37
Chromium	ppm	ASTM D5185(m)	>5	5	<1	1
Copper	ppm	ASTM D5185(m)	>5	5	14	14
Ferrous Rubbing	Scale 0-10	ASTM D7684*		7	7	8
Silicon	ppm	ASTM D5185(m)	>5	26	17	15
Particles >4µm		ASTM D7647	>10000	161493	280383	248273
Particles >6µm		ASTM D7647	>2500	110784	42762	103479
Particles >14µm		ASTM D7647	>160	1914	414	857
Oil Cleanliness		ISO 4406 (c)	>20/18/14	25/24/18	25/23/16	25/24/17

Customer Id: BRUTIV
 Sample No.: WC0744594
 Lab Number: 02602855
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	Resample in 30-45 days to monitor this situation.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Dirt Access	---	---	?	We advise that you check all areas where dirt can enter the system.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.
Filter Fluid	---	---	?	We recommend either performing an oil change or oil filtration. We cannot recommend specific action as we have limited information with regards to reservoir capacity and/or lubricant type.

HISTORICAL DIAGNOSIS

26 Apr 2023 Diag: Kevin Marson

WEAR



Check seals and/or filters for points of contaminant entry. We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Copper and iron ppm levels are severe. Wear particle analysis indicates that the ferrous cutting particles are abnormal. Wear particle analysis indicates that the ferrous rubbing particles are marginal. Bearing wear is indicated. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion. Cutting wear particles are caused by either hard protuberances (mis-aligned components, etc.), or abrasives entering the system and embedding themselves in softer materials (sand, etc.), and gouging out mating surfaces. Silicon ppm levels are severely high. Particles >6µm are severely high. Particles >4µm are severely high. Oil Cleanliness are severely high. Particles >14µm are abnormally high. Elemental level of silicon (Si) above normal indicating ingress of seal material. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

view report



01 Feb 2023 Diag: Kevin Marson

WEAR



Check seals and/or filters for points of contaminant entry. We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Copper and iron ppm levels are severe. Wear particle analysis indicates that the ferrous rolling and ferrous rubbing particles are abnormal. Bearing wear is indicated. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion. Silicon ppm levels are severely high. Particles >6µm are severely high. Particles >4µm are severely high. Oil Cleanliness are severely high. Particles >14µm are abnormally high. Particles >21µm are abnormally high. Elemental level of silicon (Si) above normal indicating ingress of seal material. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

view report



11 Nov 2022 Diag: Kevin Marson

WEAR



We advise that you check all areas where contaminants can enter the system. We recommend either performing an oil change or oil filtration. We cannot recommend specific action as we have limited information with regards to reservoir capacity and/or lubricant type. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Copper and iron ppm levels are severe. Wear particle analysis indicates that the ferrous rubbing particles are abnormal. Bearing wear is indicated. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion. Silicon ppm levels are severely high. Particles >6µm are severely high. Particles >4µm are severely high. Oil Cleanliness are severely high. Particles >14µm are abnormally high. Particles >21µm are abnormally high. Elemental level of silicon (Si) above normal indicating ingress of seal material. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

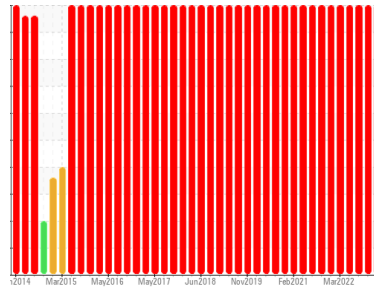

WEAR



Area
BRUCE B/8/43230
 Machine Id
8-43230-P4-P OB Brg Drn
 Component
Outboard Bearing
 Fluid
ESSO NUTO H ISO 46 (--- GAL)

DIAGNOSIS

Recommendation

Check seals and/or filters for points of contaminant entry. We advise that you check all areas where dirt can enter the system. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend either performing an oil change or oil filtration. We cannot recommend specific action as we have limited information with regards to reservoir capacity and/or lubricant type. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

Iron ppm levels are severe. Copper and chromium ppm levels are abnormal. Wear particle analysis indicates that the ferrous rubbing particles are abnormal. Bearing wear is indicated. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion.

Contaminants

There is a high amount of silt (particulates < 14 microns in size) present in the oil. Elemental level of silicon (Si) above normal indicating ingress of seal material and/or dirt. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code.

Oil Condition

The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0744594	WC0744548	WC0744546
Sample Date	Client Info		12 Jun 2023	26 Apr 2023	01 Feb 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	SEVERE	SEVERE

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		39	9	11
Iron	ppm	ASTM D5185(m) >10	65	32	37
Chromium	ppm	ASTM D5185(m) >5	5	<1	1
Nickel	ppm	ASTM D5185(m) >5	0	0	<1
Titanium	ppm	ASTM D5185(m) >5	0	0	0
Silver	ppm	ASTM D5185(m)	<1	0	0
Aluminum	ppm	ASTM D5185(m) >5	<1	0	<1
Lead	ppm	ASTM D5185(m) >5	1	3	3
Copper	ppm	ASTM D5185(m) >5	5	14	14
Tin	ppm	ASTM D5185(m) >5	<1	1	2
Antimony	ppm	ASTM D5185(m)	0	<1	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<1	<1	<1
Barium	ppm	ASTM D5185(m) 0	0	0	0
Molybdenum	ppm	ASTM D5185(m) 0	0	0	0
Manganese	ppm	ASTM D5185(m)	0	<1	<1
Magnesium	ppm	ASTM D5185(m) 5	<1	0	<1
Calcium	ppm	ASTM D5185(m) 50	54	53	55
Phosphorus	ppm	ASTM D5185(m) 330	346	367	378
Zinc	ppm	ASTM D5185(m) 410	440	407	429
Sulfur	ppm	ASTM D5185(m) 2700	5767	5440	5697
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >5	26	17	15
Sodium	ppm	ASTM D5185(m) >5	<1	0	0
Potassium	ppm	ASTM D5185(m) >20	0	0	0
Water	%	ASTM D6304* >0.005	0.001	0.001	0.001
ppm Water	ppm	ASTM D6304* >50	15	6.8	6.1

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	161493	280383	248273
Particles >6µm	ASTM D7647	>2500	110784	42762	103479
Particles >14µm	ASTM D7647	>160	1914	414	857
Particles >21µm	ASTM D7647	>40	38	51	90
Particles >38µm	ASTM D7647	>10	1	0	1
Particles >71µm	ASTM D7647	>3	1	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	25/24/18	25/23/16	25/24/17



OIL ANALYSIS REPORT

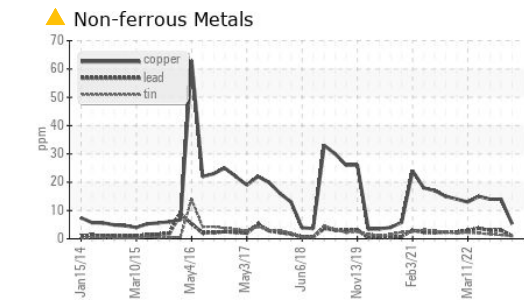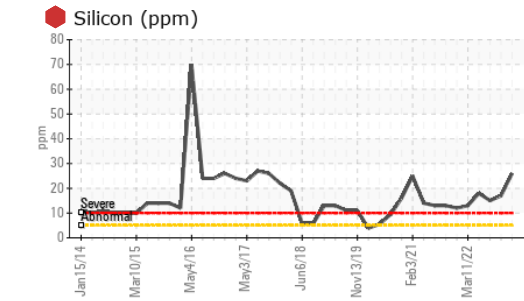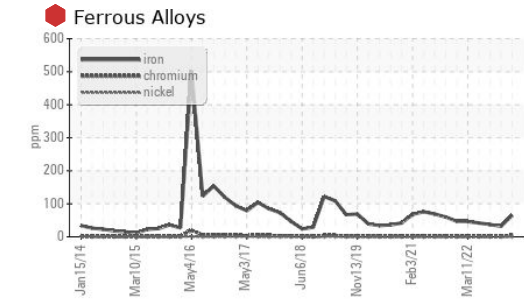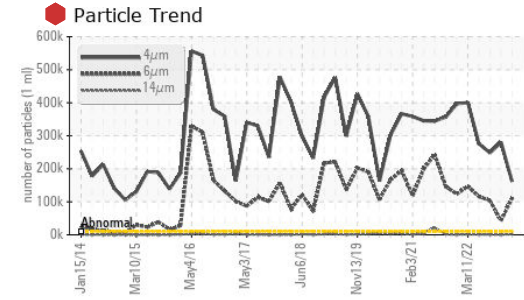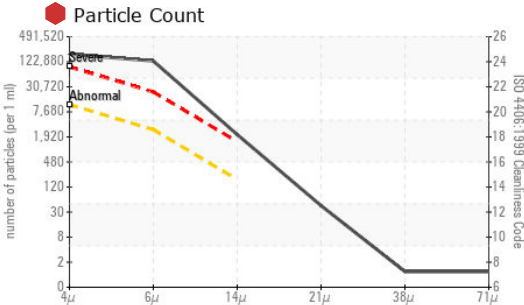

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.45	0.46	0.47	0.43

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.005	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	46	42.8	44.2	44.1

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color			
Bottom			
PrtFilter	no image	no image	



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0744594
Lab Number : 02602855
Unique Number : 5695940
Test Package : IND 2 (Additional Tests: A-FERR, DR-FERR, FILTERPATCH, PQ)



Bruce Power - Bruce A PdM
 P.O.Box 1540, 177 Tie Road., RM-222 U2 Column 2N11 615
 Tiverton, ON
 CA N0G 2T0
 Contact: Pierre Adouki
 pierre.adouki@brucepower.com
 T: (519)361-2673
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.



FERROGRAPHY REPORT

Area
BRUCE B/8/43230
 Machine Id
8-43230-P4-P OB Brg Drn
 Component
Outboard Bearing
 Fluid
ESSO NUTO H ISO 46 (--- GAL)

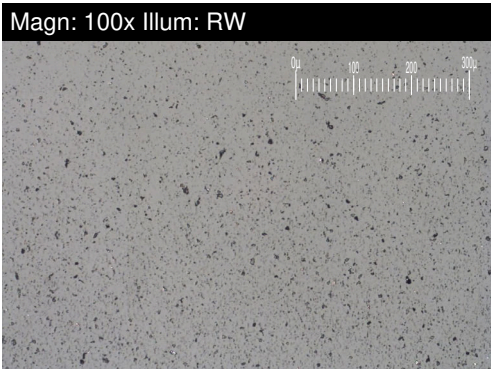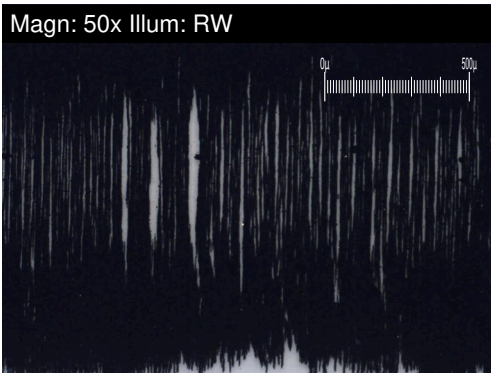


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		83.5	0.9	161.7
Small Particles		DR-Ferr*		61.2	0.5	122.0
Total Particles		DR-Ferr*	>---	144.7	1.4	283.7
Large Particles Percentage	%	DR-Ferr*		15.4	28.6	14
Severity Index		DR-Ferr*		1862	0	6419

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		▲ ■ 8	▲ 7	▲ 8
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*			▲ 1	
Ferrous Rolling	Scale 0-10	ASTM D7684*		■ 4	■ 3	▲ 5
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*				
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*		■ 2	■ 2	■ 1
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		■ 1	■ 1	■ 1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		■ 2	■ 2	■ 2

WEAR

Iron ppm levels are severe. Copper and chromium ppm levels are abnormal. Wear particle analysis indicates that the ferrous rubbing particles are abnormal. Bearing wear is indicated. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion.

DR Ferrography

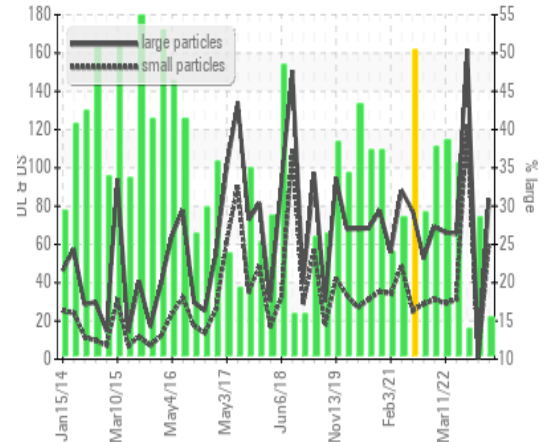

This page left intentionally blank