




PROBLEM SUMMARY



Area
MGM 825 Coxwell #3 [4500057327]
 Machine Id
CARRIER 0607Q73675
 Component
Chiller
 Fluid
ICI EMKARATE RL 68H (--- GAL)

Sample Rating Trend

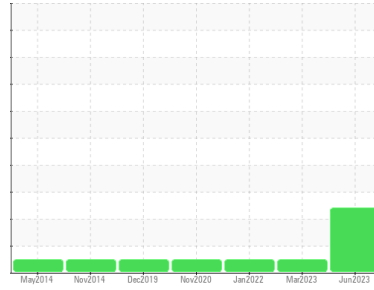

WATER



COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

Recommend replacement of any filter driers because of the increased moisture level. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	NORMAL
Tin	ppm	ASTM D5185(m)	>4	▲ 3	<1	<1
ppm Water	ppm	ASTM D6304*	>100	▲ 227	55	58

Customer Id: GTT0000224
 Sample No.: GTT0001180
 Lab Number: 02602974
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Bill Quesnel CLS,OMA II,MLA-III,LLA-I +1
 (289)291-4641 x4641
Bill.Quesnel@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

21 Mar 2023 Diag: Wes Davis

NORMAL



The test results indicate normal wear patterns for this type of unit with the moisture and acidity also in the acceptable range.

view report



25 Jan 2022 Diag: Wes Davis

NORMAL



The acid number is slightly high. All wear metals and moisture are in satisfactory ranges for this model unit and the running time reported. DO NOT change the oil. Resample in 3-4 months or 2500 hours.

view report



18 Nov 2020 Diag: Wes Davis

NORMAL



The test results indicate normal wear patterns for this type of unit with the moisture and acidity also in the acceptable range.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

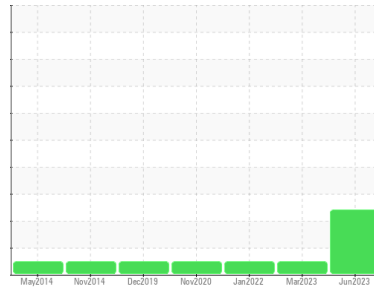

WATER



Area
MGM 825 Coxwell #3 [4500057327]
 Machine Id
CARRIER 0607Q73675
 Component
Chiller
 Fluid
ICI EMKARATE RL 68H (--- GAL)

DIAGNOSIS

▲ Recommendation

Recommend replacement of any filter driers because of the increased moisture level. We recommend an early resample to monitor this condition.

▲ Wear

Tin ppm levels are abnormal. The tin reading shows moderate wear occurring on the compressor bearings or motor bearings.

▲ Contamination

There is a moderate concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GTT0001180	GTT1533	GTT1534
Sample Date	Client Info		23 Jun 2023	21 Mar 2023	25 Jan 2022
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >8	<1	<1	<1
Chromium	ppm	ASTM D5185(m) >2	0	<1	<1
Nickel	ppm	ASTM D5185(m)	0	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m) >2	<1	---	---
Aluminum	ppm	ASTM D5185(m) >3	0	<1	<1
Lead	ppm	ASTM D5185(m) >2	<1	<1	<1
Copper	ppm	ASTM D5185(m) >8	<1	<1	<1
Tin	ppm	ASTM D5185(m) >4	▲ 3	<1	<1
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	1	---	---
Barium	ppm	ASTM D5185(m) 0	0	---	---
Molybdenum	ppm	ASTM D5185(m) 0	0	---	---
Manganese	ppm	ASTM D5185(m)	0	---	---
Magnesium	ppm	ASTM D5185(m) 0	0	---	---
Calcium	ppm	ASTM D5185(m) 0	0	---	---
Phosphorus	ppm	ASTM D5185(m) 1900	1820	---	---
Zinc	ppm	ASTM D5185(m) 0	3	<1	1
Sulfur	ppm	ASTM D5185(m) 25	33	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	19	---	---
Sodium	ppm	ASTM D5185(m)	2	---	---
Potassium	ppm	ASTM D5185(m) >20	6	---	---
ppm Water	ppm	ASTM D6304* >100	▲ 227	55	58



FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.02	0.10	0.078	0.101

OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	72.3	40.8	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS



Sample No. : GTT0001180 **Recieved** : 13 Dec 2023
Lab Number : 02602974 **Diagnosed** : 15 Dec 2023
Unique Number : 5696059 **Diagnostician** : Bill Quesnel
Test Package : IND 2 (Additional Tests: KV40)

To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.

Test denoted () outside scope of accreditation, (m) method modified, (e) tested at external lab.*

Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.

Carrier Commerical Service
 C/O Conduent Div of Carrier Canada, 1-2740 Matheson Blvd
 Mississauga, ON
 CA L4W 4X3
 Contact: Brian Raymundo
 Brian.Raymundo@carrier.com

T:
F: