

## **OIL ANALYSIS REPORT**

Sample Rating Trend







Machine Id Component New (Unused) Oil Fluid MOBIL DTE OIL HVY MEDIUM (205 LTR)

#### DIAGNOSIS

#### Recommendation

This is the baseline readout on this new (unused) oil. The fluid is suitable for service.

#### Wear

{not applicable}

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. There is no indication of any contamination in the new (unused) oil.


#### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0865640		
Sample Date		Client Info		13 Dec 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATION	J	method	limit/base	current	history1	history2
Water		WC Method		NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>5	0		
Chromium	ppm	ASTM D5185(m)	>5	0		
Nickel	ppm	ASTM D5185(m)	>5	0		
Titanium	ppm	ASTM D5185(m)		0		
Silver	ppm	ASTM D5185(m)	>5	<1		
Aluminum	ppm	ASTM D5185(m)	>5	0		
Lead	ppm	ASTM D5185(m)	>5	0		
Copper	ppm	ASTM D5185(m)	>5	<1		
Tin	ppm	ASTM D5185(m)	>5	0		
Antimony	ppm	ASTM D5185(m)		0		
Vanadium	ppm	ASTM D5185(m)		0		
Beryllium	ppm	ASTM D5185(m)		0		
Cadmium	ppm	ASTM D5185(m)		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1		
Barium	ppm	ASTM D5185(m)		<1		
Molybdenum	ppm	ASTM D5185(m)		0		
Manganese	ppm	ASTM D5185(m)		0		
Magnesium	ppm	ASTM D5185(m)		0		
Calcium	ppm	ASTM D5185(m)		2		
Phosphorus	ppm	ASTM D5185(m)		112		
Zinc	ppm	ASTM D5185(m)		86		
Sulfur	ppm	ASTM D5185(m)		1078		
Lithium	ppm	ASTM D5185(m)		<1		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	0		
Sodium	ppm	ASTM D5185(m)		0		
Potassium	ppm	ASTM D5185(m)	>20	0		
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*		0		
Nitration	Abs/cm	ASTM D7624*		1.8		
Sulfation	Abs/.1mm	ASTM D7415*		12.0		




# **OIL ANALYSIS REPORT**











0

FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	1136		
Particles >6µm		ASTM D7647	>1300	358		
Particles >14µm		ASTM D7647	>160	22		
Particles >21µm		ASTM D7647	>40	6		
Particles >38µm		ASTM D7647	>10	1		
Particles >71µm		ASTM D7647	>3	1		
Oil Cleanliness		ISO 4406 (c)	>19/17/14	17/16/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*		1.9		
Acid Number (AN)	mg KOH/g	ASTM D974*		0.16		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE		
Yellow Metal	scalar	Visual*	NONE	NONE		
Precipitate	scalar	Visual*	NONE	NONE		
Silt	scalar	Visual*	NONE	NONE		
Debris	scalar	Visual*	NONE	NONE		
Sand/Dirt	scalar	Visual*	NONE	NONE		
Appearance	scalar	Visual*	NORML	NORML		
Odor	scalar	Visual*	NORML	NORML		
Emulsified Water	scalar	Visual*		NEG		
Free Water	scalar	Visual*		NEG		
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	65.1	68.4		
Visc @ 100°C	cSt	ASTM D7279(m)	8.7	9		
Viscosity Index (VI)	Scale	ASTM D2270*	95	105		
SAMPLE IMAGES method		method	limit/base	current	history1	history2

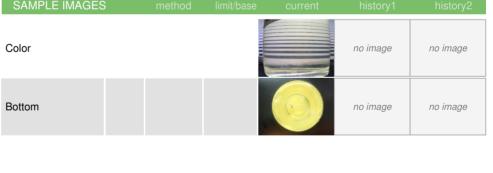



Per13/7

NEWFOUNDLAND POWER INC. 50 DUFFY PLACE, PO BOX 8910 ST. JOHNS, NL

SI. JOHNS, NL CA A1B 3P6 Contact: Shane Reid sreid@newfoundlandpower.com T: (709)737-5209 F: (709)737-2926

Contact/Location: Shane Reid - NEWSTJ