




# PROBLEM SUMMARY

Sample Rating Trend

VISCOSITY




Machine Id  
**GFP2 - UNIT 4 GOVERNOR (S/N 720060)**  
 Component  
**Governor System**  
 Fluid  
**SHELL TURBO T ISO 46 (4100 LTR)**

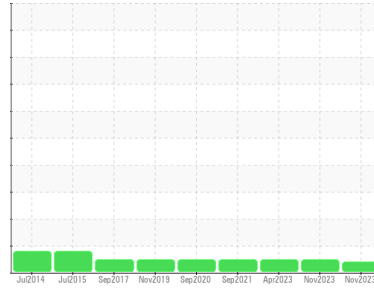

## COMPONENT CONDITION SUMMARY

▲ Viscosity @ 40°C

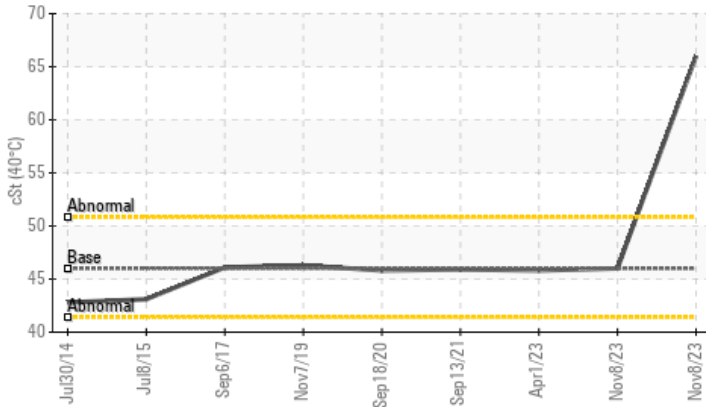

## RECOMMENDATION

Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using IND 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. ( Customer Sample Comment: Unsure date )

## PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	NORMAL
Visc @ 40°C	cSt	ASTM D7279(m)	46	▲ 66.0	46.0	45.8

Customer Id: NALGRA  
 Sample No.: WC0524888  
 Lab Number: 02603219  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Kevin Marson +1 (289)291-4644 x4644  
[Kevin.Marson@wearcheck.com](mailto:Kevin.Marson@wearcheck.com)

To change component or sample information:  
 Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Contact Required	---	---	?	Please contact your representative for information regarding the proper sampling kits for your service.
Alert	---	---	?	NOTE: We recommend using IND 3 test kits,

## HISTORICAL DIAGNOSIS

### 08 Nov 2023 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using IND 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. Component wear rates appear to be normal (unconfirmed). The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 01 Apr 2023 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 13 Sep 2021 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report





# OIL ANALYSIS REPORT

Sample Rating Trend


VISCOSITY



Machine Id  
**GFP2 - UNIT 4 GOVERNOR (S/N 720060)**

Component  
**Governor System**

Fluid  
**SHELL TURBO T ISO 46 (4100 LTR)**

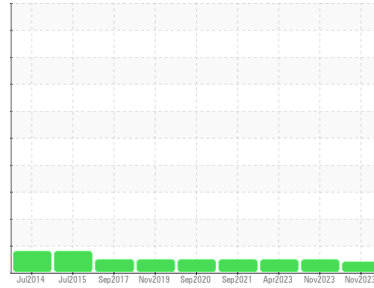

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using IND 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. ( Customer Sample Comment: Unsure date )

### Wear

Component wear rates appear to be normal (unconfirmed).

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

### Fluid Condition

Viscosity of sample indicates oil is within ISO 68 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0524888</b>	WC0827903	WC0701194
Sample Date	Client Info		<b>08 Nov 2023</b>	08 Nov 2023	01 Apr 2023
Machine Age	days	Client Info	<b>0</b>	0	0
Oil Age	days	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>50	<b>&lt;1</b>	0	<1
Chromium	ppm	ASTM D5185(m)	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>10	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	0
Aluminum	ppm	ASTM D5185(m)	>3	<b>0</b>	0	0
Lead	ppm	ASTM D5185(m)	>75	<b>&lt;1</b>	<1	0
Copper	ppm	ASTM D5185(m)	>15	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185(m)	>55	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	4.0	<b>&lt;1</b>	<1	0
Barium	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	<1	0
Molybdenum	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185(m)	0	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185(m)	2.1	<b>2</b>	1	0
Zinc	ppm	ASTM D5185(m)	2.0	<b>5</b>	2	2
Sulfur	ppm	ASTM D5185(m)	1300	<b>57</b>	63	50
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1





## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>8	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>1584</b>	1477	890
Particles >6µm	ASTM D7647	>5000	<b>270</b>	360	203
Particles >14µm	ASTM D7647	>640	<b>16</b>	29	15
Particles >21µm	ASTM D7647	>160	<b>4</b>	7	4
Particles >38µm	ASTM D7647	>40	<b>0</b>	0	0
Particles >71µm	ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>18/15/11</b>	18/16/12	17/15/11

# OIL ANALYSIS REPORT

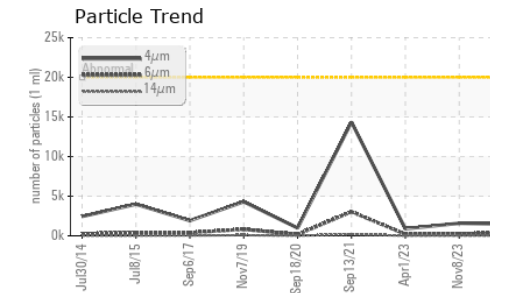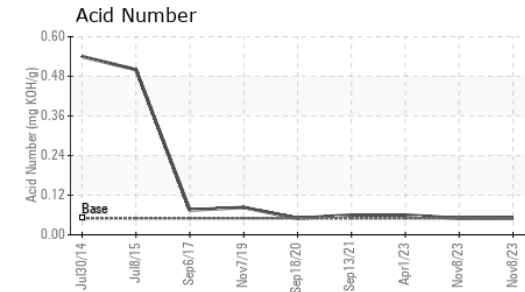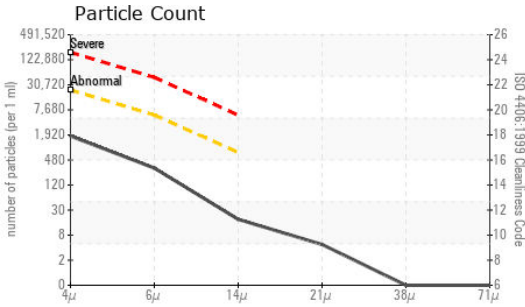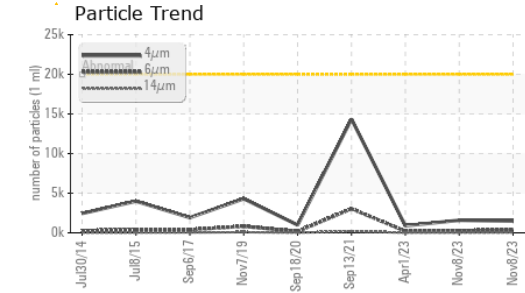

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **Nalcor Energy - Grand Falls-Windsor**  
**Sample No.** : WC0524888 **Received** : 14 Dec 2023  
**Lab Number** : 02603219 **Diagnosed** : 18 Dec 2023  
**Unique Number** : 5696304 **Diagnostician** : Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: TAN Man )


To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	.05	<b>0.05</b>	0.05	0.06

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	46	<b>▲ 66.0</b>	46.0	45.8

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

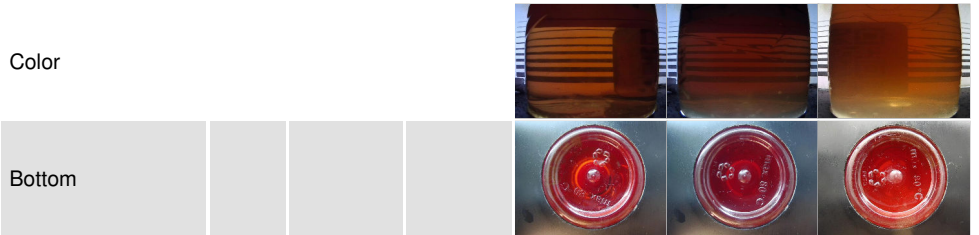

## GRAPHS

