




# PROBLEM SUMMARY

## Sample Rating Trend

ISO

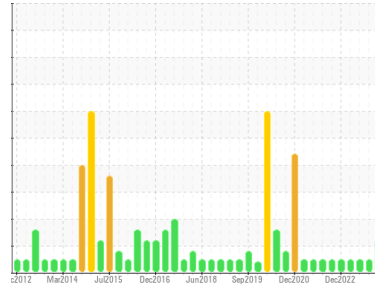


Area  
**2 Phoenix/020 ISO Dewax/P Pump/100A Feed Pump**  
 Machine Id  
**N/A 20P100A (West)**

Component  
**Pump**  
 Fluid  
**PETRO CANADA TURBOFLO 32 (136 LTR)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

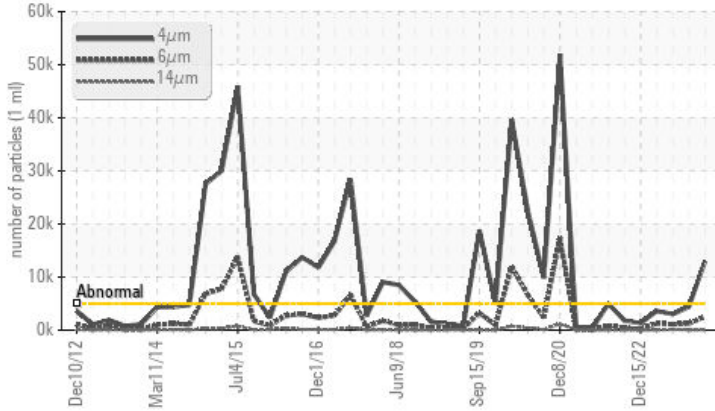

## RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	NORMAL
Particles >4µm	ASTM D7647	>5000	▲ <b>12975</b>	4377	3003
Particles >6µm	ASTM D7647	>1300	▲ <b>2550</b>	1225	1099
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ <b>21/19/13</b>	19/17/13	19/17/14

Customer Id: PETMIS  
 Sample No.: WC0883393  
 Lab Number: 02603333  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Wes Davis +1 905-569-8600 x223  
[wesd@wearcheck.ca](mailto:wesd@wearcheck.ca)

To change component or sample information:  
 Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.

## HISTORICAL DIAGNOSIS

### 30 Oct 2023 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



### 15 Sep 2023 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



### 15 Mar 2023 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


[view report](#)





# OIL ANALYSIS REPORT

Sample Rating Trend

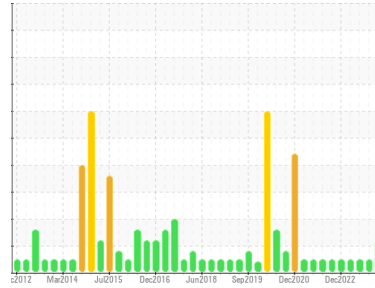

ISO



Area  
**2 Phoenix/020 ISO Dewax/P Pump/100A Feed Pump**  
 Machine Id  
**N/A 20P100A (West)**  
 Component  
**Pump**  
 Fluid  
**PETRO CANADA TURBOFLO 32 (136 LTR)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0883393</b>	WC0822068	WC0851462
Sample Date	Client Info		<b>15 Dec 2023</b>	30 Oct 2023	15 Sep 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>90	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>5	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185(m)	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	>3	<b>&lt;1</b>	<1	<1
Aluminum	ppm	ASTM D5185(m)	>7	<b>0</b>	<1	0
Lead	ppm	ASTM D5185(m)	>12	<b>0</b>	0	<1
Copper	ppm	ASTM D5185(m)	>30	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m)	>9	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	0	<1
Barium	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	<1	<1
Molybdenum	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185(m)	0	<b>0</b>	<1	<1
Phosphorus	ppm	ASTM D5185(m)	120	<b>2</b>	3	5
Zinc	ppm	ASTM D5185(m)	0.0	<b>&lt;1</b>	1	2
Sulfur	ppm	ASTM D5185(m)	0	<b>700</b>	616	754
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

## CONTAMINANTS


	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>60	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0

## FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>▲ 12975</b>	4377	3003
Particles >6µm	ASTM D7647	>1300	<b>▲ 2550</b>	1225	1099
Particles >14µm	ASTM D7647	>160	<b>76</b>	52	134
Particles >21µm	ASTM D7647	>40	<b>12</b>	10	27
Particles >38µm	ASTM D7647	>10	<b>1</b>	1	1
Particles >71µm	ASTM D7647	>3	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>▲ 21/19/13</b>	19/17/13	19/17/14

# OIL ANALYSIS REPORT


### ▲ Particle Trend

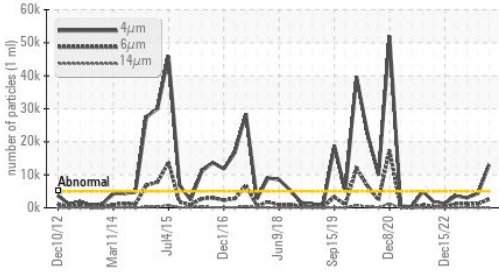


### ▲ Particle Trend

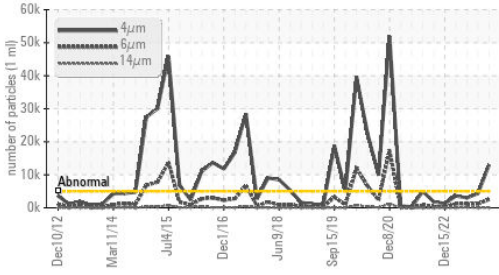

### Acid Number

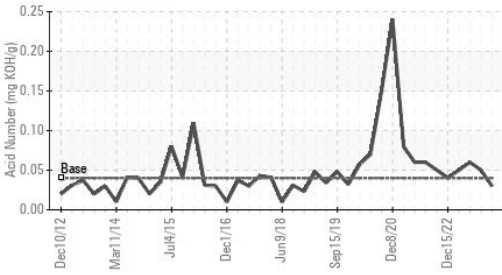

### Viscosity @ 40°C

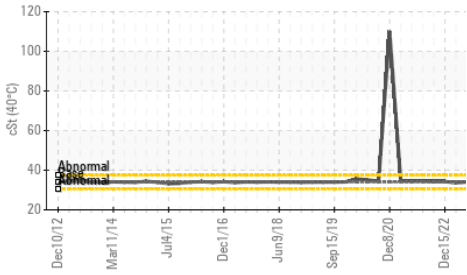


### FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN) mg KOH/g	ASTM D974*	0.04	<b>0.03</b>	0.05	0.06	
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

### FLUID PROPERTIES


method	limit/base	current	history1	history2	
Visc @ 40°C cSt	ASTM D7279(m)	34.0	<b>34.4</b>	34.0	34.1

### SAMPLE IMAGES

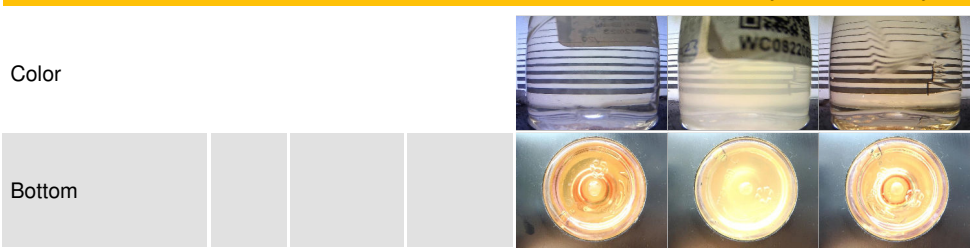


### GRAPHS


#### Ferrous Alloys

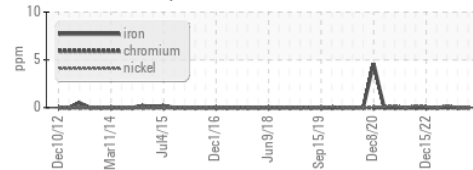


#### Non-ferrous Metals

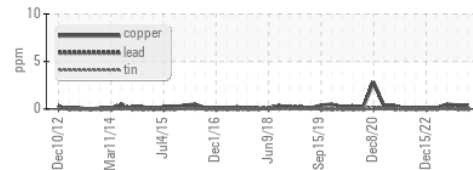


#### Viscosity @ 40°C

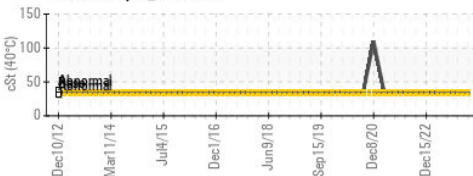

#### ▲ Particle Count

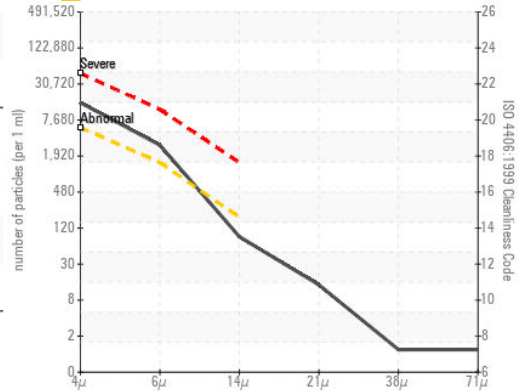

#### Acid Number

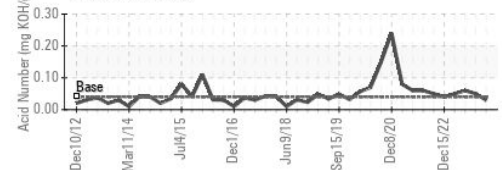

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0883393 **Received** : 14 Dec 2023  
**Lab Number** : 02603333 **Diagnosed** : 15 Dec 2023  
**Unique Number** : 5696418 **Diagnostician** : Wes Davis  
**Test Package** : IND 2 ( Additional Tests: TAN Man )

**Petro Canada Lubricants Inc.**  
 385 Southdown Road  
 Mississauga, ON  
 CA L5J 2Y3  
 Contact: Martin Wagenaar  
 martin.wagenaar@HFSinclair.com  
 T: (905)403-5682  
 F: (905)822-6025

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.