




# OIL ANALYSIS REPORT

Sample Rating Trend

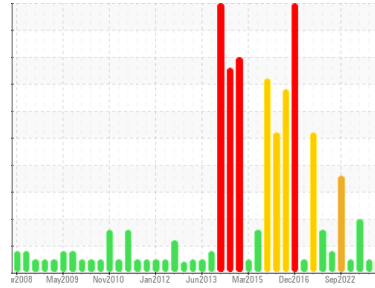

**NORMAL**



Area

## System 92 - Maintenance Facilities

Machine Id

### Q-9209 HYDRAULIC POWER UNIT, MAIN. WINCH, 37 KW

Component

#### Hydraulic System

Fluid

#### IRVING HYDRAULIC OIL LP 32 (1000 LTR)

#### DIAGNOSIS

##### Recommendation

Resample at the next service interval to monitor.

##### Wear

All component wear rates are normal.

##### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

##### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

#### SAMPLE INFORMATION

| method        |                 | limit/base | current            | history1    | history2    |
|---------------|-----------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info     |            | <b>PP</b>          | PP          | PP          |
| Sample Date   | Client Info     |            | <b>14 Dec 2023</b> | 31 Aug 2023 | 30 May 2023 |
| Machine Age   | hrs Client Info |            | <b>0</b>           | 0           | 0           |
| Oil Age       | hrs Client Info |            | <b>0</b>           | 0           | 0           |
| Oil Changed   | Client Info     |            | <b>N/A</b>         | N/A         | N/A         |
| Sample Status |                 |            | <b>NORMAL</b>      | NORMAL      | ABNORMAL    |

#### WEAR METALS

| method    |                   | limit/base | current | history1 | history2 |
|-----------|-------------------|------------|---------|----------|----------|
| Iron      | ppm ASTM D5185(m) | >20        | <1      | <1       | <1       |
| Chromium  | ppm ASTM D5185(m) | >10        | 0       | 0        | 0        |
| Nickel    | ppm ASTM D5185(m) | >10        | <1      | 0        | <1       |
| Titanium  | ppm ASTM D5185(m) |            | 0       | 0        | 0        |
| Silver    | ppm ASTM D5185(m) |            | <1      | <1       | <1       |
| Aluminum  | ppm ASTM D5185(m) | >10        | 0       | <1       | 0        |
| Lead      | ppm ASTM D5185(m) | >20        | <1      | <1       | <1       |
| Copper    | ppm ASTM D5185(m) | >20        | 4       | 4        | 4        |
| Tin       | ppm ASTM D5185(m) | >10        | 0       | 0        | 0        |
| Antimony  | ppm ASTM D5185(m) |            | 0       | 0        | 0        |
| Vanadium  | ppm ASTM D5185(m) |            | 0       | 0        | 0        |
| Beryllium | ppm ASTM D5185(m) |            | 0       | 0        | 0        |
| Cadmium   | ppm ASTM D5185(m) |            | 0       | 0        | 0        |

#### ADDITIVES

| method     |                   | limit/base | current | history1 | history2 |
|------------|-------------------|------------|---------|----------|----------|
| Boron      | ppm ASTM D5185(m) |            | <1      | 0        | <1       |
| Barium     | ppm ASTM D5185(m) |            | <1      | 0        | 0        |
| Molybdenum | ppm ASTM D5185(m) |            | 0       | 0        | 0        |
| Manganese  | ppm ASTM D5185(m) |            | 0       | 0        | 0        |
| Magnesium  | ppm ASTM D5185(m) |            | <1      | <1       | <1       |
| Calcium    | ppm ASTM D5185(m) |            | 50      | 51       | 49       |
| Phosphorus | ppm ASTM D5185(m) |            | 333     | 367      | 362      |
| Zinc       | ppm ASTM D5185(m) | 400        | 442     | 453      | 433      |
| Sulfur     | ppm ASTM D5185(m) |            | 2759    | 2874     | 2787     |
| Lithium    | ppm ASTM D5185(m) |            | <1      | <1       | <1       |

#### CONTAMINANTS






| method    |                   | limit/base | current | history1 | history2 |
|-----------|-------------------|------------|---------|----------|----------|
| Silicon   | ppm ASTM D5185(m) | >15        | <1      | 1        | <1       |
| Sodium    | ppm ASTM D5185(m) |            | 3       | 4        | 4        |
| Potassium | ppm ASTM D5185(m) | >20        | 0       | <1       | 3        |
| Water     | % ASTM D6304*     | >0.05      | 0.004   | 0.006    | 0.003    |
| ppm Water | ppm ASTM D6304*   | >500       | 44      | 67.6     | 27.9     |

#### FLUID CLEANLINESS

| method          |              | limit/base | current  | history1 | history2   |
|-----------------|--------------|------------|----------|----------|------------|
| Particles >4µm  | ASTM D7647   | >5000      | 3269     | 4215     | ▲ 9718     |
| Particles >6µm  | ASTM D7647   | >1300      | 911      | 901      | ▲ 3923     |
| Particles >14µm | ASTM D7647   | >160       | 88       | 49       | ▲ 478      |
| Particles >21µm | ASTM D7647   | >40        | 20       | 7        | ▲ 158      |
| Particles >38µm | ASTM D7647   | >10        | 2        | 0        | 10         |
| Particles >71µm | ASTM D7647   | >3         | 0        | 0        | 0          |
| Oil Cleanliness | ISO 4406 (c) | >19/17/14  | 19/17/14 | 19/17/13 | ▲ 20/19/16 |



# OIL ANALYSIS REPORT

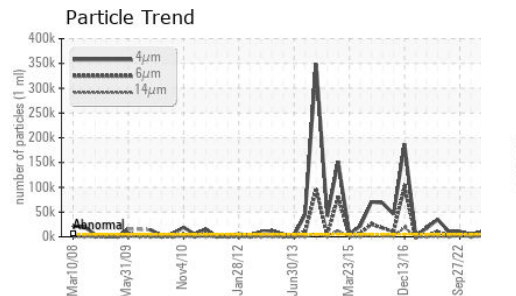
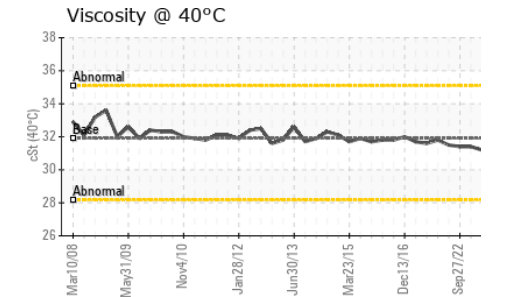
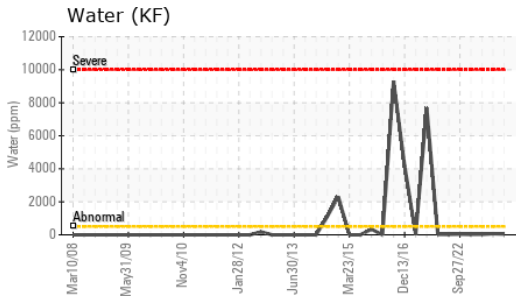
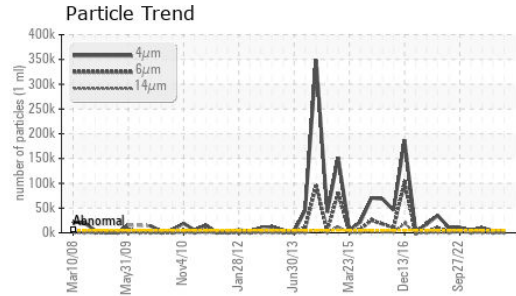
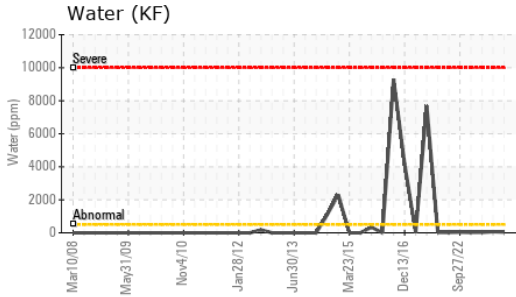


| FLUID DEGRADATION |          | method     | limit/base | current      | history1 | history2 |
|-------------------|----------|------------|------------|--------------|----------|----------|
| Acid Number (AN)  | mg KOH/g | ASTM D974* |            | <b>0.43</b>  | 0.40     | 0.41     |
| VISUAL            |          | method     | limit/base | current      | history1 | history2 |
| White Metal       | scalar   | Visual*    | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Yellow Metal      | scalar   | Visual*    | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Precipitate       | scalar   | Visual*    | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Silt              | scalar   | Visual*    | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Debris            | scalar   | Visual*    | NONE       | <b>NONE</b>  | VLITE    | NONE     |
| Sand/Dirt         | scalar   | Visual*    | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Appearance        | scalar   | Visual*    | NORML      | <b>NORML</b> | NORML    | NORML    |
| Odor              | scalar   | Visual*    | NORML      | <b>NORML</b> | NORML    | NORML    |
| Emulsified Water  | scalar   | Visual*    | >0.05      | <b>NEG</b>   | .2%      | .2%      |
| Free Water        | scalar   | Visual*    |            | <b>NEG</b>   | NEG      | NEG      |

| FLUID PROPERTIES |     | method        | limit/base | current     | history1 | history2 |
|------------------|-----|---------------|------------|-------------|----------|----------|
| Visc @ 40°C      | cSt | ASTM D7279(m) | 31.9       | <b>31.7</b> | 31.5     | 31.2     |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
| Color         |        |            |         |          |          |
| Bottom        |        |            |         |          |          |

## GRAPHS

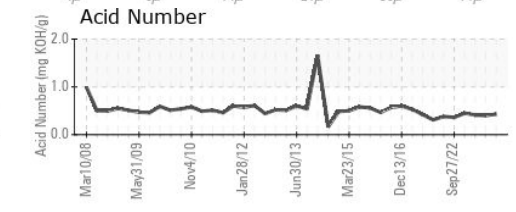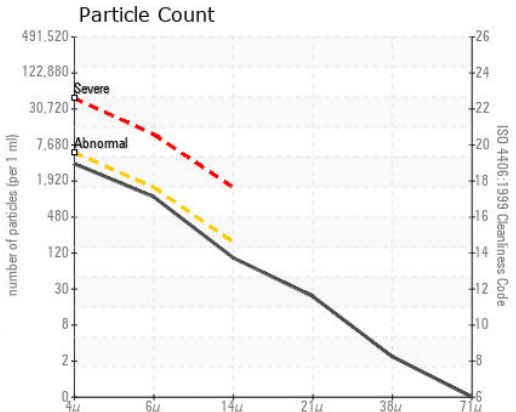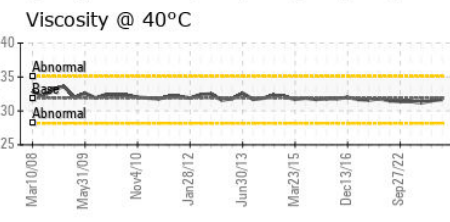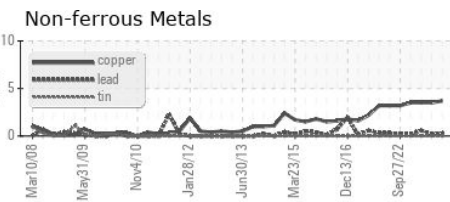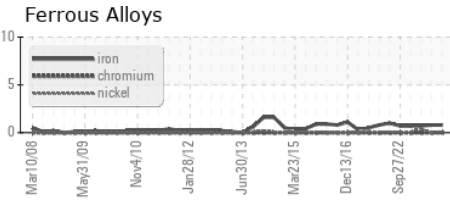

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **HIBERNIA MGMT & DEVELOPMENT CO. LTD**  
**Sample No.** : PP **Received** : 15 Dec 2023 **SUITE 1000,, 100 NEW GOWER STREET**  
**Lab Number** : **02603494** **Diagnosed** : 18 Dec 2023 **ST.JOHN'S, NL**  
**Unique Number** : 5696579 **Diagnostician** : Wes Davis **CA A1C 6K3**  
**Test Package** : MAR 2 ( Additional Tests: KF ) **Contact: Sam Nash**  
*To discuss this sample report, contact Customer Service at 1-800-268-2131.* **samantha.m.nash@exxonmobil.com**  
*Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.* **T:**  
*Validity of results and interpretation are based on the sample and information as supplied.* **F: (709)722-3766**